


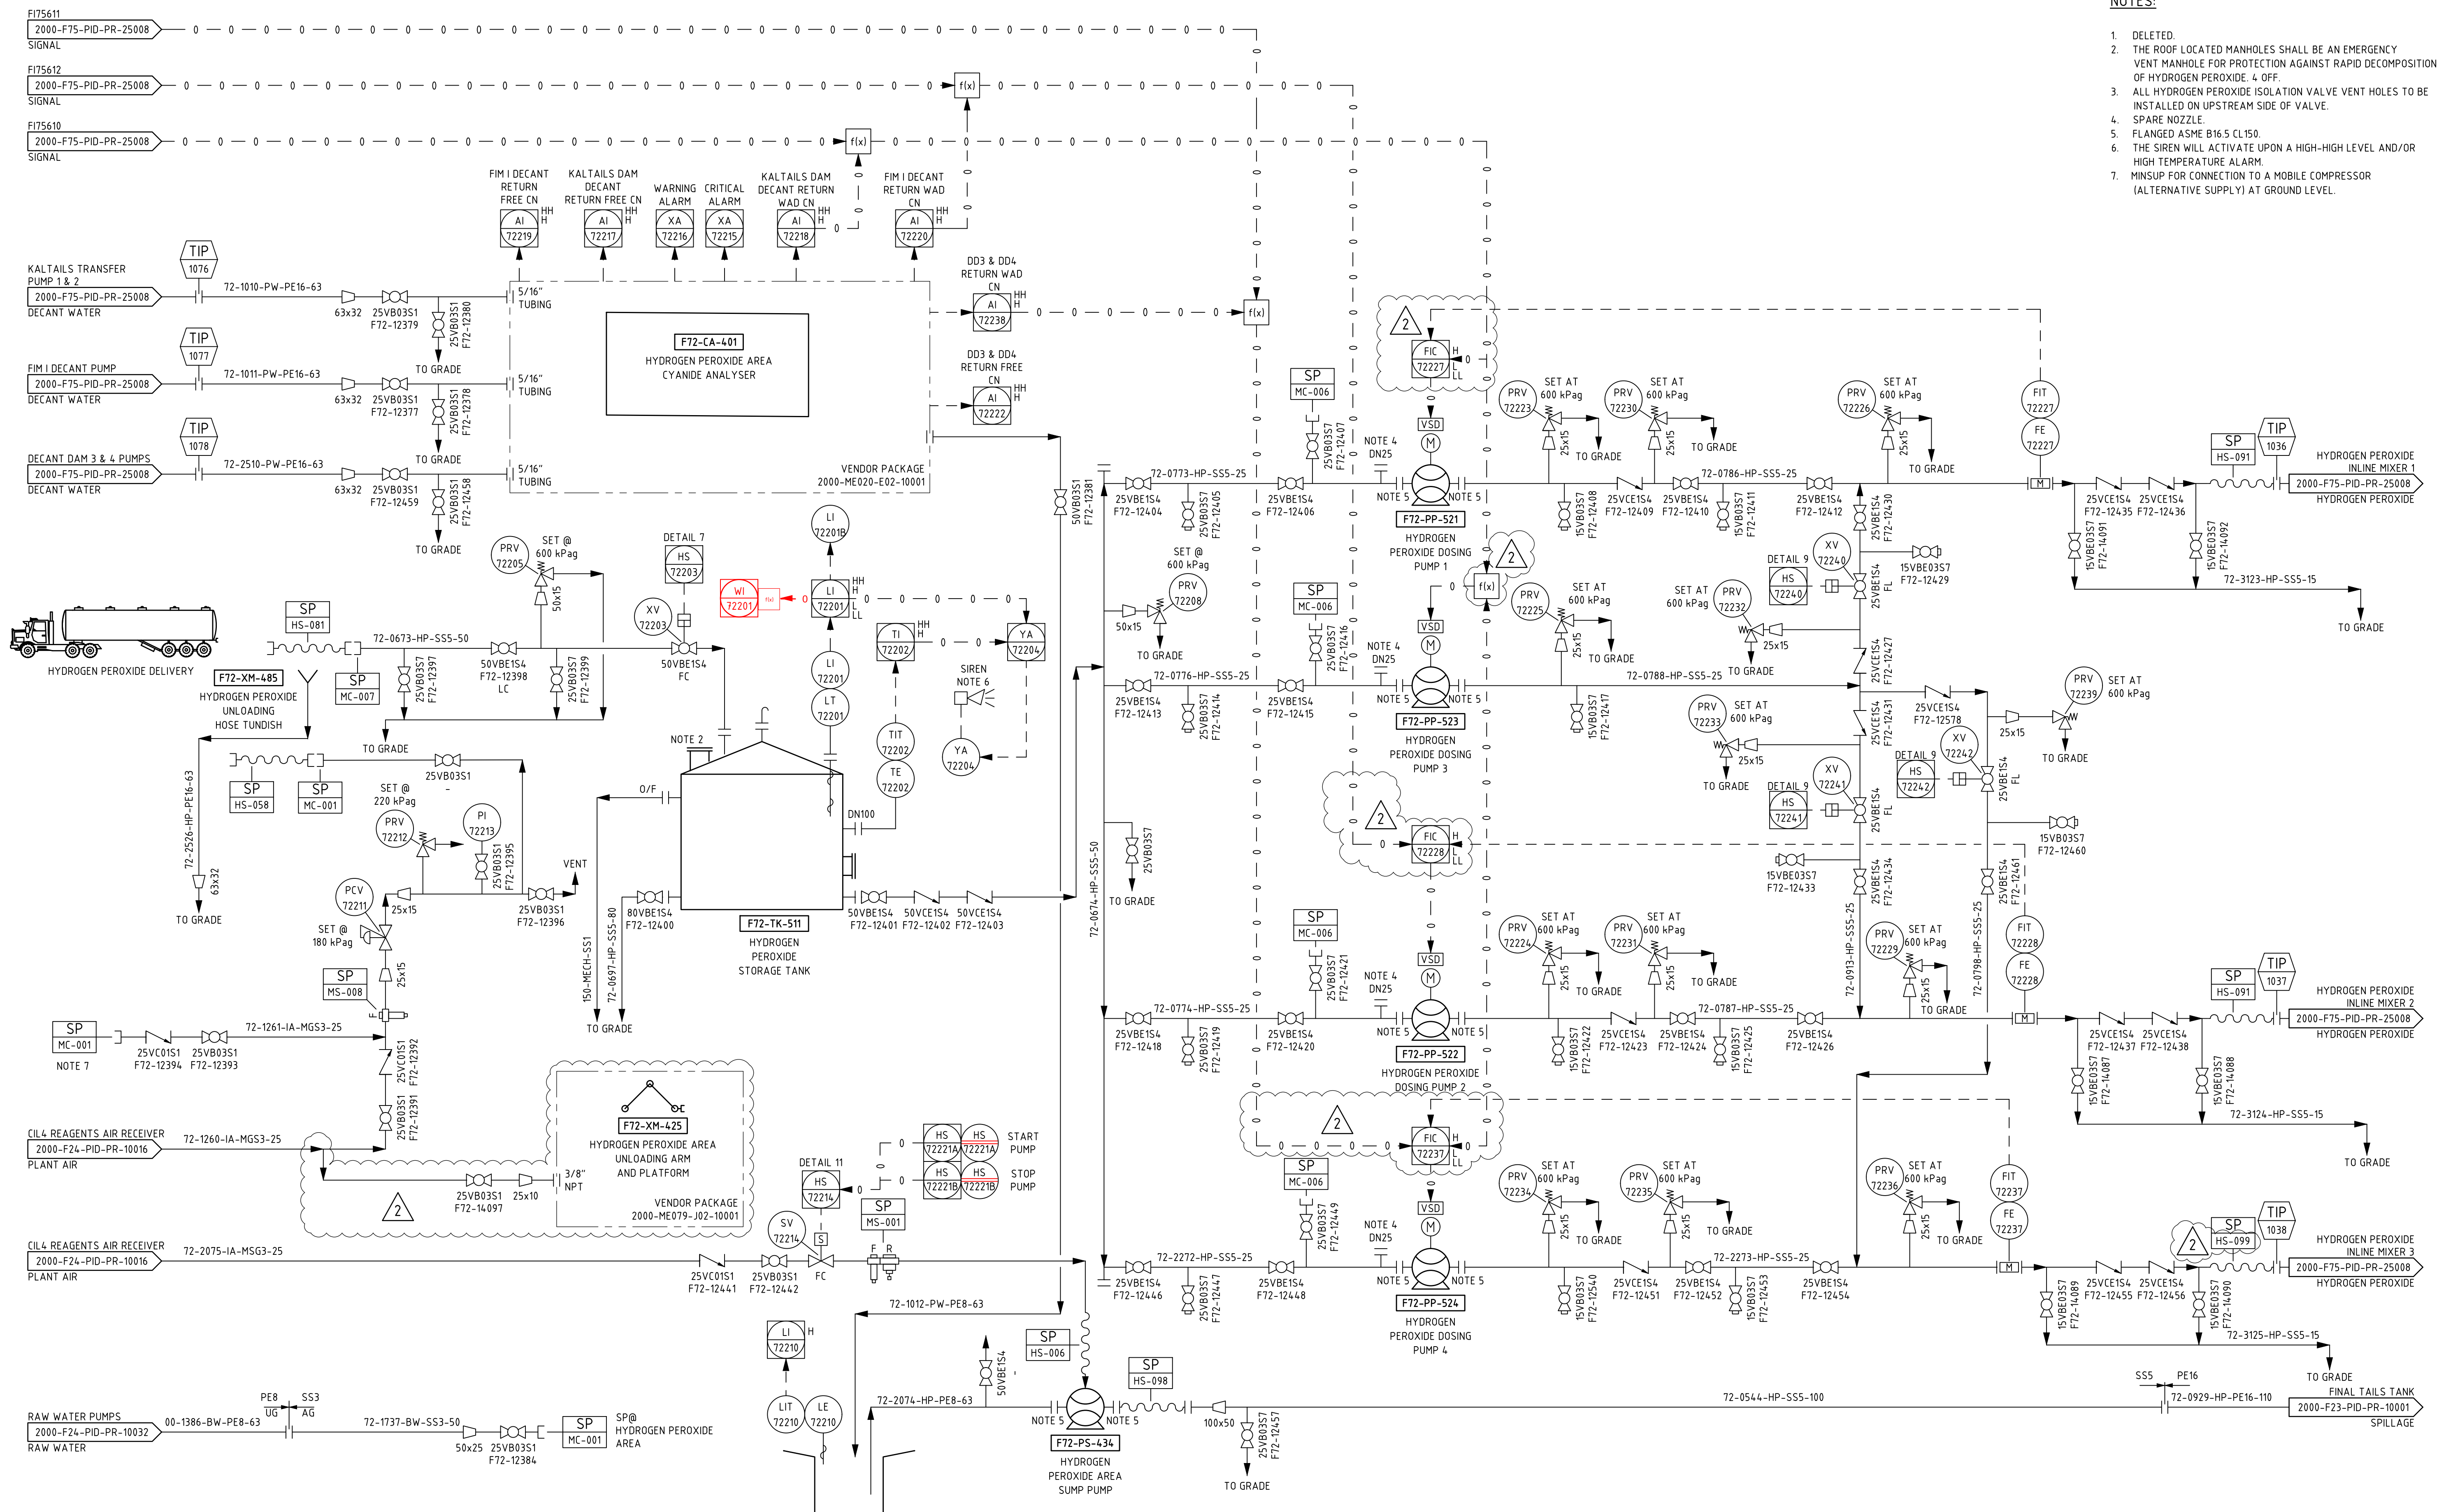

NOTES:

1. DELETED.
2. THE ROOF LOCATED MANHOLES SHALL BE AN EMERGENCY VENT MANHOLE FOR PROTECTION AGAINST RAPID DECOMPOSITION OF HYDROGEN PEROXIDE. 4 OFF.
3. ALL HYDROGEN PEROXIDE ISOLATION VALVE VENT HOLES TO BE INSTALLED ON UPSTREAM SIDE OF VALVE.
4. SPARE NOZZLE.
5. FLANGED ASME B16.5 CL150.
6. THE SIREN WILL ACTIVATE UPON A HIGH-HIGH LEVEL AND/OR HIGH TEMPERATURE ALARM.
7. MINSUP FOR CONNECTION TO A MOBILE COMPRESSOR (ALTERNATIVE SUPPLY) AT GROUND LEVEL.