


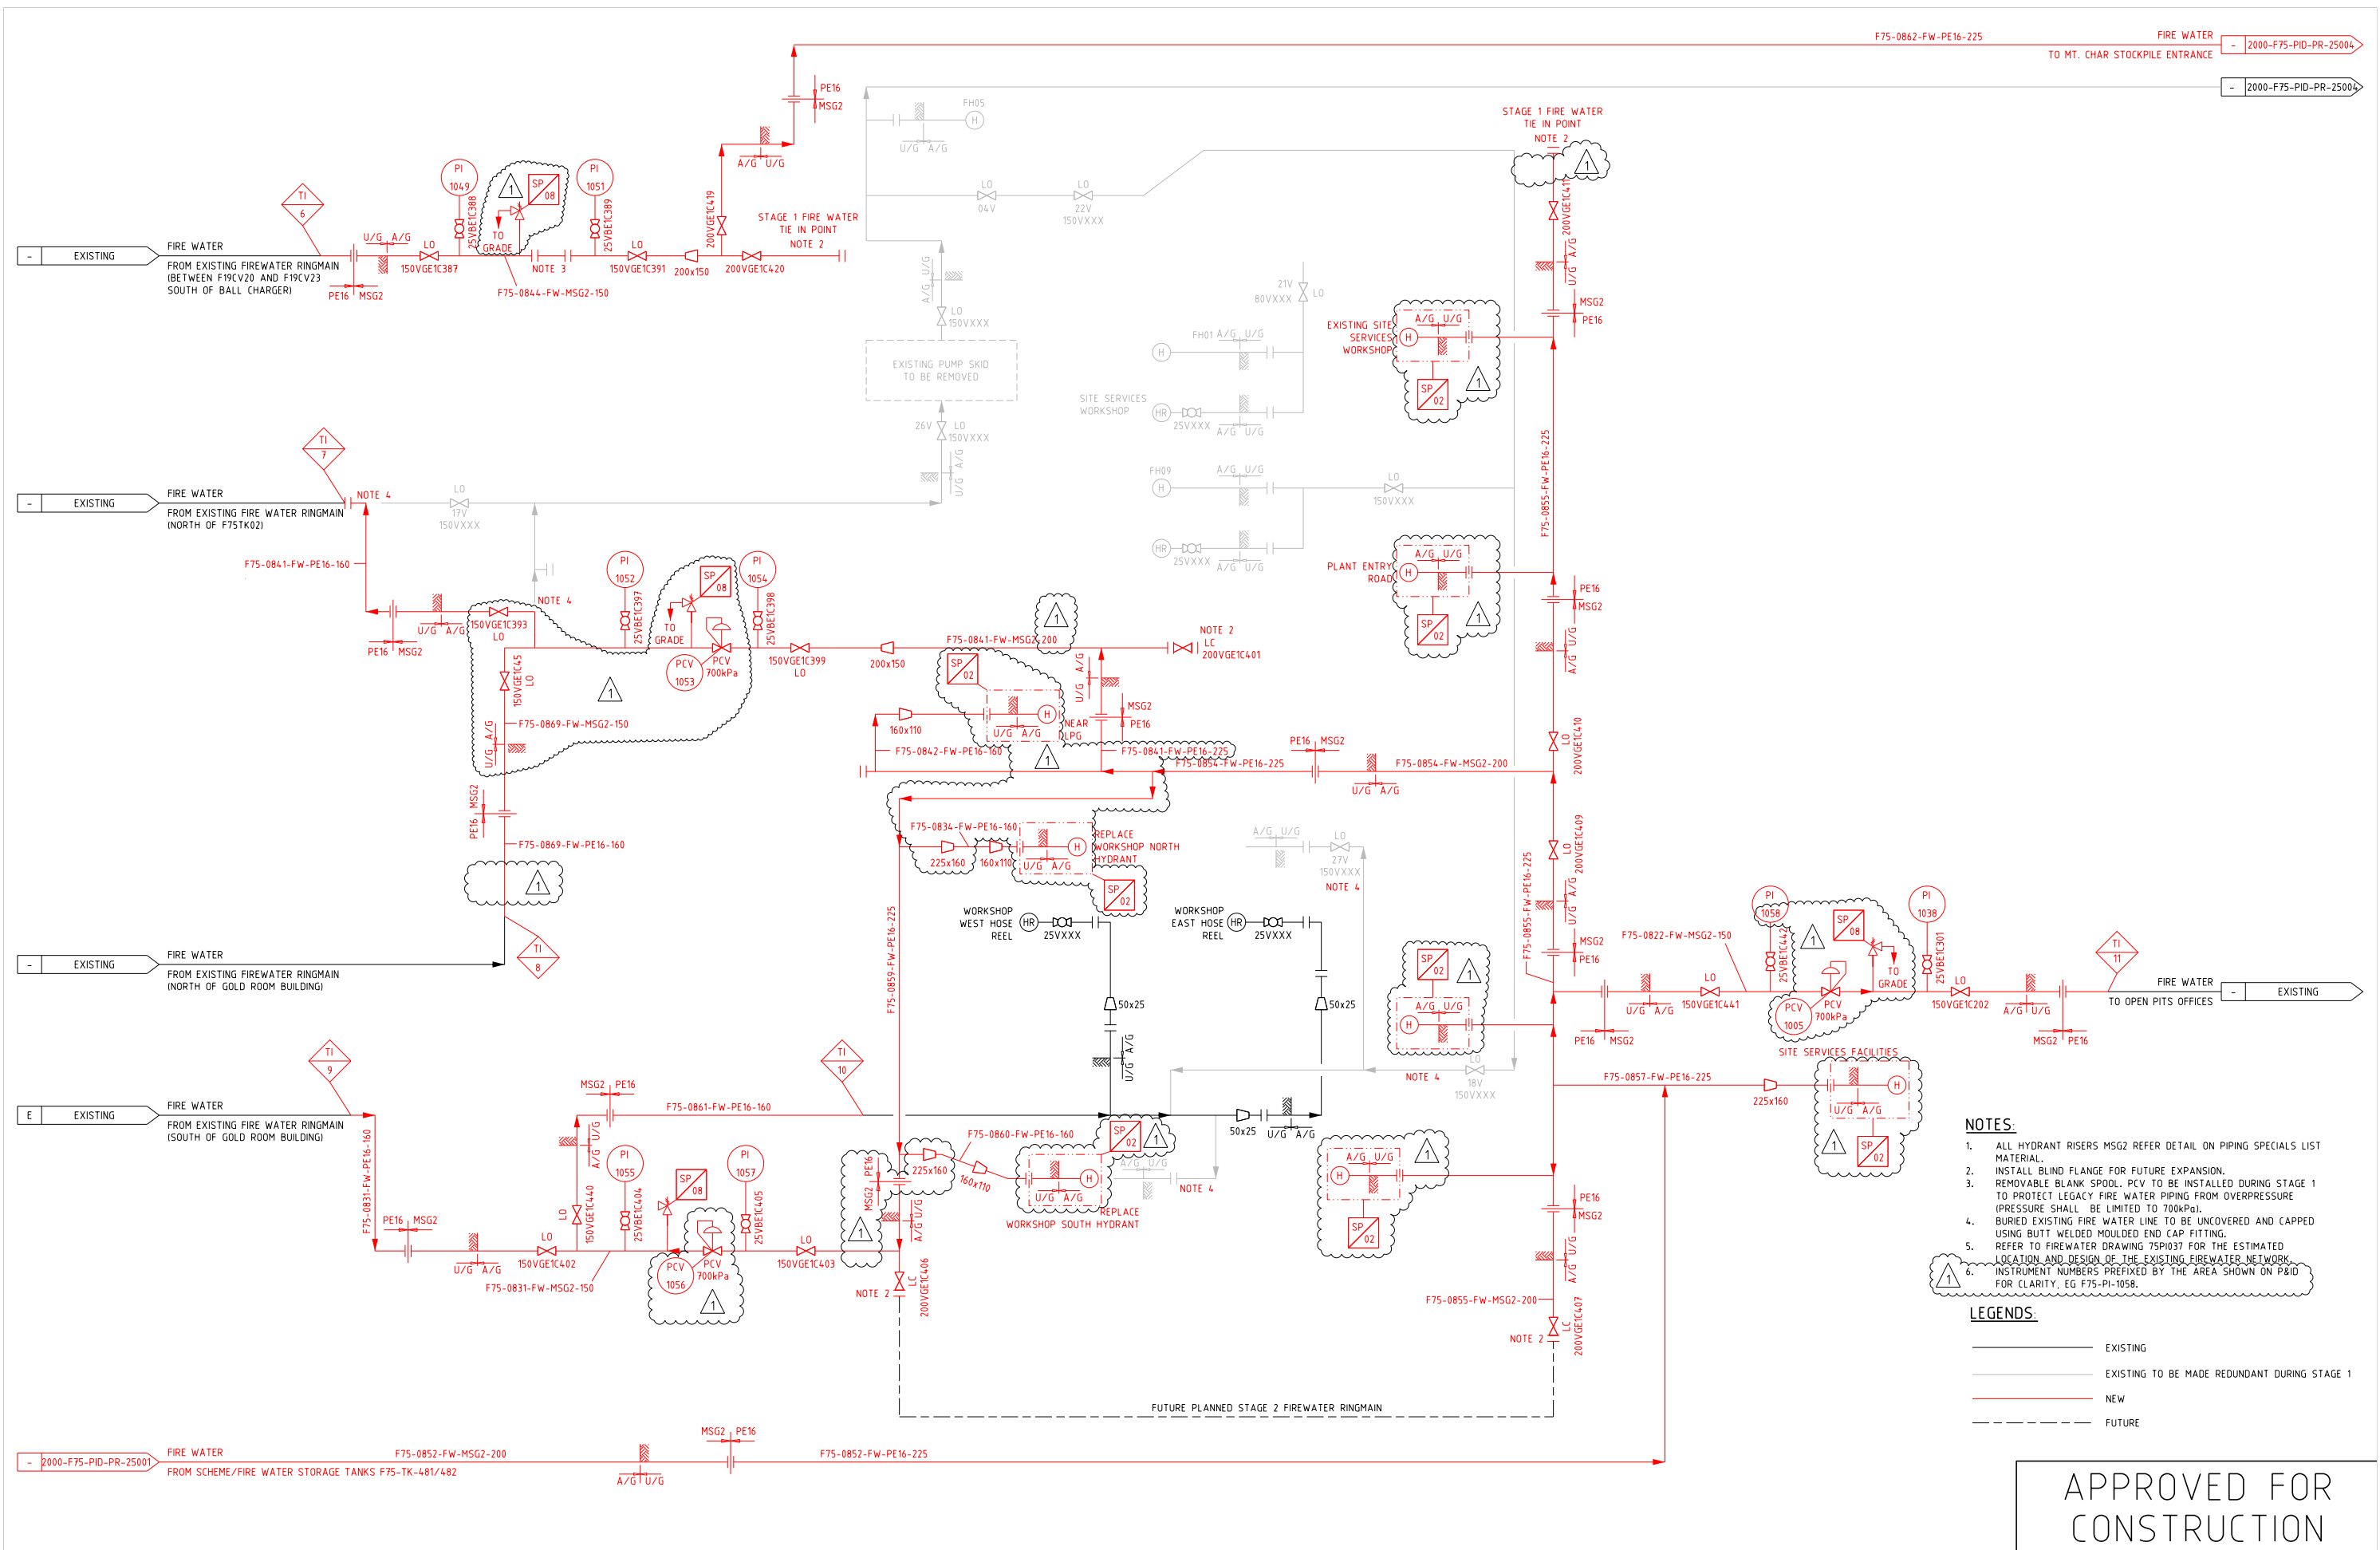

- NOTES:**
1. ALL HYDRANT RISERS MSG2 REFER DETAIL ON PIPING SPECIALS LIST MATERIAL.
 2. INSTALL BLIND FLANGE FOR FUTURE EXPANSION.
 3. REMOVABLE BLANK SPOOL. PCV TO BE INSTALLED DURING STAGE 1 TO PROTECT LEGACY FIRE WATER PIPING FROM OVERPRESSURE (PRESSURE SHALL BE LIMITED TO 700kPa).
 4. BURIED EXISTING FIRE WATER LINE TO BE UNCOVERED AND CAPPED USING BUTT WELDED MOULDED END CAP FITTING.
 5. REFER TO FIREWATER DRAWING 75PI037 FOR THE ESTIMATED LOCATION AND DESIGN OF THE EXISTING FIREWATER NETWORK.
 6. INSTRUMENT NUMBERS PREFIXED BY THE AREA SHOWN ON P&ID FOR CLARITY, EG F75-PI-1058.

- LEGENDS:**
- EXISTING
 - EXISTING TO BE MADE REDUNDANT DURING STAGE 1
 - NEW
 - - - FUTURE

APPROVED FOR
CONSTRUCTION