


- NOTES:**
- 1. FUTURE STAGE 1 HIGH PRESSURE FIRE WATER TIE IN TO BACKFEED LEGACY SYSTEM.
 - 2. BURIED EXISTING FIREWATER LINE TO BE UNCOVERED AND CAPPED USING BUTT WELDED MOULDED END CAP FITTING.

- LEGENDS:**
- EXISTING
 - EXISTING TO BE MADE REDUNDANT DURING STAGE 1
 - NEW
 - FUTURE

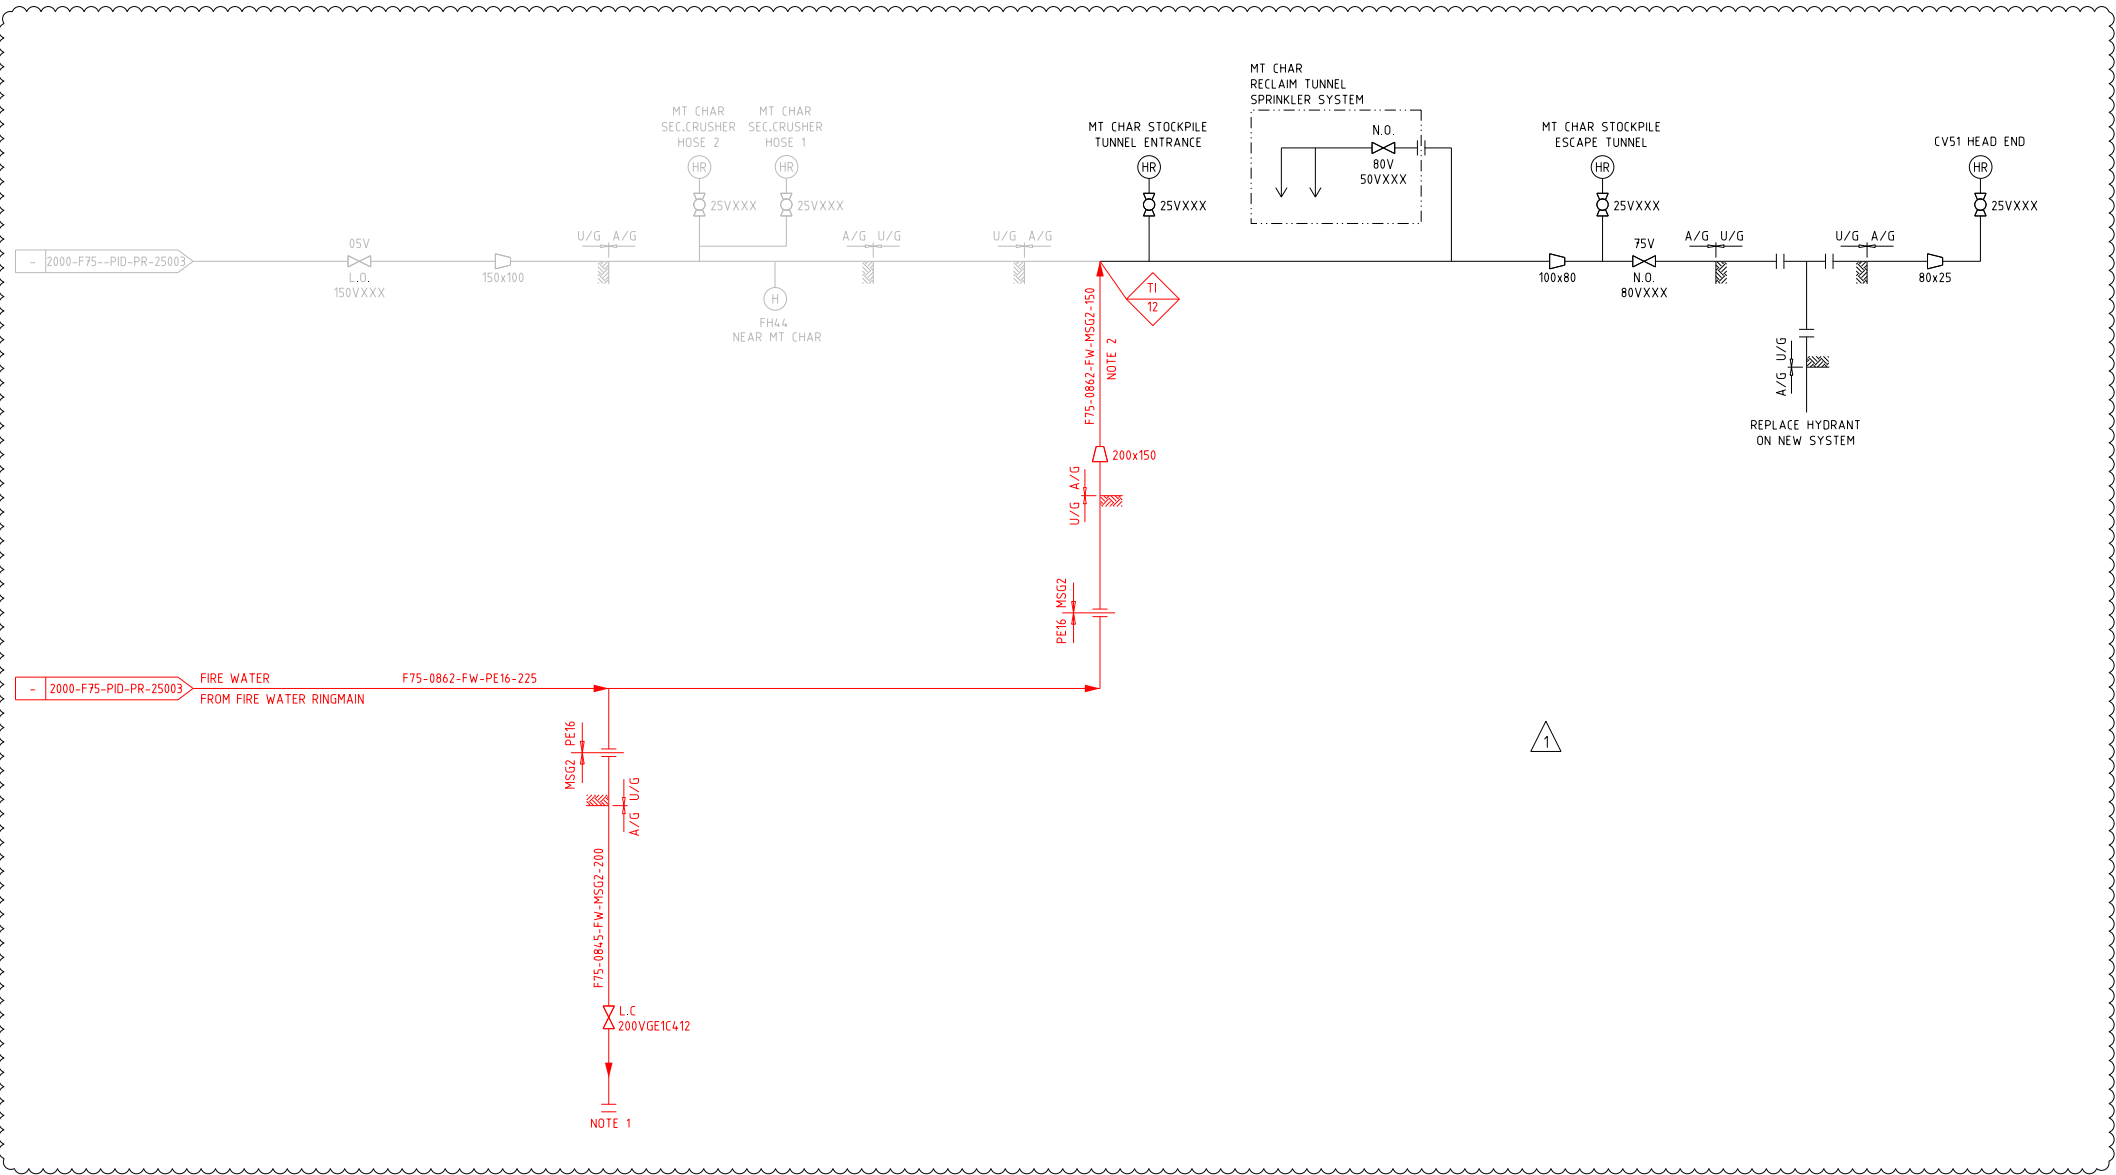

APPROVED FOR
CONSTRUCTION