


- NOTES:
1. REFER TO 2000-F75-PID-PR-40008
FOR PUMP AND PUMP HEADER DETAILS.
2. SEEPAGE WATER HEADER HAS BEEN SIZED FOR A
MAXIMUM OF 20 FUTURE SEEPAGE BORE PUMPS
ACCORDING TO HYDROGEOLOGY REPORT
2000-T00-REP-GE-40001.
- LEGEND:
EXISTING
NEW
FUTURE
DECOMMISSIONED

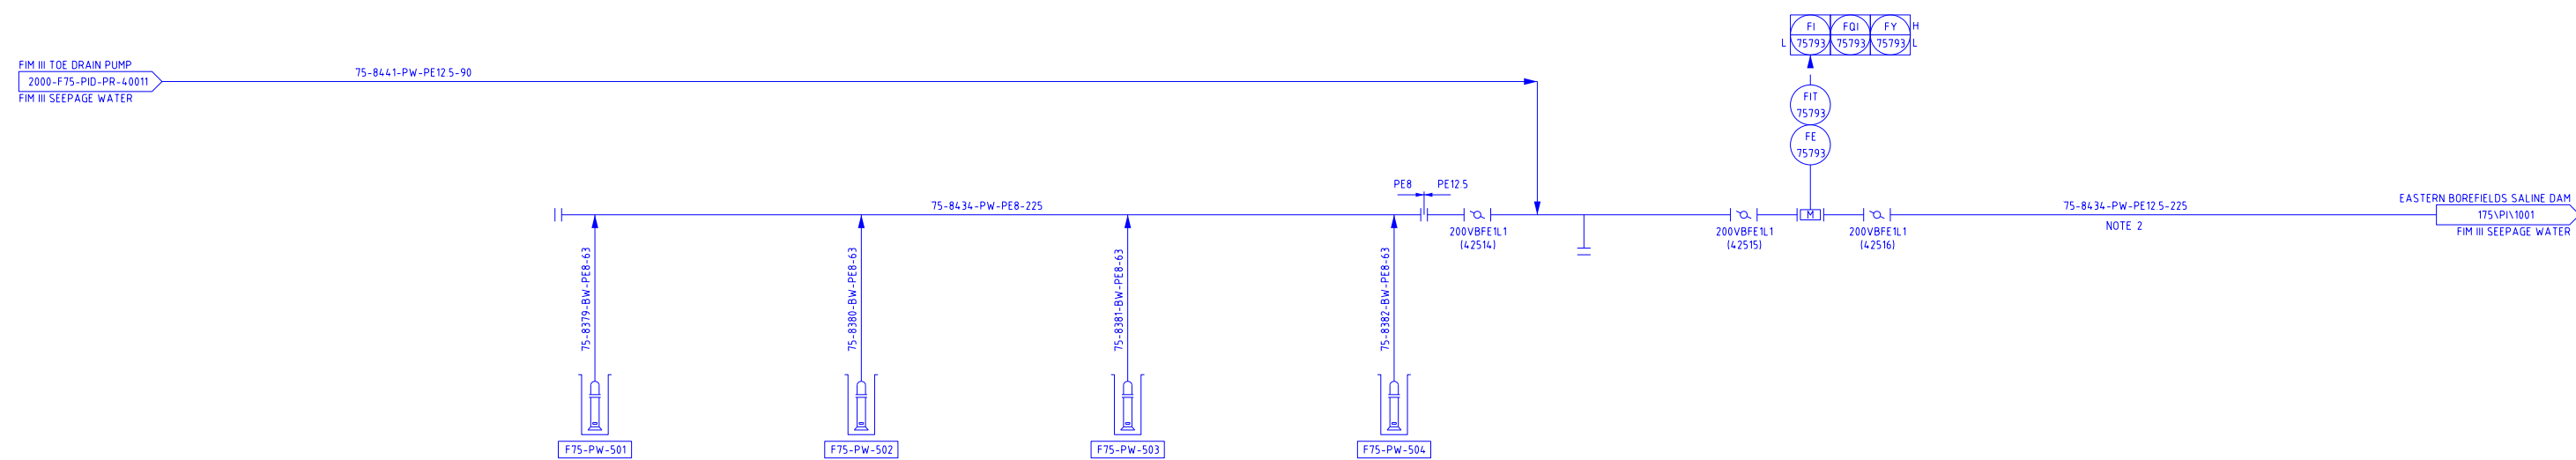

APPROVED FOR
CONSTRUCTION