
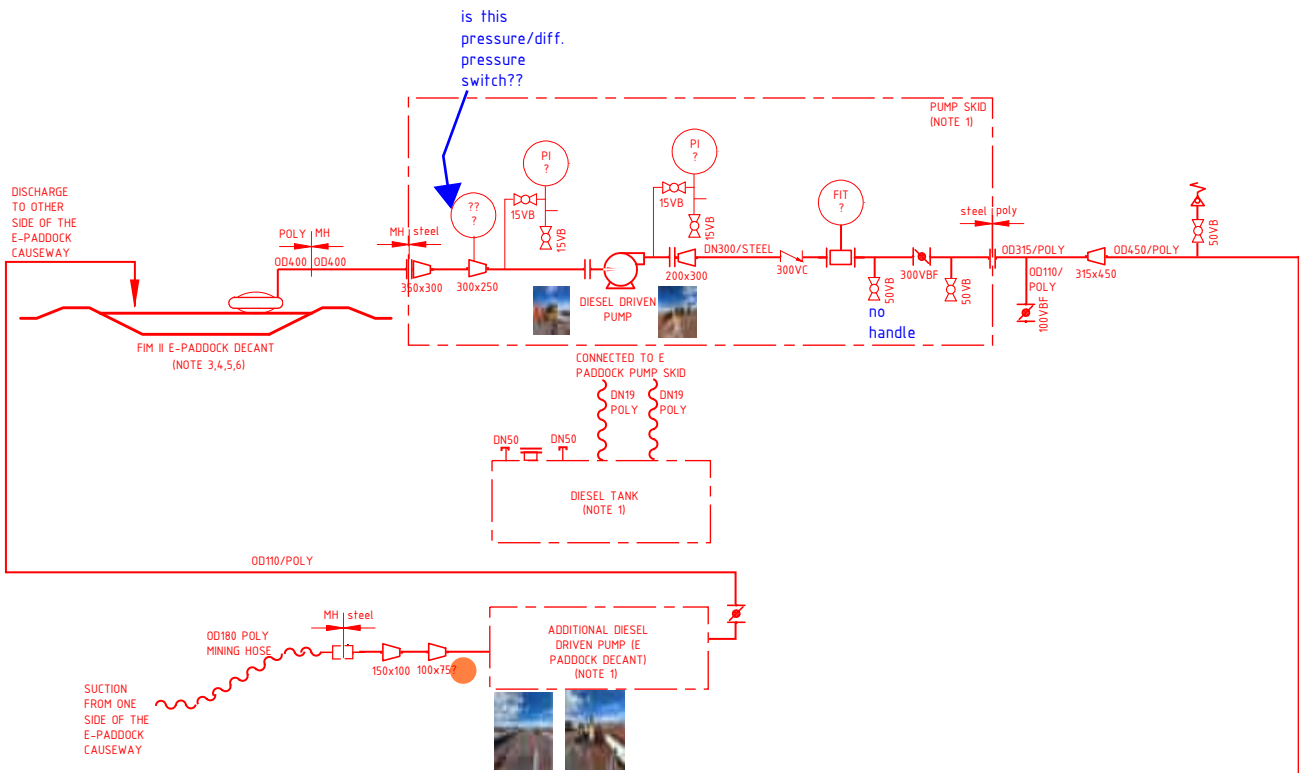


- NOTES:
1. FOR DETAILS OF VENDOR SKID, REFER TO SUPPLIER DOCUMENTATION.
 2. UNDERGROUND PIPING CANNOT BE VERIFIED VISUALLY AND SO CANNOT BE CONFIRMED. TBC - BY CLIENT.
 3. NO LEVEL INSTRUMENT SEEN IN FIELD.
 4. NO ANTISCALANT DOSING SYSTEM SEEN IN FIELD.
 5. NO POTABLE WASH UNIT SEEN IN FIELD.
 6. PUMP NUMBER, INSTRUMENT DESCRIPTION/TAG NUMBERS NOT FOUND IN FIELD.
 7. UNIDENTIFIED FITTING

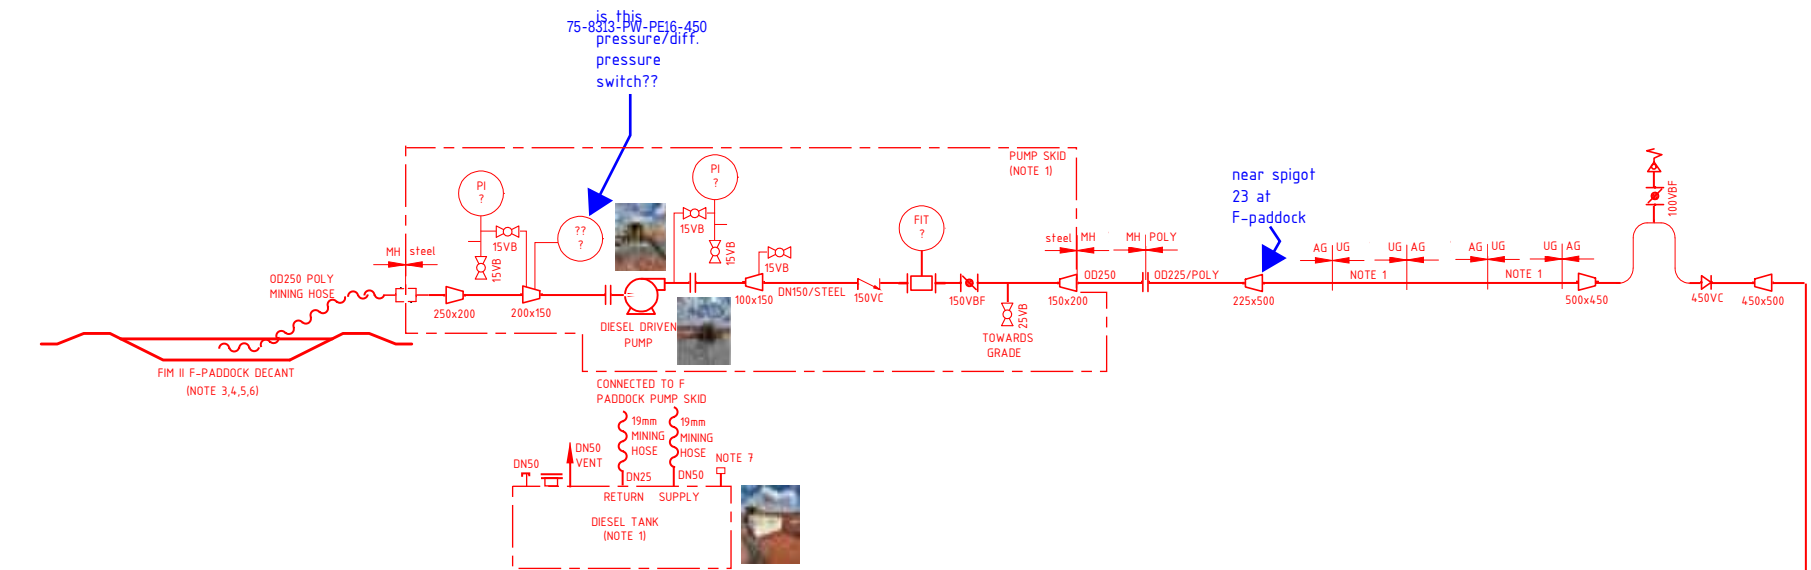