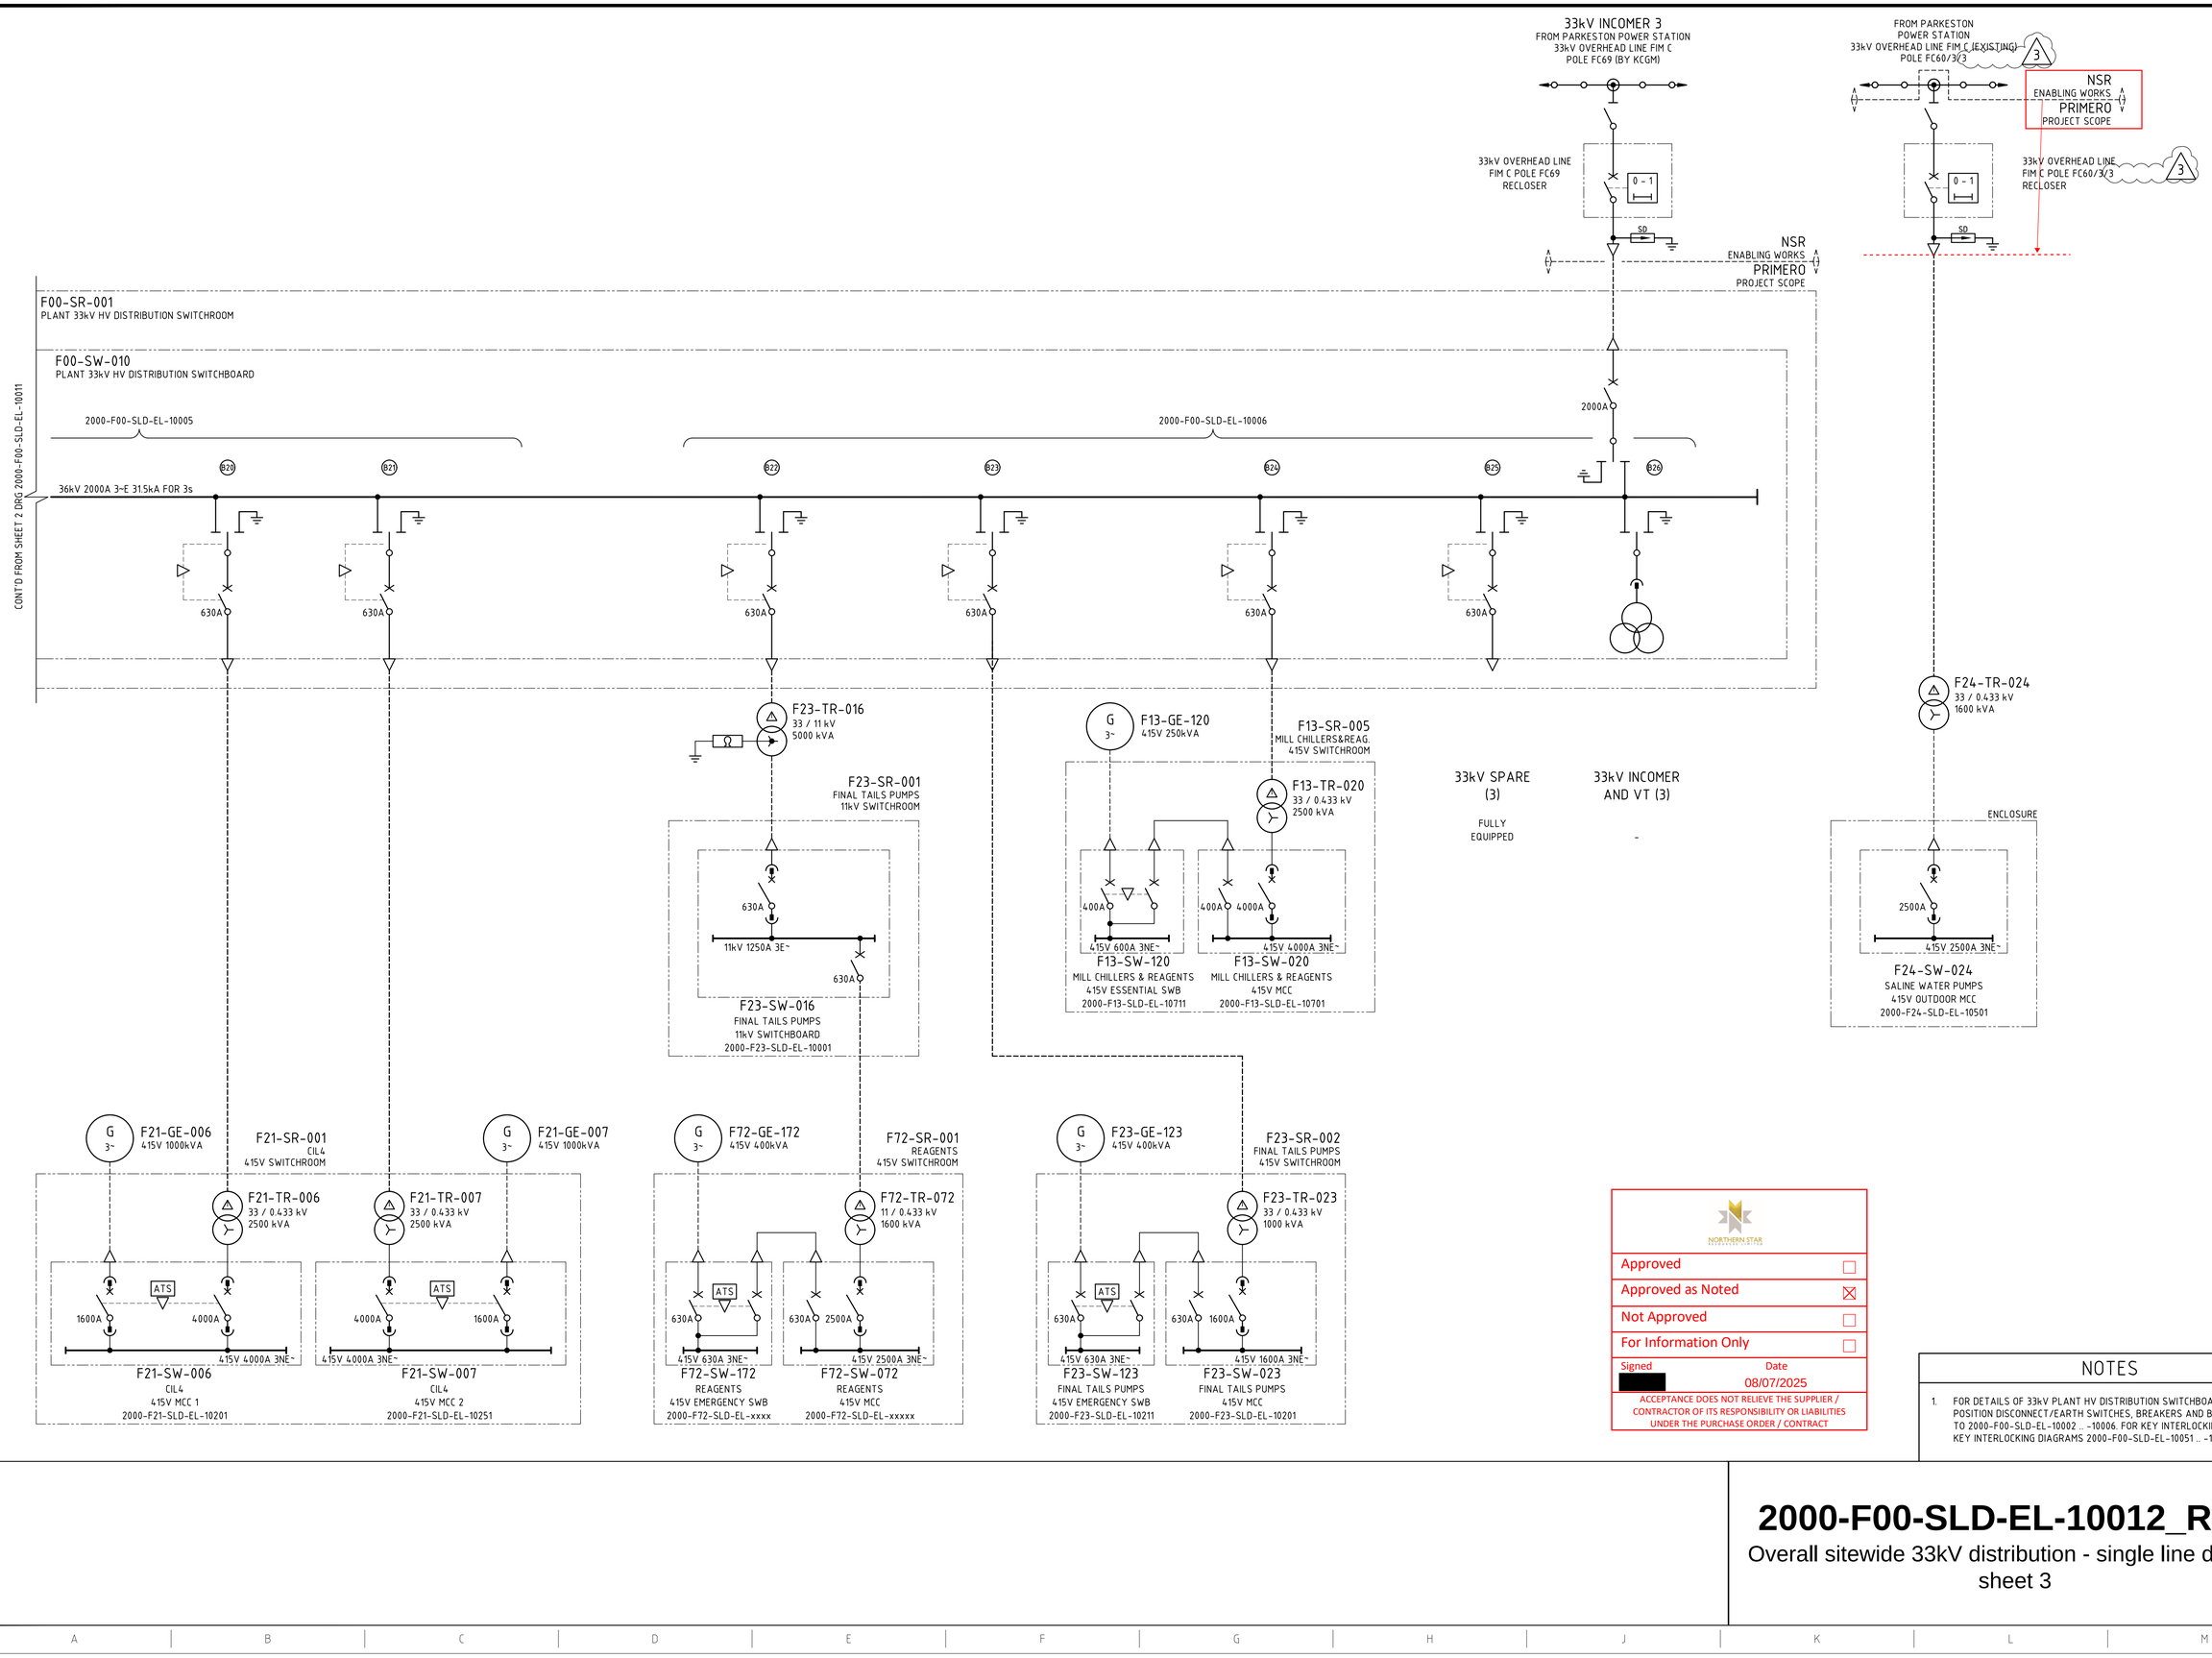


Approved	☐
Approved as Noted	☒
Not Approved	☐
For Information Only	☐

Signed [redacted] Date 08/07/2025

ACCEPTANCE DOES NOT RELIEVE THE SUPPLIER / CONTRACTOR OF ITS RESPONSIBILITY OR LIABILITIES UNDER THE PURCHASE ORDER / CONTRACT

NOTES

1. FOR DETAILS OF 33kV PLANT HV DISTRIBUTION SWITCHBOARD THREE POSITION DISCONNECT/EARTH SWITCHES, BREAKERS AND BUS TIES REFER TO 2000-F00-SLD-EL-10002 .. -10006. FOR KEY INTERLOCKING, REFER TO KEY INTERLOCKING DIAGRAMS 2000-F00-SLD-EL-10051 .. -10055

2000-F00-SLD-EL-10012_Rev3

Overall sitewide 33kV distribution - single line diagram sheet 3

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\EL\F00 - GENERAL FINISTON SITE\2000-F00-SLD-EL-10012.DWG 22JUL25 12:17PM ANTONY.DECAPRIO