




F12UPS002-ISL
240VAC UPS
MAINTENANCE
BYPASS SWITCH
11 kW

2000-F12-TLD-EL-10102



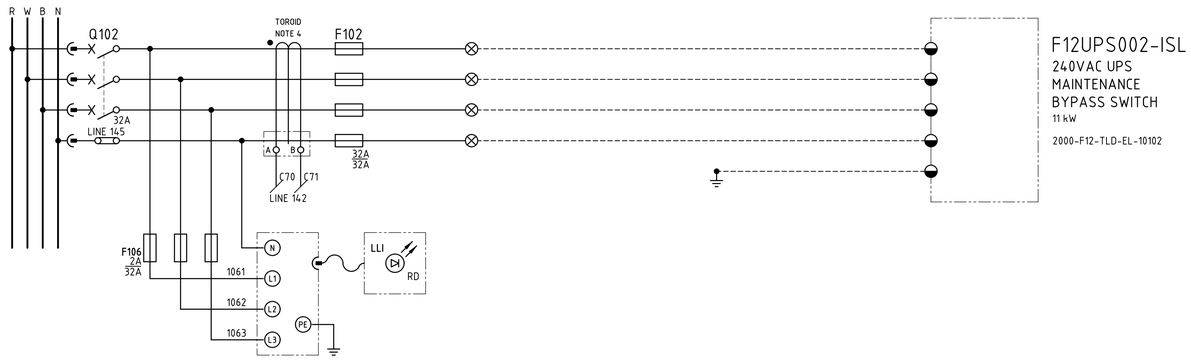




CABLE ZONE
24VDC TERMINALS

24VDC
LOOPED POWER
NEXT MODULE
PREV MODULE

| | | |
|---|---|---|
| Q120 | 4A | 2570 |
| 1 | | 2580 |
| 2 | | 2580 |
| 3 | | |
| 4 | | |
| 5 | | |
| 6 | | |
| 7 | | |
| 8 | ⏚ | EARTH |

NOTE 2

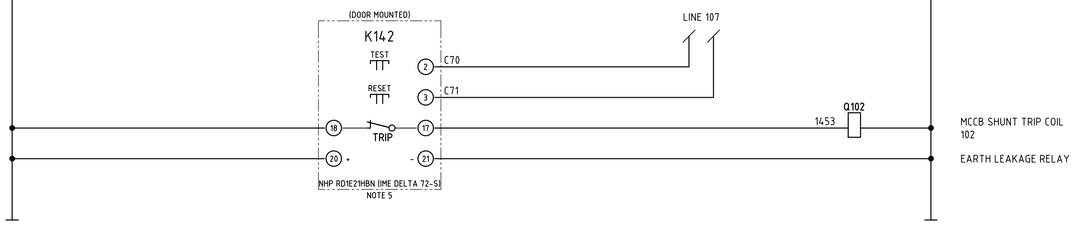



## NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F12UPS002-1200, UNLESS OTHERWISE NOTED.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGB2
   IN:70A IΔN MIN:0.03A TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR. RELAY ENERGISED (NORMALLY CLOSED CONTACT OPEN) IN NORMAL OPERATION.

## LEGEND

| | |
|---|---|
| 00/01/00 | DCS DIGITAL INPUT |
| 00/02/00 | DCS DIGITAL OUTPUT |
| ⊗ | MCC TERMINAL |
| ◓ | VSD TERMINAL |
| ◒ | FIELD TERMINAL |
| ◑ | DCS OR I/O TERMINAL |
| ◧ | MARSHALLING TERMINAL |
| ⊗ x | DEVICE TERMINAL |
| ⊗ cc | INDICATION LAMP<br>cc = COLOUR |

## TERMINATION LEGEND

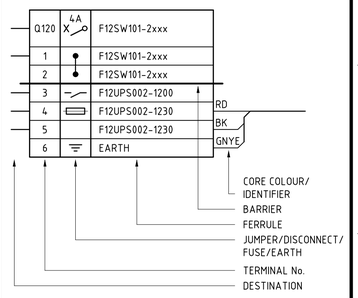


# 2000-F12-SCM-EL-10206_Rev2

F12-SW-101 - f12UPS002-isl 240VAC UPS maintenance bypass sw - schematic and termination diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\ELV\F12 - PRIMARY CRUSHING\2000-F12-SCM-EL-10206.DWG 24.AUG26 11.07PM GRENVILLE.DEASY