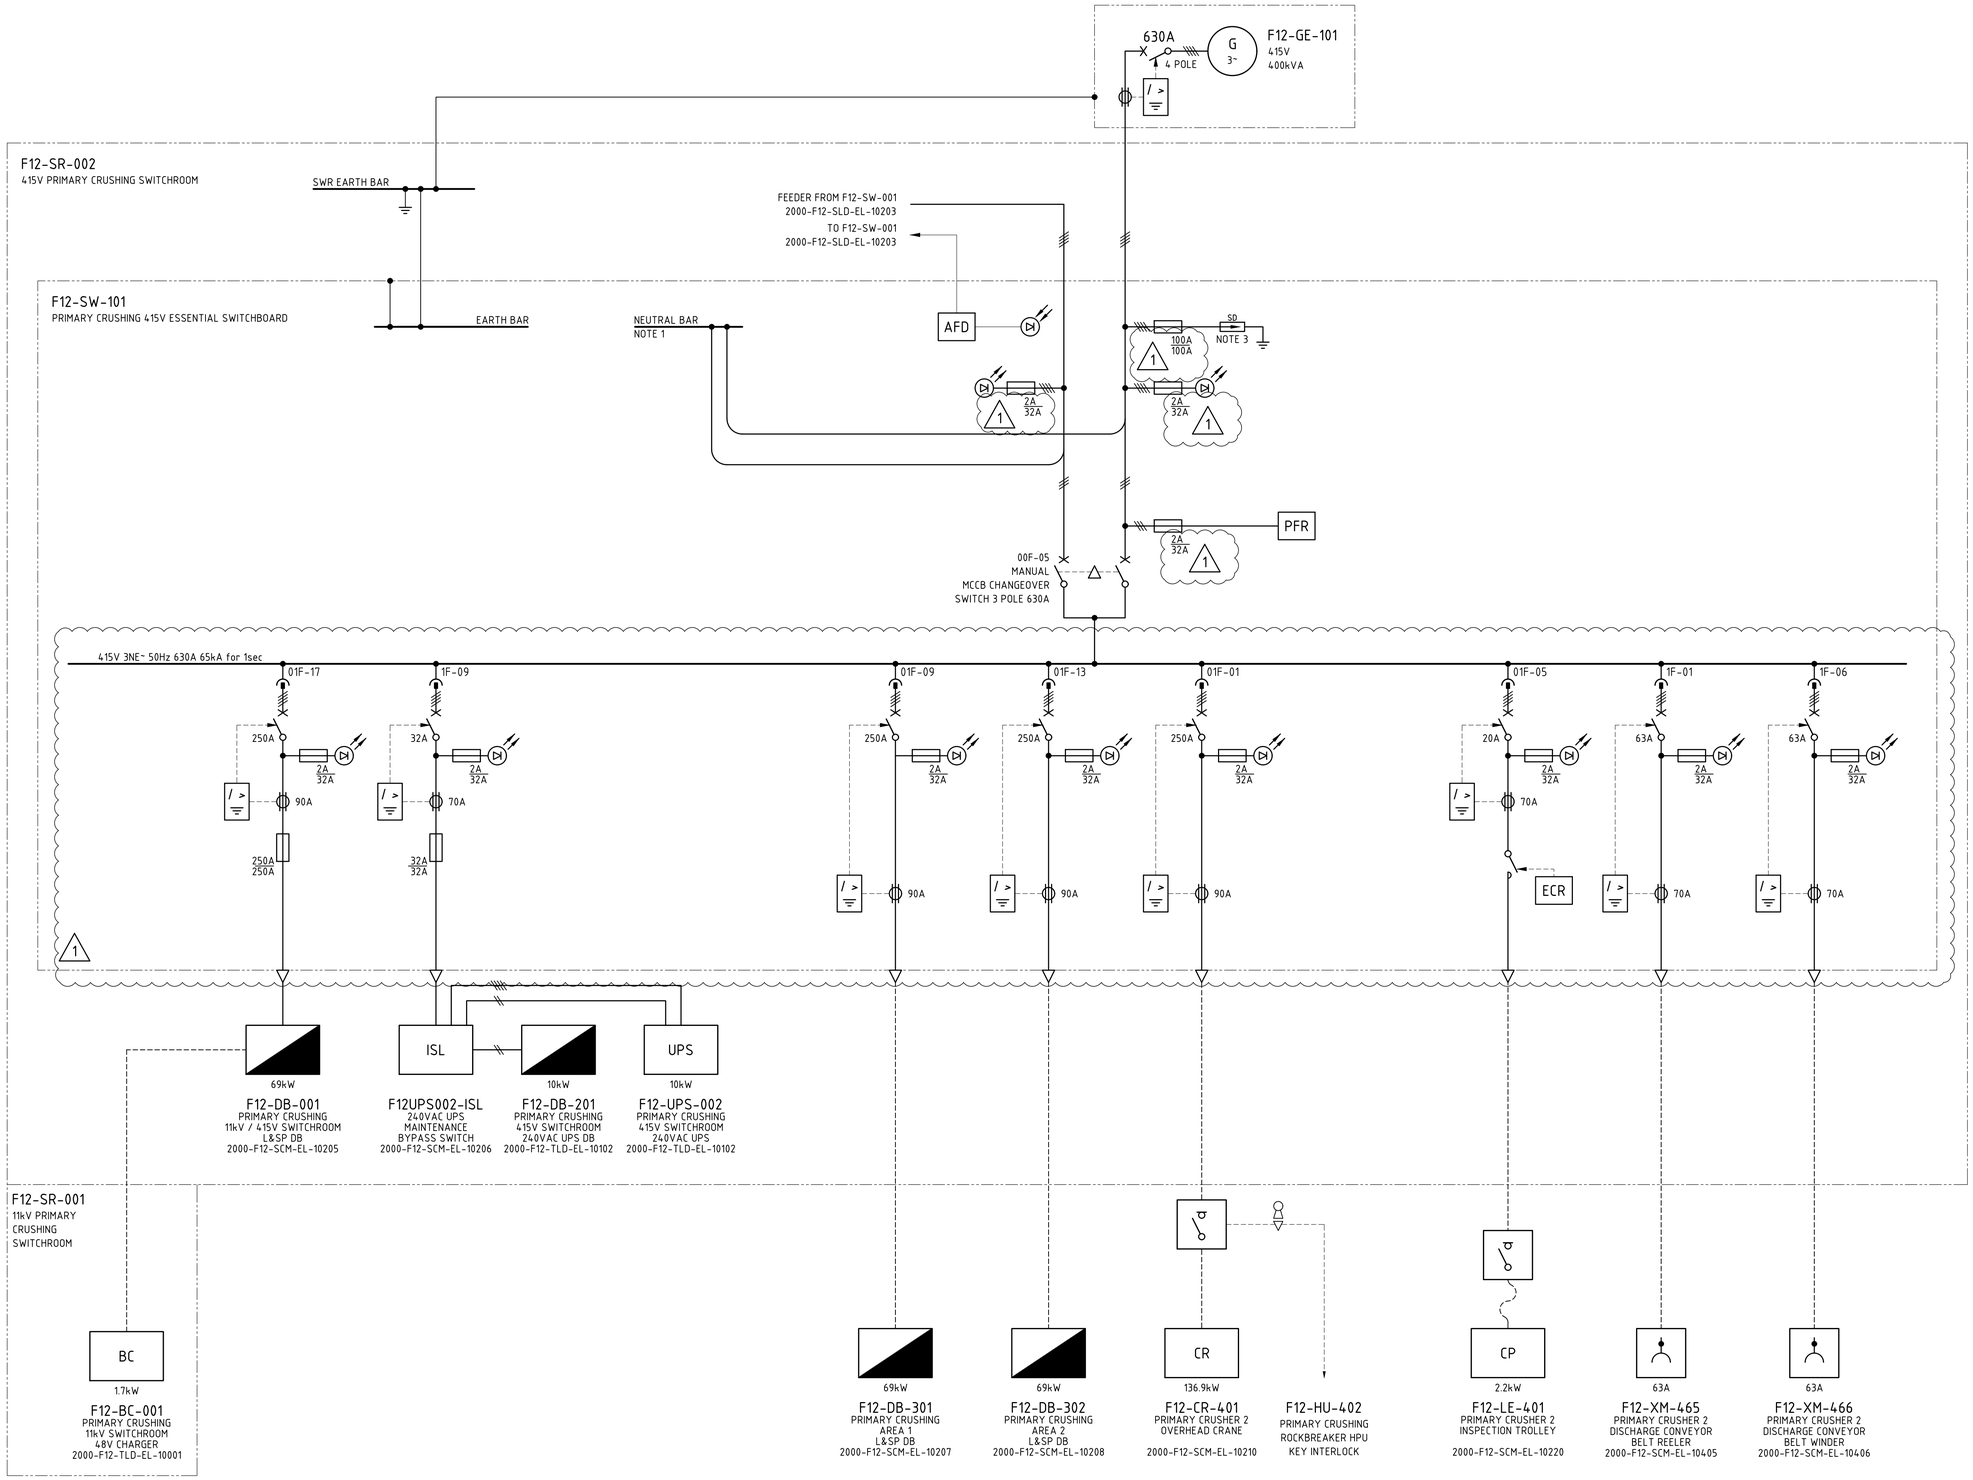


NOTES

1. EARTH-NEUTRAL LINK INSTALLED IN UPSTREAM F12-SW-001 INCOMER TIER. SIGNAGE SHALL BE PLACED ON F12-SW-101 SWITCHBOARD AND ON GENERATOR READING "M.E.N. LINK LOCATED IN F12-SW-001 INCOMER TIER"
2. SWITCHBOARD SHALL BE EXTENSIBLE AND BE PROVIDED WITH THE FACILITY TO EXTEND THE MAIN BUSBAR AND APPEND ADDITIONAL TIERS AT ONE END WITHOUT MAJOR STRUCTURAL DISASSEMBLY.
3. SURGE DIVERTERS SHALL PROVIDE FEEDBACK TO DCS VIA VOLT-FREE CONTACTS. SURGE DIVERTER FUSES SHALL BE SIZED BY VENDOR TO SUIT DUTY.
4. MINIATURE CIRCUIT BREAKERS SHALL BE SIZED AND RATED TO SUIT ACB AND INCOMER REQUIREMENTS.
5. CIRCUIT BREAKER TO BE SUBSTITUTED FOR FUSED-SWITCH WHERE REQUIRED BY EQUIPMENT MANUFACTURERS GUIDELINES.

LEGEND

- PFR — PHASE FAILURE RELAY
- / > — EARTH LEAKAGE RELAY
- xxxA / xxxA — ST TRIP SET POINT / CB SIZE
- AFD — ARC FLASH DETECTION
- ECR — EARTH CONTINUITY RELAY
- 63A 3 PHASE SOCKET OUTLET
- KEY-OPERATED INTERLOCK

NORTHERN STAR RESOURCES LTD

Approved	X
Approved as Noted	
Not Approved	
For Information Only	

Signed [redacted] Date 04/09/2025

ACCEPTANCE DOES NOT RELIEVE THE SUPPLIER / CONTRACTOR OF ITS RESPONSIBILITY OR LIABILITIES UNDER THE PURCHASE ORDER / CONTRACT

2000-F12-SLD-EL-10211_Rev1

F12-SW-101 415V essential switchboard - single line diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\EL\F12 - PRIMARY CRUSHING\2000-F12-SLD-EL-10211.DWG 13AUG25 11:52AM HOTSEAT04