

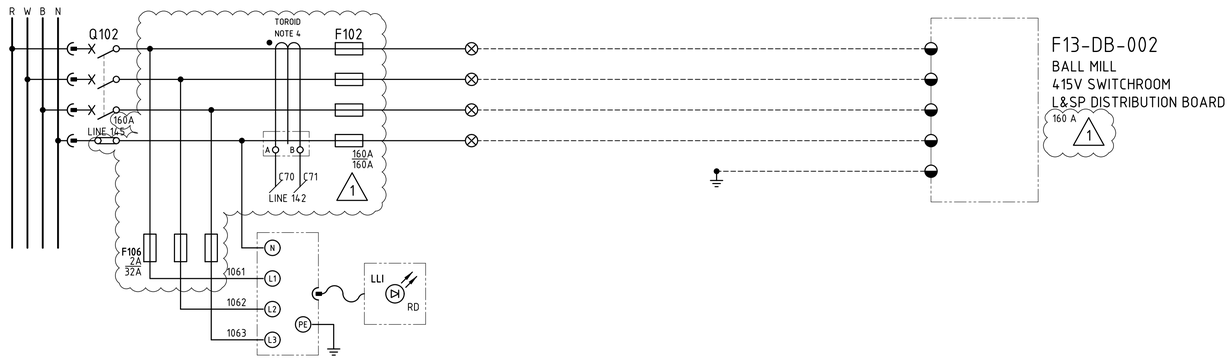


F13-DB-002
BALL MILL
415V SWITCHROOM
L&SP DISTRIBUTION BOARD
160 A 1



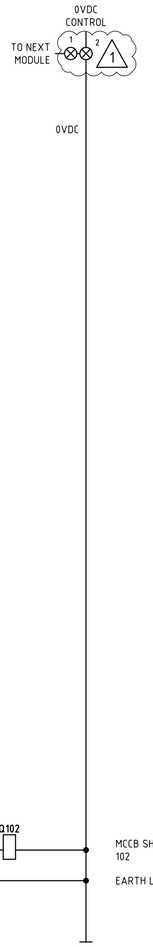


CABLE ZONE
24VDC TERMINALS 1

24VDC LOOPED POWER
NEXT MODULE
PREV MODULE

Q120	4A	F13SW103-2530
1		F13SW103-2540
2		F13SW103-2540
3		
4		
5		
6		
7		
8	⏚	EARTH

NOTE 2

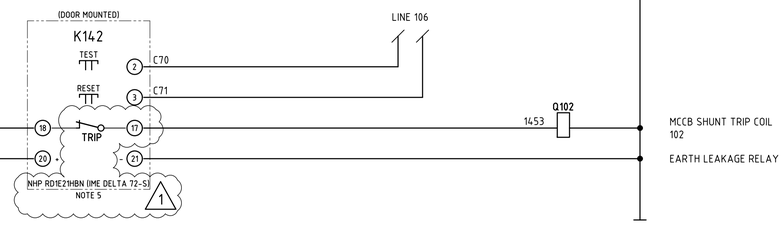

NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F13DB002-1200, UNLESS OTHERWISE NOTED. 1
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGH2
   IN:90A IΔN MIN:0.03A TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR. RELAY ENERGISED (NORMALLY CLOSED CONTACT OPEN) IN NORMAL OPERATION. 1

LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- ⊗ — MCC TERMINAL
- ◓ — VSD TERMINAL
- ◒ — FIELD TERMINAL
- ◑ — DCS OR I/O TERMINAL
- ◧ — MARSHALLING TERMINAL
- ⊗ x — DEVICE TERMINAL
- ⊗ cc — INDICATION LAMP, cc = COLOUR

1

TERMINATION LEGEND

Q120	4A	F13SW103-2xxx
1		F13SW103-2xxx
2		F13SW103-2xxx
3		F13DB002-1200
4		F13DB002-1230
5		F13DB002-1230
6	⏚	EARTH

RD
BK
GNYE

CORE COLOUR/ IDENTIFIER
BARRIER
FERRULE
JUMPER/DISCONNECT/ FUSE/EARTH
TERMINAL No.
DESTINATION

2000-F13-SCM-EL-10905_Rev1

F13-SW-003 - F13-DB-002 ball mill 415V switchroom
L&SP DB - schematic and termination diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\ELV\F13 - MILLING & CLASSIFICATION\2000-F13-SCM-EL-10905.DWG 25SEP25 12:51PM HOTSEAT04