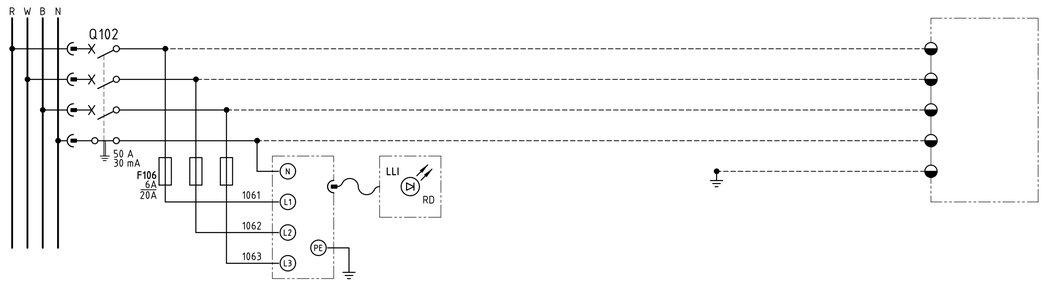





CABLE ZONE
24VDC TERMINALS

24VDC LOOPED POWER
NEXT MODULE | PREV MODULE

1	●	F19SW401-24VDC
2	●	F19SW401-24VDC
3	●	F19SW401-0VDC
4	●	F19SW401-0VDC
5		
6		
7		
8		
9		
10	⏚	EARTH

NOTE 2.

NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC"
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. FxxSCxxx-1200
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES

LEGEND

- 00/01/00 — PLC DIGITAL INPUT
- 00/02/00 — PLC DIGITAL OUTPUT
- ⊗ — MCC TERMINAL
- ◓ — VSD TERMINAL
- ◒ — FIELD TERMINAL
- ◑ — PLC OR I/O TERMINAL
- ◧ — MARSHALLING TERMINAL
- ⓧ — DEVICE TERMINAL
- ⊗cc — INDICATION LAMP, cc = COLOUR

PLC LEGEND



TERMINATION LEGEND

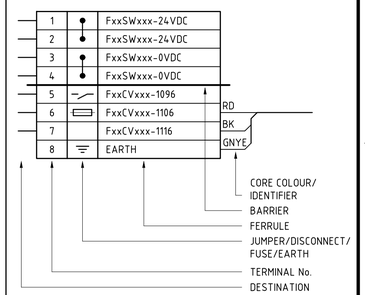

2000-F19-SCM-EL-10001_Rev0

F19-cp-401 ball charger control panel schematic & termination diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23519 KCGM GROWTH PROJECT\03 DELIVERABLES\ELVF19 - FLOTATION REGRIND (BROWNFIELD TIE-INS)\2000-F19-SCM-EL-10001DWG 31AUG23 1:53PM ANTONY.DECAPRIO