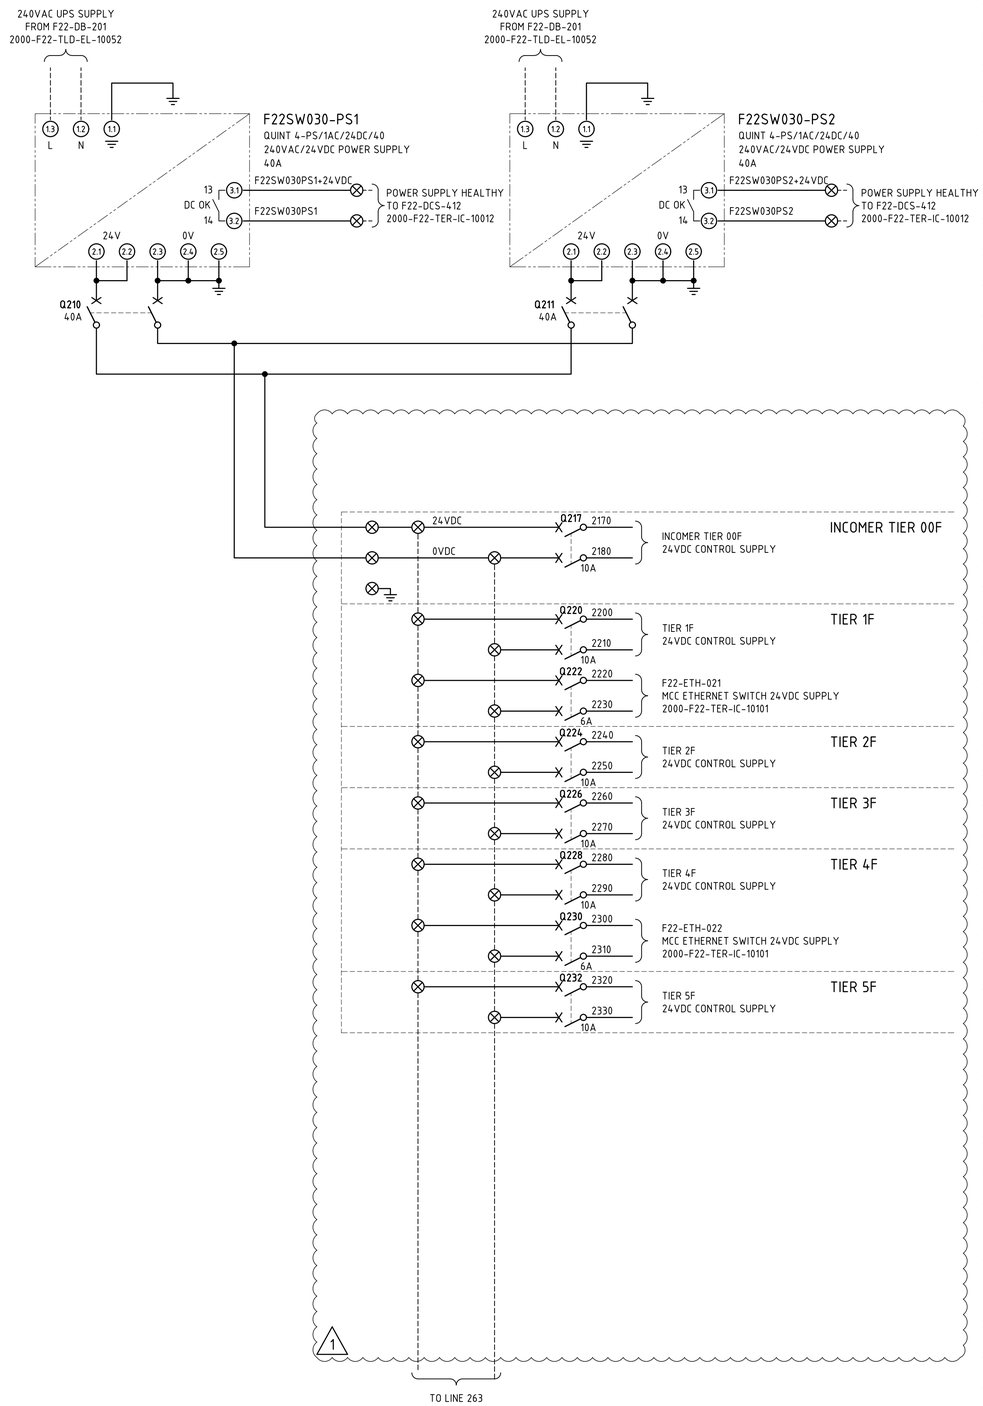
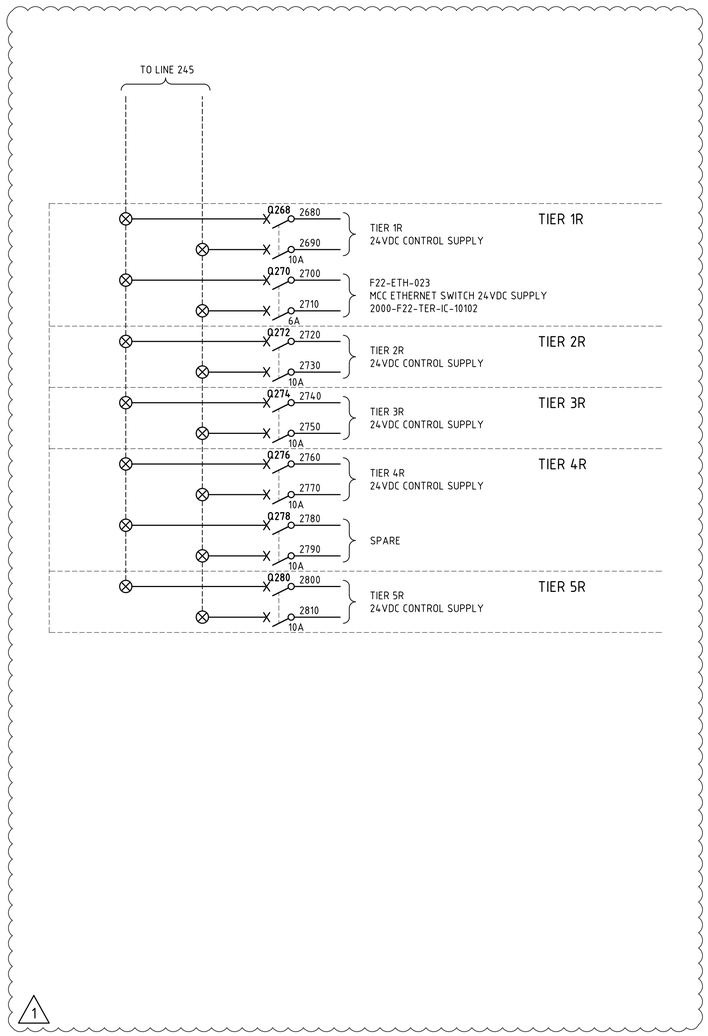



## NOTES


1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F22SW030-1200, UNLESS OTHERWISE NOTED.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.

1

## LEGEND

| | |
|---|---|
| 00/01/00 | DCS DIGITAL INPUT |
| 00/02/00 | DCS DIGITAL OUTPUT |
| ⊗ | MCC TERMINAL |
| ◓ | VSD TERMINAL |
| ◒ | FIELD TERMINAL |
| ◑ | DCS OR I/O TERMINAL |
| ◧ | MARSHALLING TERMINAL |
| (x) | DEVICE TERMINAL |
| ⊗ cc | INDICATION LAMP<br>cc = COLOUR |

## TERMINATION LEGEND

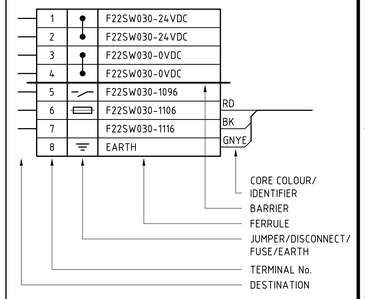


1

# 2000-F22-SCM-EL-10203_Rev1

F22-SW-030 - F22-SW-030 24VDC distribution - schematic diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\235TI KCGM GROWTH PROJECT\03 DELIVERABLES\EL\F22 - CIL4 CARBON TREAMENT & ELUTION\2000-F22-SCM-EL-10203.DWG 18DEC25 12:12PM HOTSEAT04