

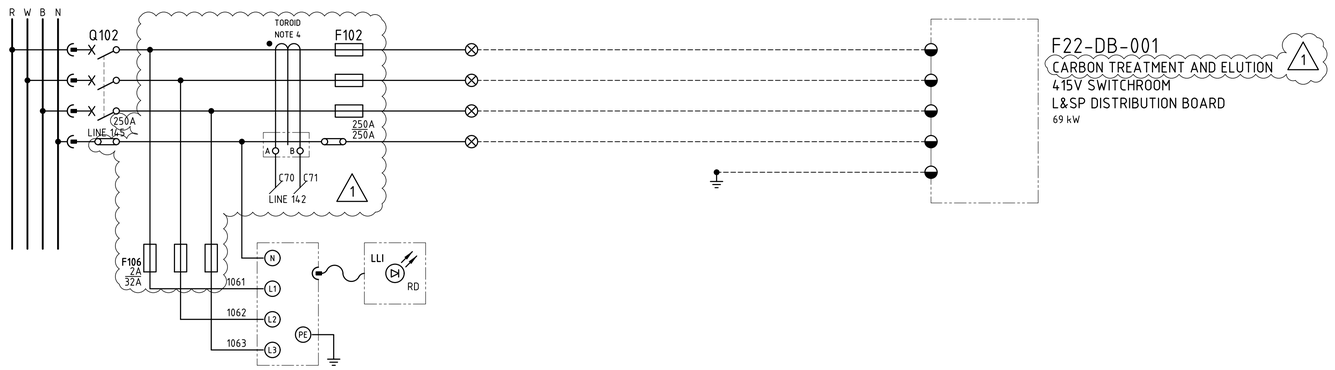


F22-DB-001
CARBON TREATMENT AND ELUTION
415V SWITCHROOM
L&SP DISTRIBUTION BOARD
69 kW



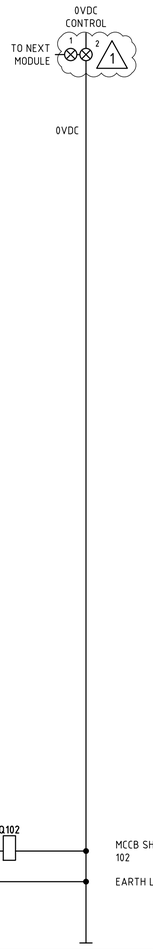


CABLE ZONE
24VDC TERMINALS
1

24VDC
LOOPED POWER
NEXT MODULE
PREV MODULE

Q120	4A	F22SW131-2550
1		F22SW131-2560
2		F22SW131-2560
3		
4		
5		
6		
7		
8	⏚	EARTH

NOTE 2

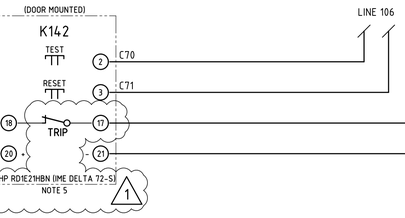

Q102
1453

MCCB SHUNT TRIP COIL
102

EARTH LEAKAGE RELAY

NOTES


1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F22DB001-1200, UNLESS OTHERWISE NOTED. (1)
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGH2
   IN:90A IΔN MIN:0.03A TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR. RELAY ENERGISED (NORMALLY CLOSED CONTACT OPEN) IN NORMAL OPERATION. (1)

LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- ⊗ — MCC TERMINAL
- ◓ — VSD TERMINAL
- ◒ — FIELD TERMINAL
- ◑ — DCS OR I/O TERMINAL
- ◧ — MARSHALLING TERMINAL
- ⊗ x — DEVICE TERMINAL
- ⊗ cc — INDICATION LAMP, cc = COLOUR

1

TERMINATION LEGEND

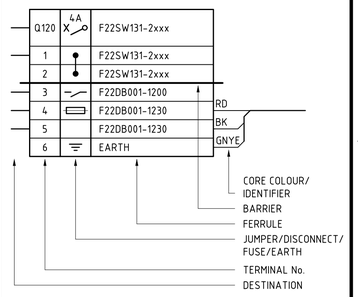

2000-F22-SCM-EL-10255_Rev1

F22-SW-131 - F22-DB-001 carbon regen & elution
415V swrm L&SP DB - schematic and termination diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\235I7 KCGM GROWTH PROJECT\03 DELIVERABLES\ELF22 - CIL4 CARBON TREAMENT & ELUTION\2000-F22-SCM-EL-10255.DWG 18DEC25 12:13PM HOTSEAT04