

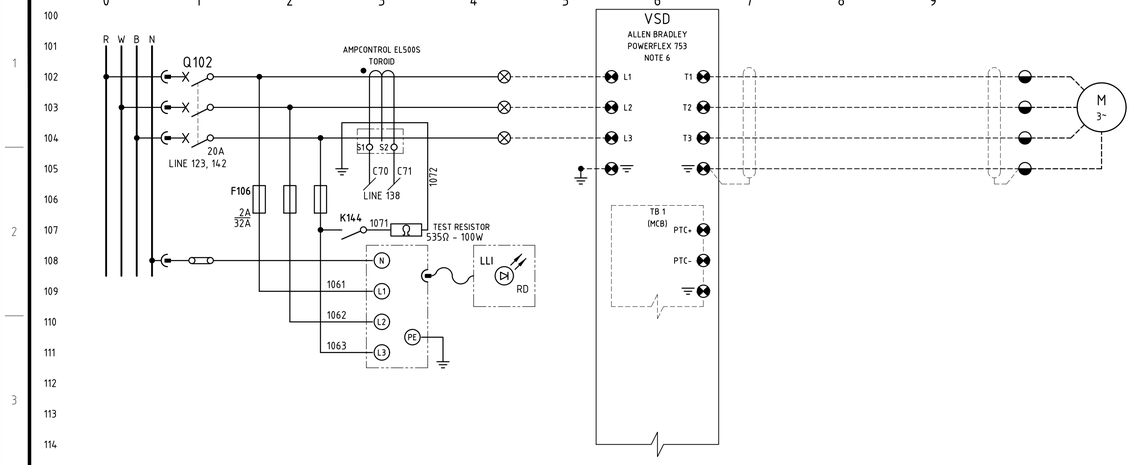


F28-PP-495

UFG MILL 3
PRODUCT SAMPLE
PUMP
5.5 kW

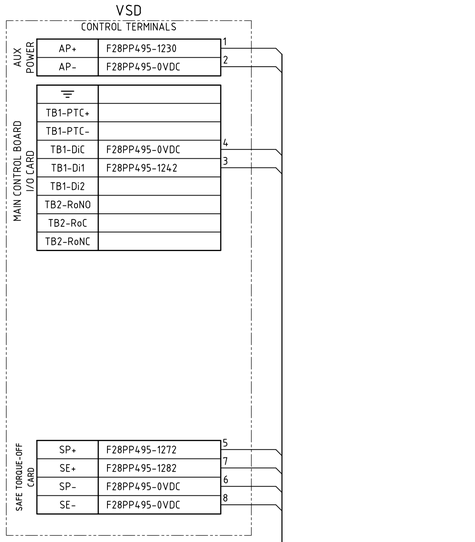

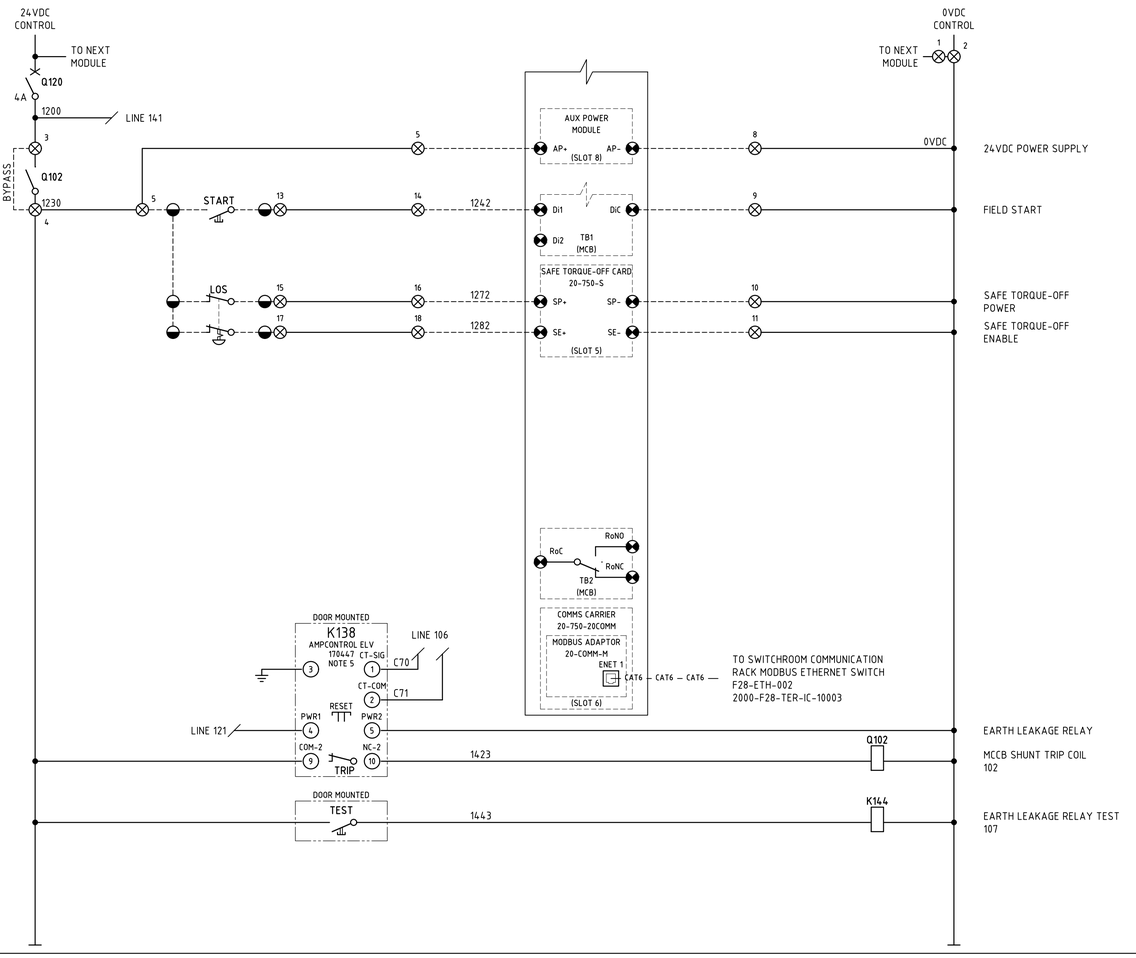

TO SWITCHROOM COMMUNICATION RACK MODBUS ETHERNET SWITCH
F28-ETH-002
2000-F28-TER-IC-10003

24VDC POWER SUPPLY

FIELD START


SAFE TORQUE-OFF POWER


SAFE TORQUE-OFF ENABLE

EARTH LEAKAGE RELAY

MCCB SHUNT TRIP COIL 102

EARTH LEAKAGE RELAY TEST 107

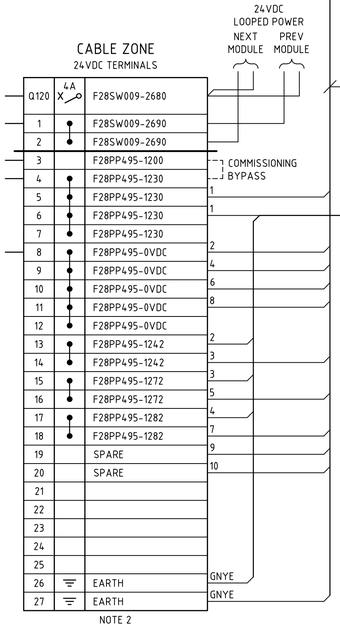




NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F28PP495-1200, UNLESS OTHERWISE NOTED.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. AMPCONTROL 115437
   100/1A TOROID.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR. RELAY ENERGISED (NORMALLY CLOSED CONTACT OPEN) IN NORMAL OPERATION.
6. VSD SHALL BE SIZE FRAME 2 AND ABOVE.

LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- MCC TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- DCS OR I/O TERMINAL
- MARSHALLING TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)

TERMINATION LEGEND

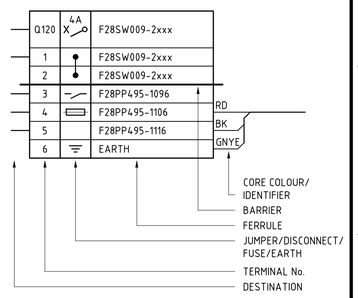

2000-F28-SCM-EL-10245_Rev2

F28-SW-009 - F28-PP-495 UFG mill 3 product sample pump - schematic and termination diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\ELV\F28 - ULTRAFINE GRINDING 2 & 3\2000-F28-SCM-EL-10245.DWG 30SEP26 12:53PM ROBINLAW