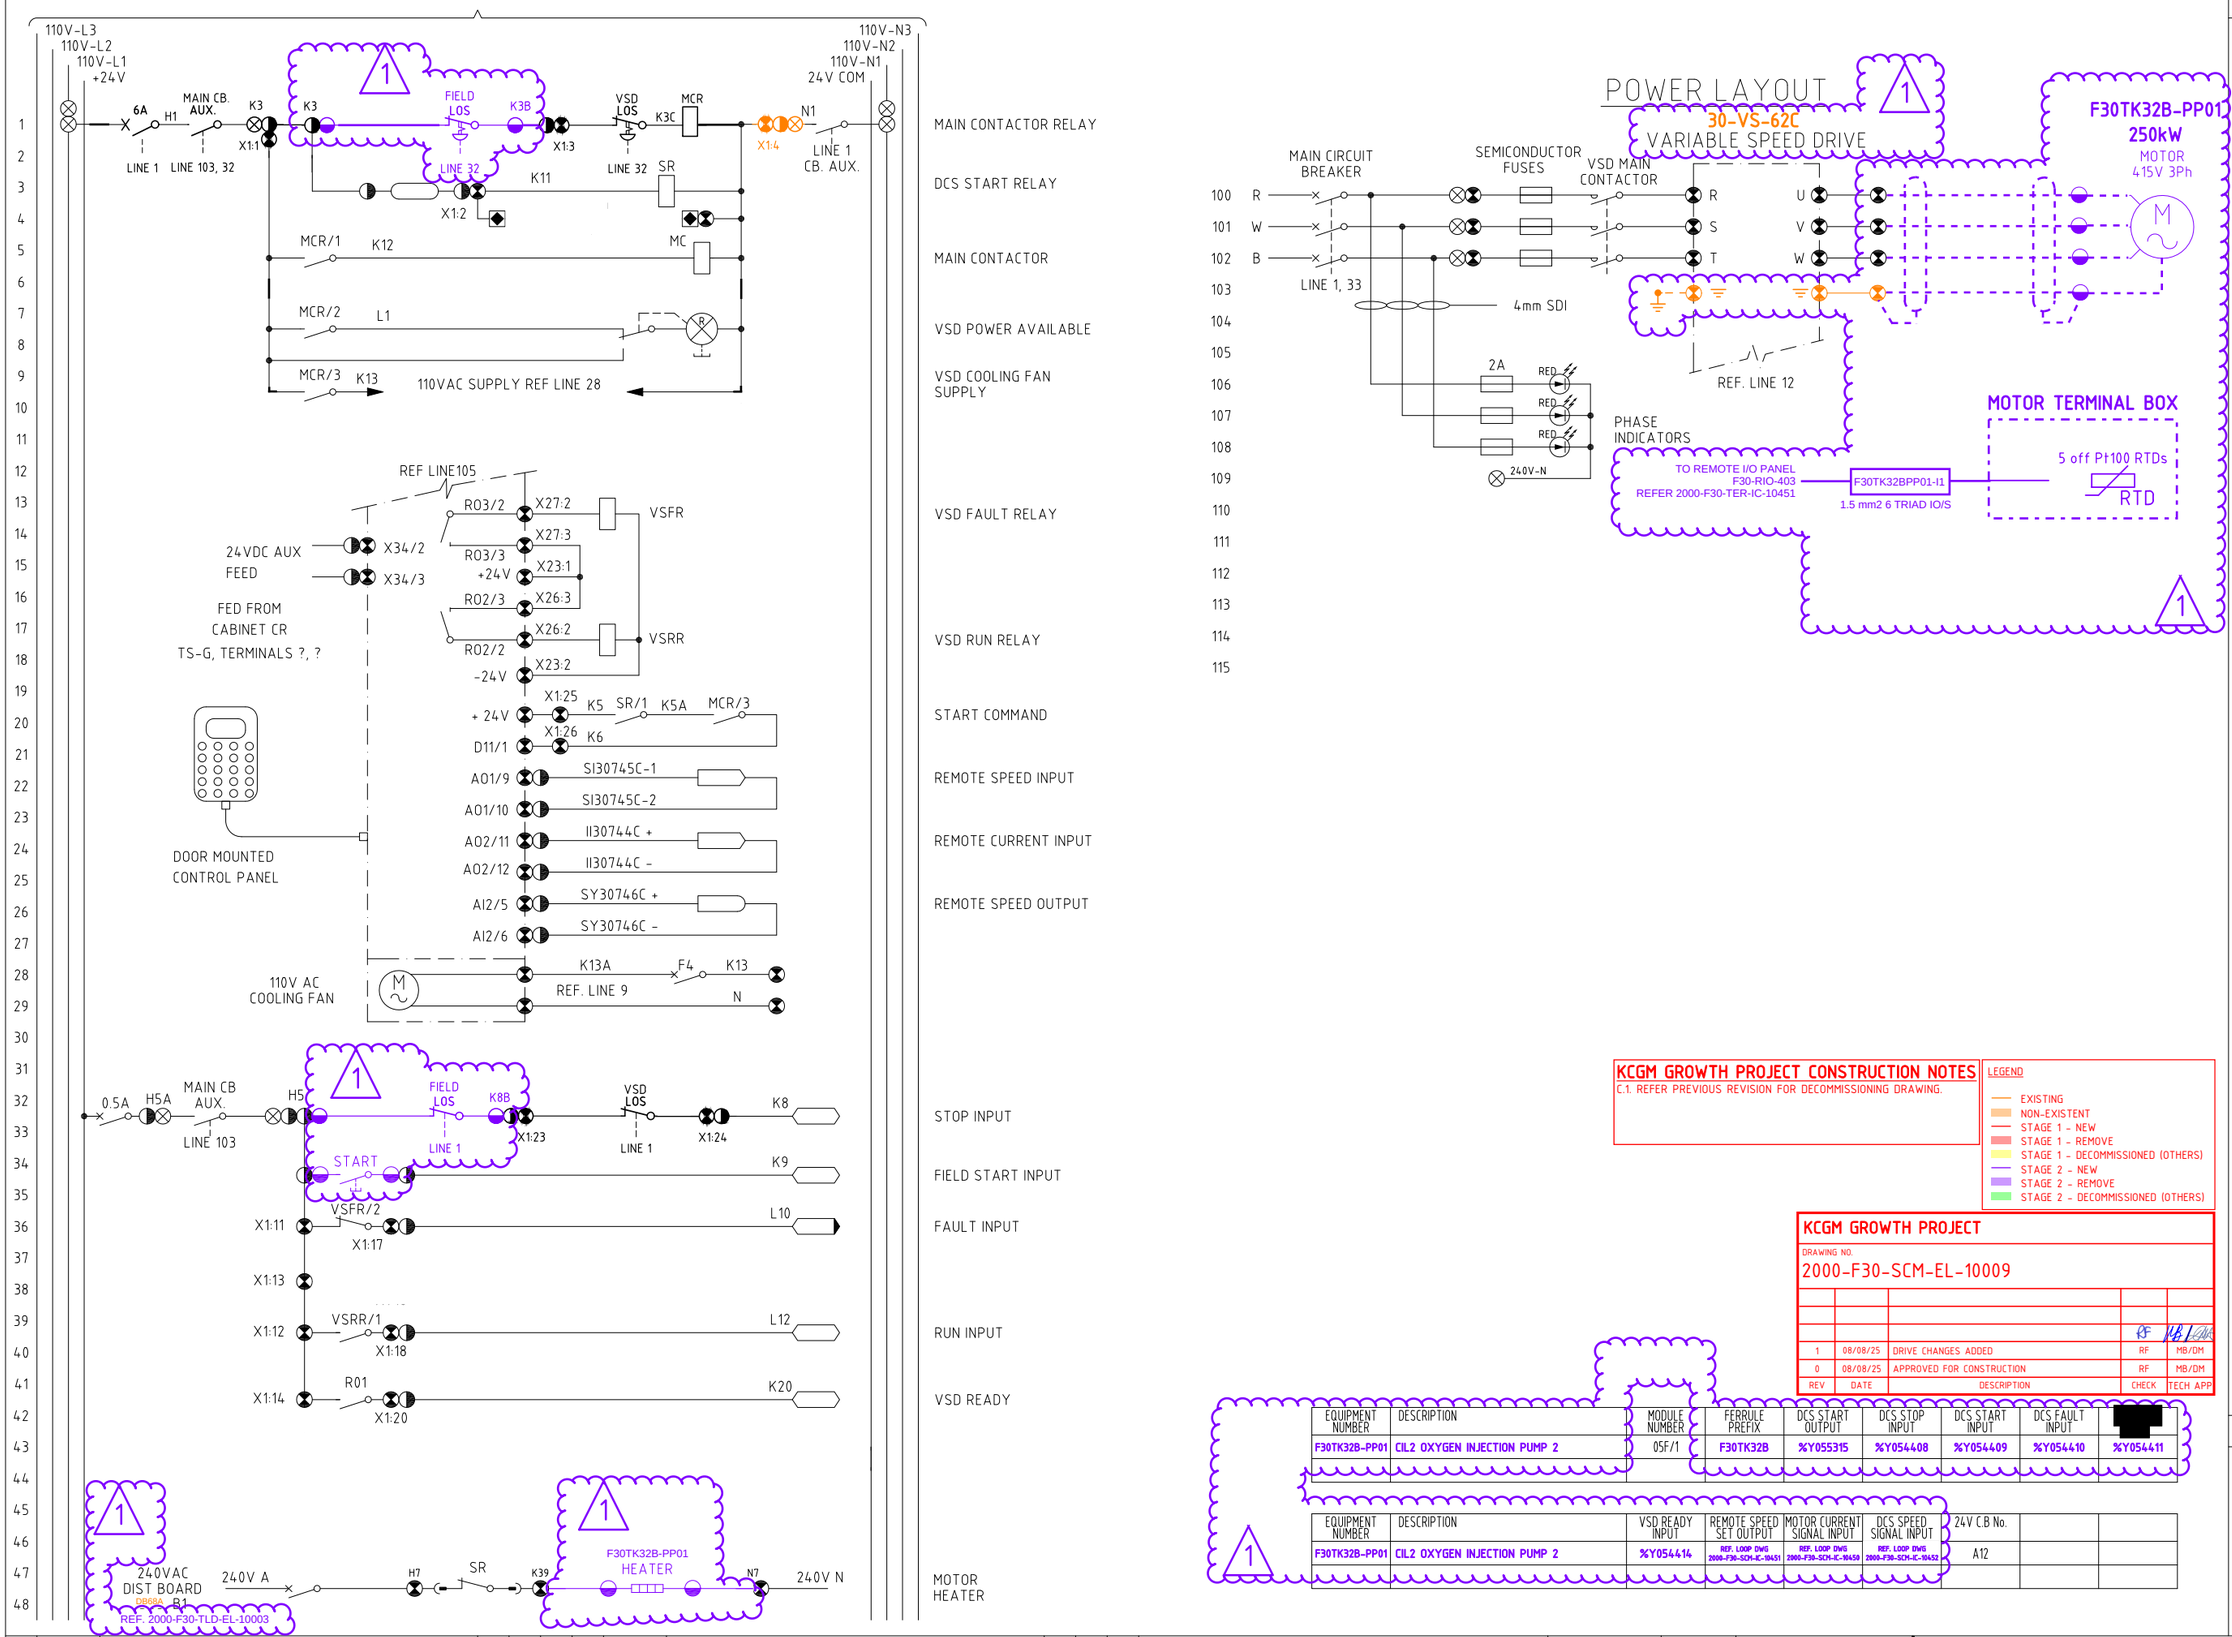


LEGEND

TERMINALS

- MOTOR CONTROL CENTRE (MCC)
- FIELD
- PROCESS CONTROL CUBICLE
- LINE CONDITIONER
- SOFT STARTER TERMINAL
- VARIABLE SPEED DRIVE
- DISTRIBUTION BOARD
- HV MOTOR CONTROL CENTRE
- MISC. ELECTRICAL DEVICE REFER NOTES FOR SPECIFIC DESC.

DIGITAL FUNCTIONS

- DCS INPUT
- DCS INPUT WITH ALARM FUNCTION
- DCS OUTPUT

ANALOGUE FUNCTION

- 4-20mA INPUT
- 4-20mA OUTPUT

ANCILLARY EQUIPMENT

- CIRCUIT BREAKER
- COMBINATION FUSE SWITCH
- ISOLATOR
- PUSH BUTTON
- LOS (LOCK OFF STOP)
- PULL WIRE SWITCH
- NORMALLY CLOSED CONTACT
- LIMIT SWITCH
- CONTACTOR CONTACT
- NORMALLY OPEN CONTACT
- TIMER CONTACT
- FUNCTION CONTACT
  - P - PRESSURE
  - T° - TEMPERATURE
  - F - FLOW
  - L - FLOAT
- SIREN
- HORN
- RELAY
- LINK
- THERMISTOR
- INDICATION LAMP R - RED, G - GREEN, A - AMBER

VOLTAGES ON CONTROL BUS

- +24V - 24V DC DCS SUPPLY BUS
- 110V-L1 - 110V AC MCC CONTROL BUS
- 110V-L2 - 110V AC CONDITIONED BUS
- 110V-L3 - 110V AC NON CONDITIONED BUS
- 110V-L1E - 110V [redacted] EMERGENCY CONROL BUS
- 240V-L4 - 240V AC CONTROL BUS

NOTES

1. ALL WIRES EXCEPT CONTROL SUPPLIES & THOSE WITHIN FORM 4 MODULES SHALL BE FERRULED WITH PREFIX LISTED IN ABOVE TABLE.

KCGM GROWTH PROJECT CONSTRUCTION NOTES

C.1. REFER PREVIOUS REVISION FOR DECOMMISSIONING DRAWING.

LEGEND

- EXISTING
- NON-EXISTENT
- STAGE 1 - NEW
- STAGE 1 - REMOVE
- STAGE 1 - DECOMMISSIONED (OTHERS)
- STAGE 2 - NEW
- STAGE 2 - REMOVE
- STAGE 2 - DECOMMISSIONED (OTHERS)

KCGM GROWTH PROJECT

DRAWING NO. 2000-F30-SCM-EL-10009

REV	DATE	DESCRIPTION	CHECK	TECH APP
1	08/08/25	DRIVE CHANGES ADDED	RF	MB/DM
0	08/08/25	APPROVED FOR CONSTRUCTION	RF	MB/DM

EQUIPMENT NUMBER	DESCRIPTION	MODULE NUMBER	FERRULE PREFIX	DCS START OUTPUT	DCS STOP INPUT	DCS START INPUT	DCS FAULT INPUT	[redacted]
F30TK32B-PP01	CIL2 OXYGEN INJECTION PUMP 2	05F/1	F30TK32B	%Y055315	%Y054408	%Y054409	%Y054410	%Y054411

EQUIPMENT NUMBER	DESCRIPTION	VSD READY INPUT	REMOTE SPEED SET OUTPUT	MOTOR CURRENT SIGNAL INPUT	DCS SPEED SIGNAL INPUT	24V C.B No.		
F30TK32B-PP01	CIL2 OXYGEN INJECTION PUMP 2	%Y054414	REF. LOOP DWG 2000-F30-SCM-IC-10451	REF. LOOP DWG 2000-F30-SCM-IC-10450	REF. LOOP DWG 2000-F30-SCM-IC-10452	A12		

2000-F30-SCM-EL-10009_Rev1

Substation no. 68 MCC 30-SW-62 f30tk32b-pp01 CIL2 oxygen injection pump 2 schematic and termination diagram