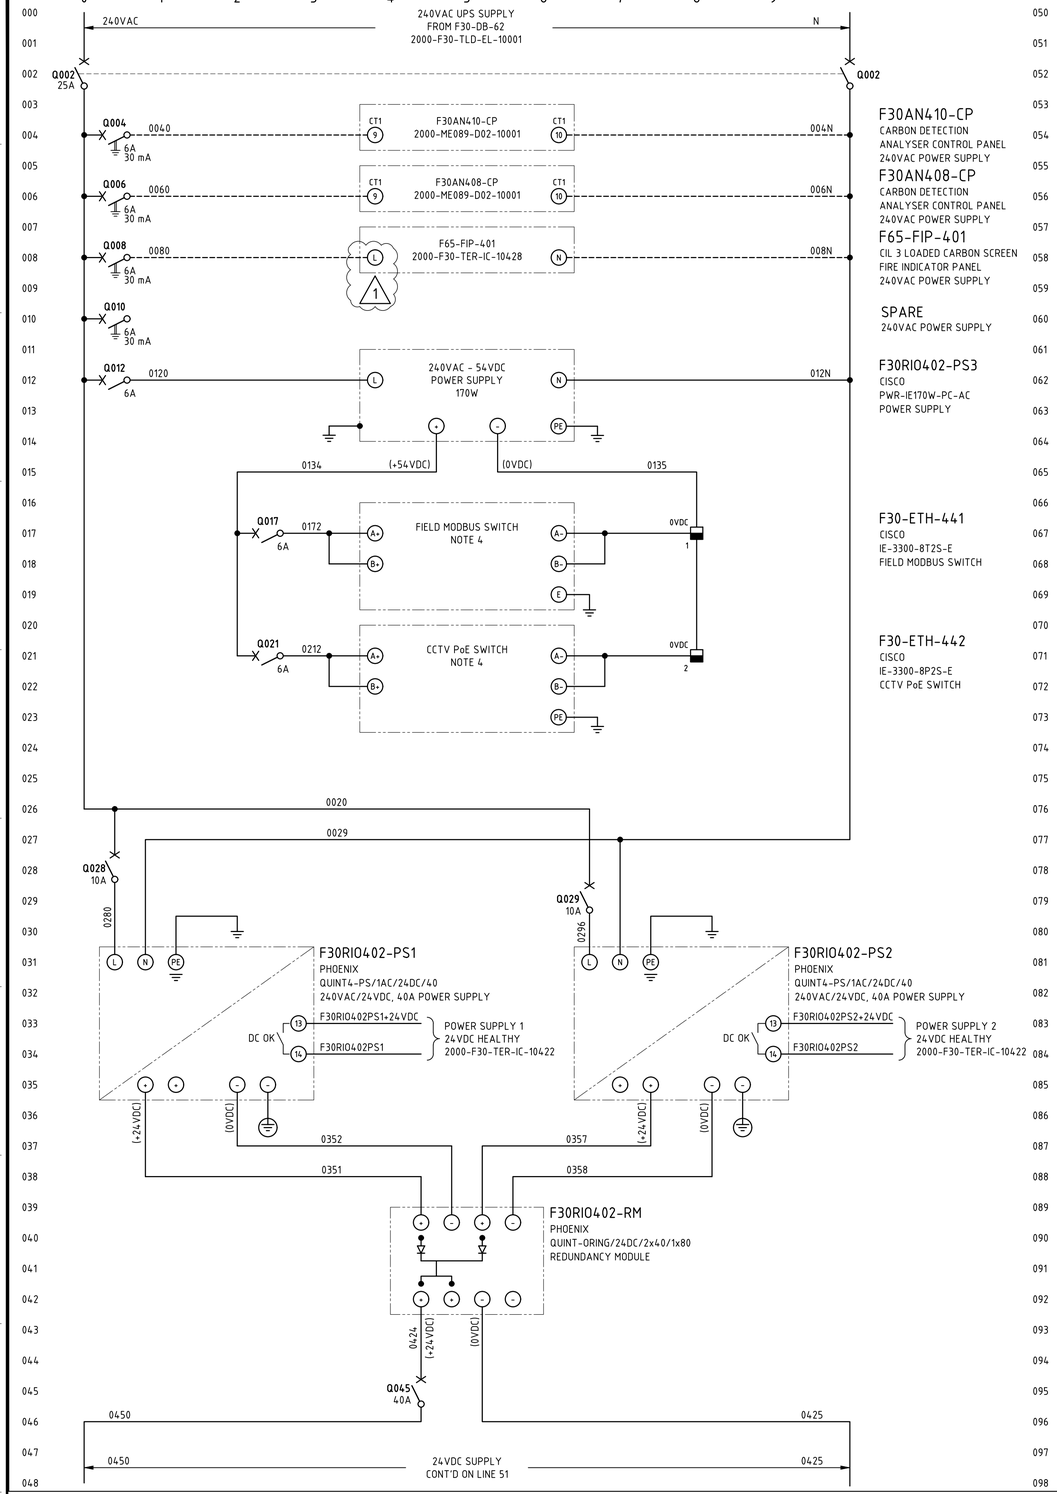


F30AN410-CP
CARBON DETECTION
ANALYSER CONTROL PANEL
240VAC POWER SUPPLY

F30AN408-CP
CARBON DETECTION
ANALYSER CONTROL PANEL
240VAC POWER SUPPLY


F65-FIP-401
CIL 3 LOADED CARBON SCREEN
FIRE INDICATOR PANEL
240VAC POWER SUPPLY

SPARE
240VAC POWER SUPPLY

F30RIO402-PS3
CISCO
PWR-IE170W-PC-AC
POWER SUPPLY

F30-ETH-441
CISCO
IE-3300-8T2S-E
FIELD MODBUS SWITCH

F30-ETH-442
CISCO
IE-3300-8P2S-E
CCTV PoE SWITCH

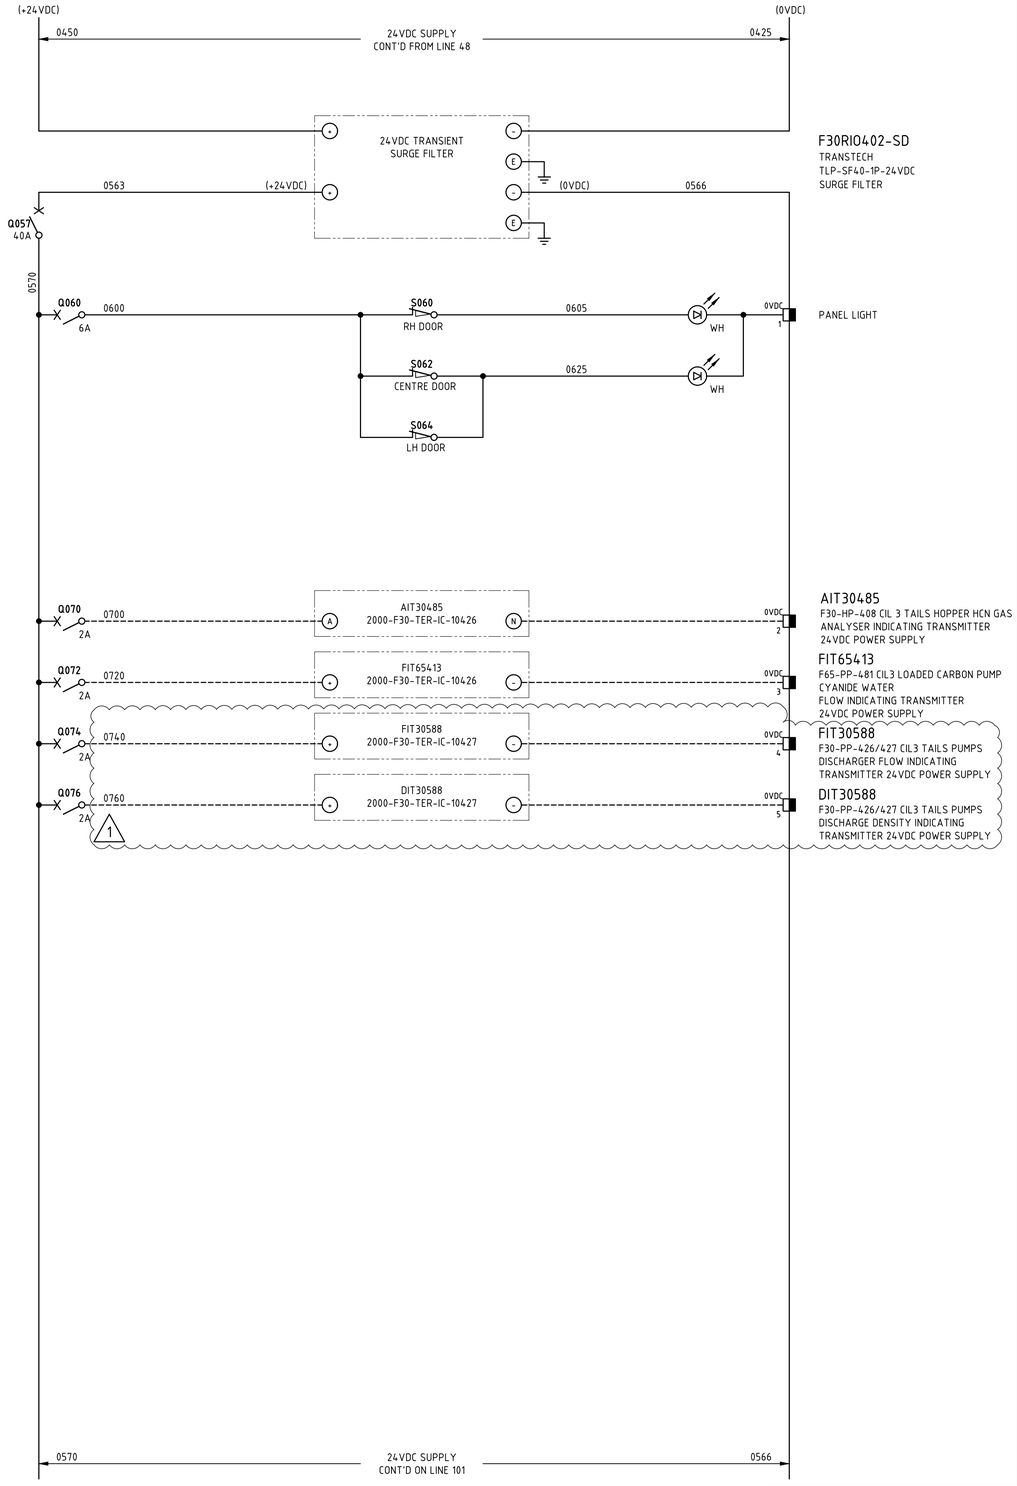

F30RIO402-SD
TRANSTECH
TLP-SF40-1P-24VDC
SURGE FILTER

PANEL LIGHT

AIT30485
F30-HP-408 CIL 3 TAILS HOPPER HCN GAS
ANALYSER INDICATING TRANSMITTER
24VDC POWER SUPPLY

FIT65413
F65-PP-481 CIL3 LOADED CARBON PUMP
CYANIDE WATER
FLOW INDICATING TRANSMITTER
24VDC POWER SUPPLY

FIT30588
F30-PP-426/427 CIL3 TAILS PUMPS
DISCHARGER FLOW INDICATING
TRANSMITTER 24VDC POWER SUPPLY

DIT30588
F30-PP-426/427 CIL3 TAILS PUMPS
DISCHARGE DENSITY INDICATING
TRANSMITTER 24VDC POWER SUPPLY

NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F30RIO402-xxxx.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. FOR NETWORK CONNECTION & BUS CABLING DETAILS REFER TO RIO PANEL COMMUNICATIONS TERMINATION DIAGRAMS.
5. INSTRUMENT EARTH BAR TO BE BONDED TO MAIN EARTH BAR WITH SOLID COPPER LINK.

LEGEND

- FIELD TERMINAL
- DCS OR I/O TERMINAL
- 0VDC TERMINAL FOR 24VDC
- 0VDC TERMINAL FOR 54VDC
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)
- EARTH BAR
- INSTRUMENT EARTH BAR

2000-F30-SCM-IC-10421_Rev1

Carbon in leach (CIL3) F30-RIO-402 concentrate leach & adsorption field n-IO panel schematic diagram sheet 1

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\IC\F30 - CIL2_3 & CONCENTRATE THICKENING\2000-F30-SCM-IC-10421DWG 19NOV25 11:46AM HOTSEAT04