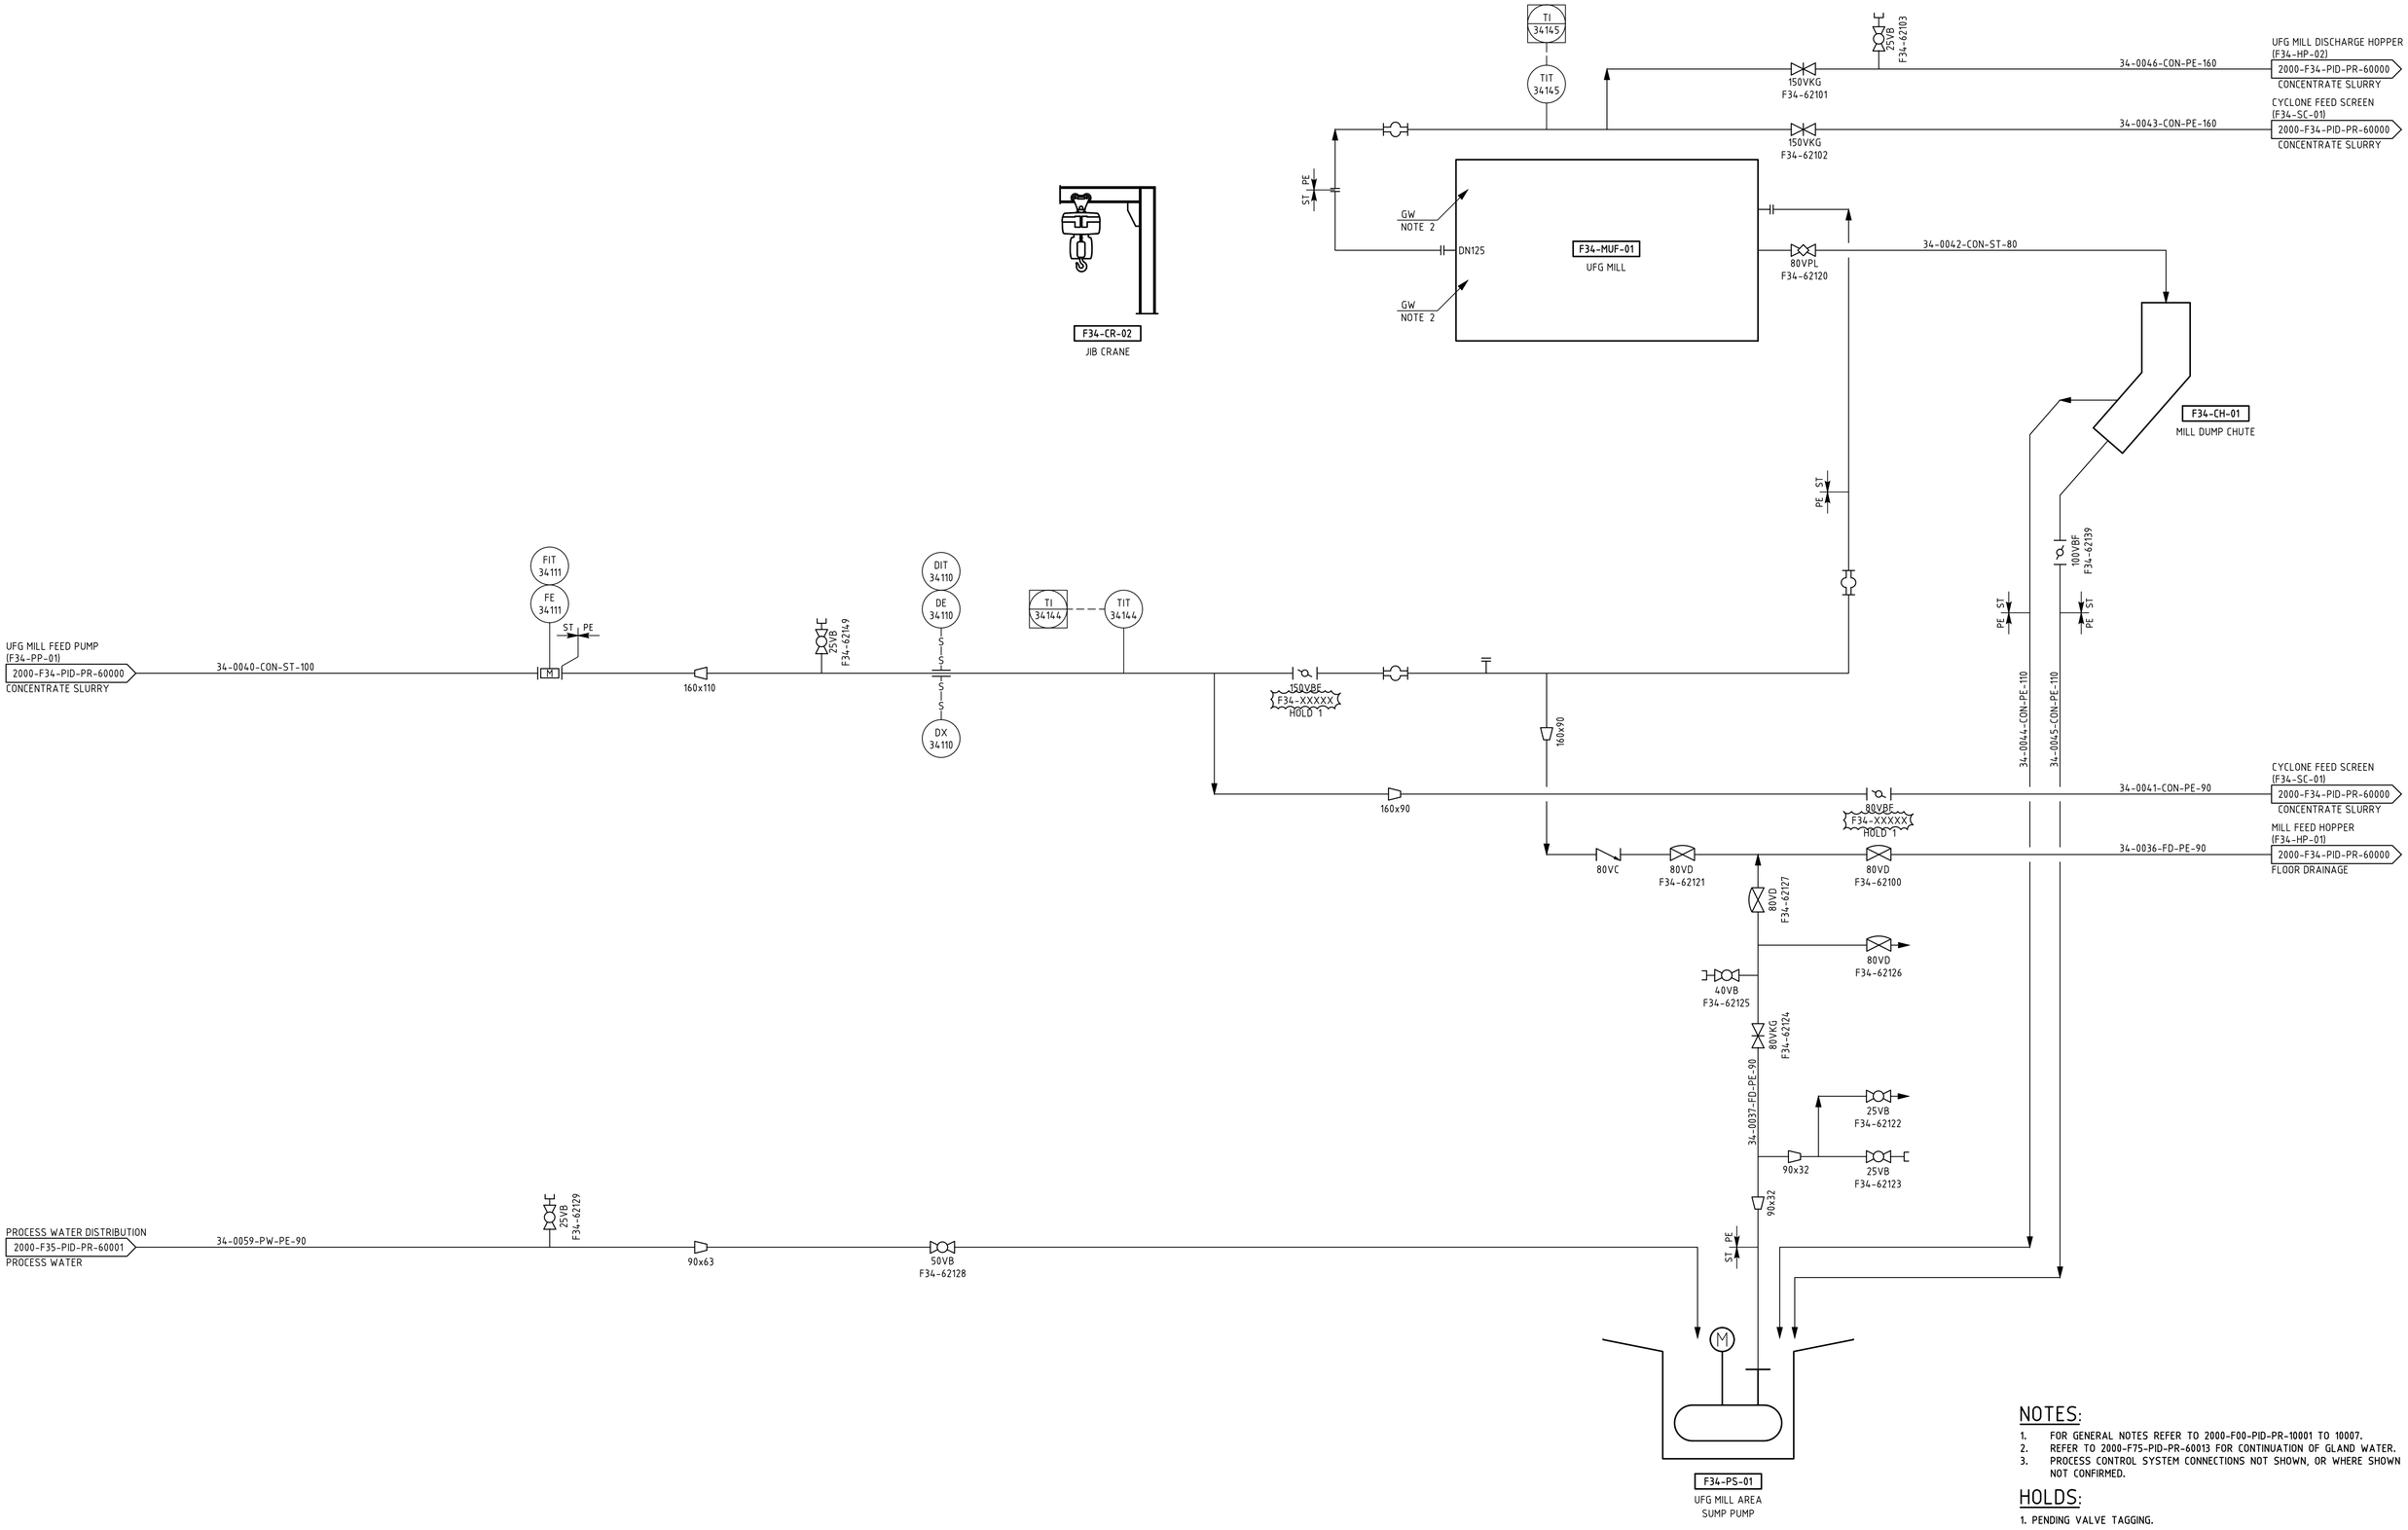


NOTES:

1. FOR GENERAL NOTES REFER TO 2000-F00-PID-PR-10001 TO 10007.
2. REFER TO 2000-F75-PID-PR-60013 FOR CONTINUATION OF GLAND WATER.
3. PROCESS CONTROL SYSTEM CONNECTIONS NOT SHOWN, OR WHERE SHOWN NOT CONFIRMED.

HOLDS:

1. PENDING VALVE TAGGING.

ORIGINAL DRAWING: 34\PI\0002