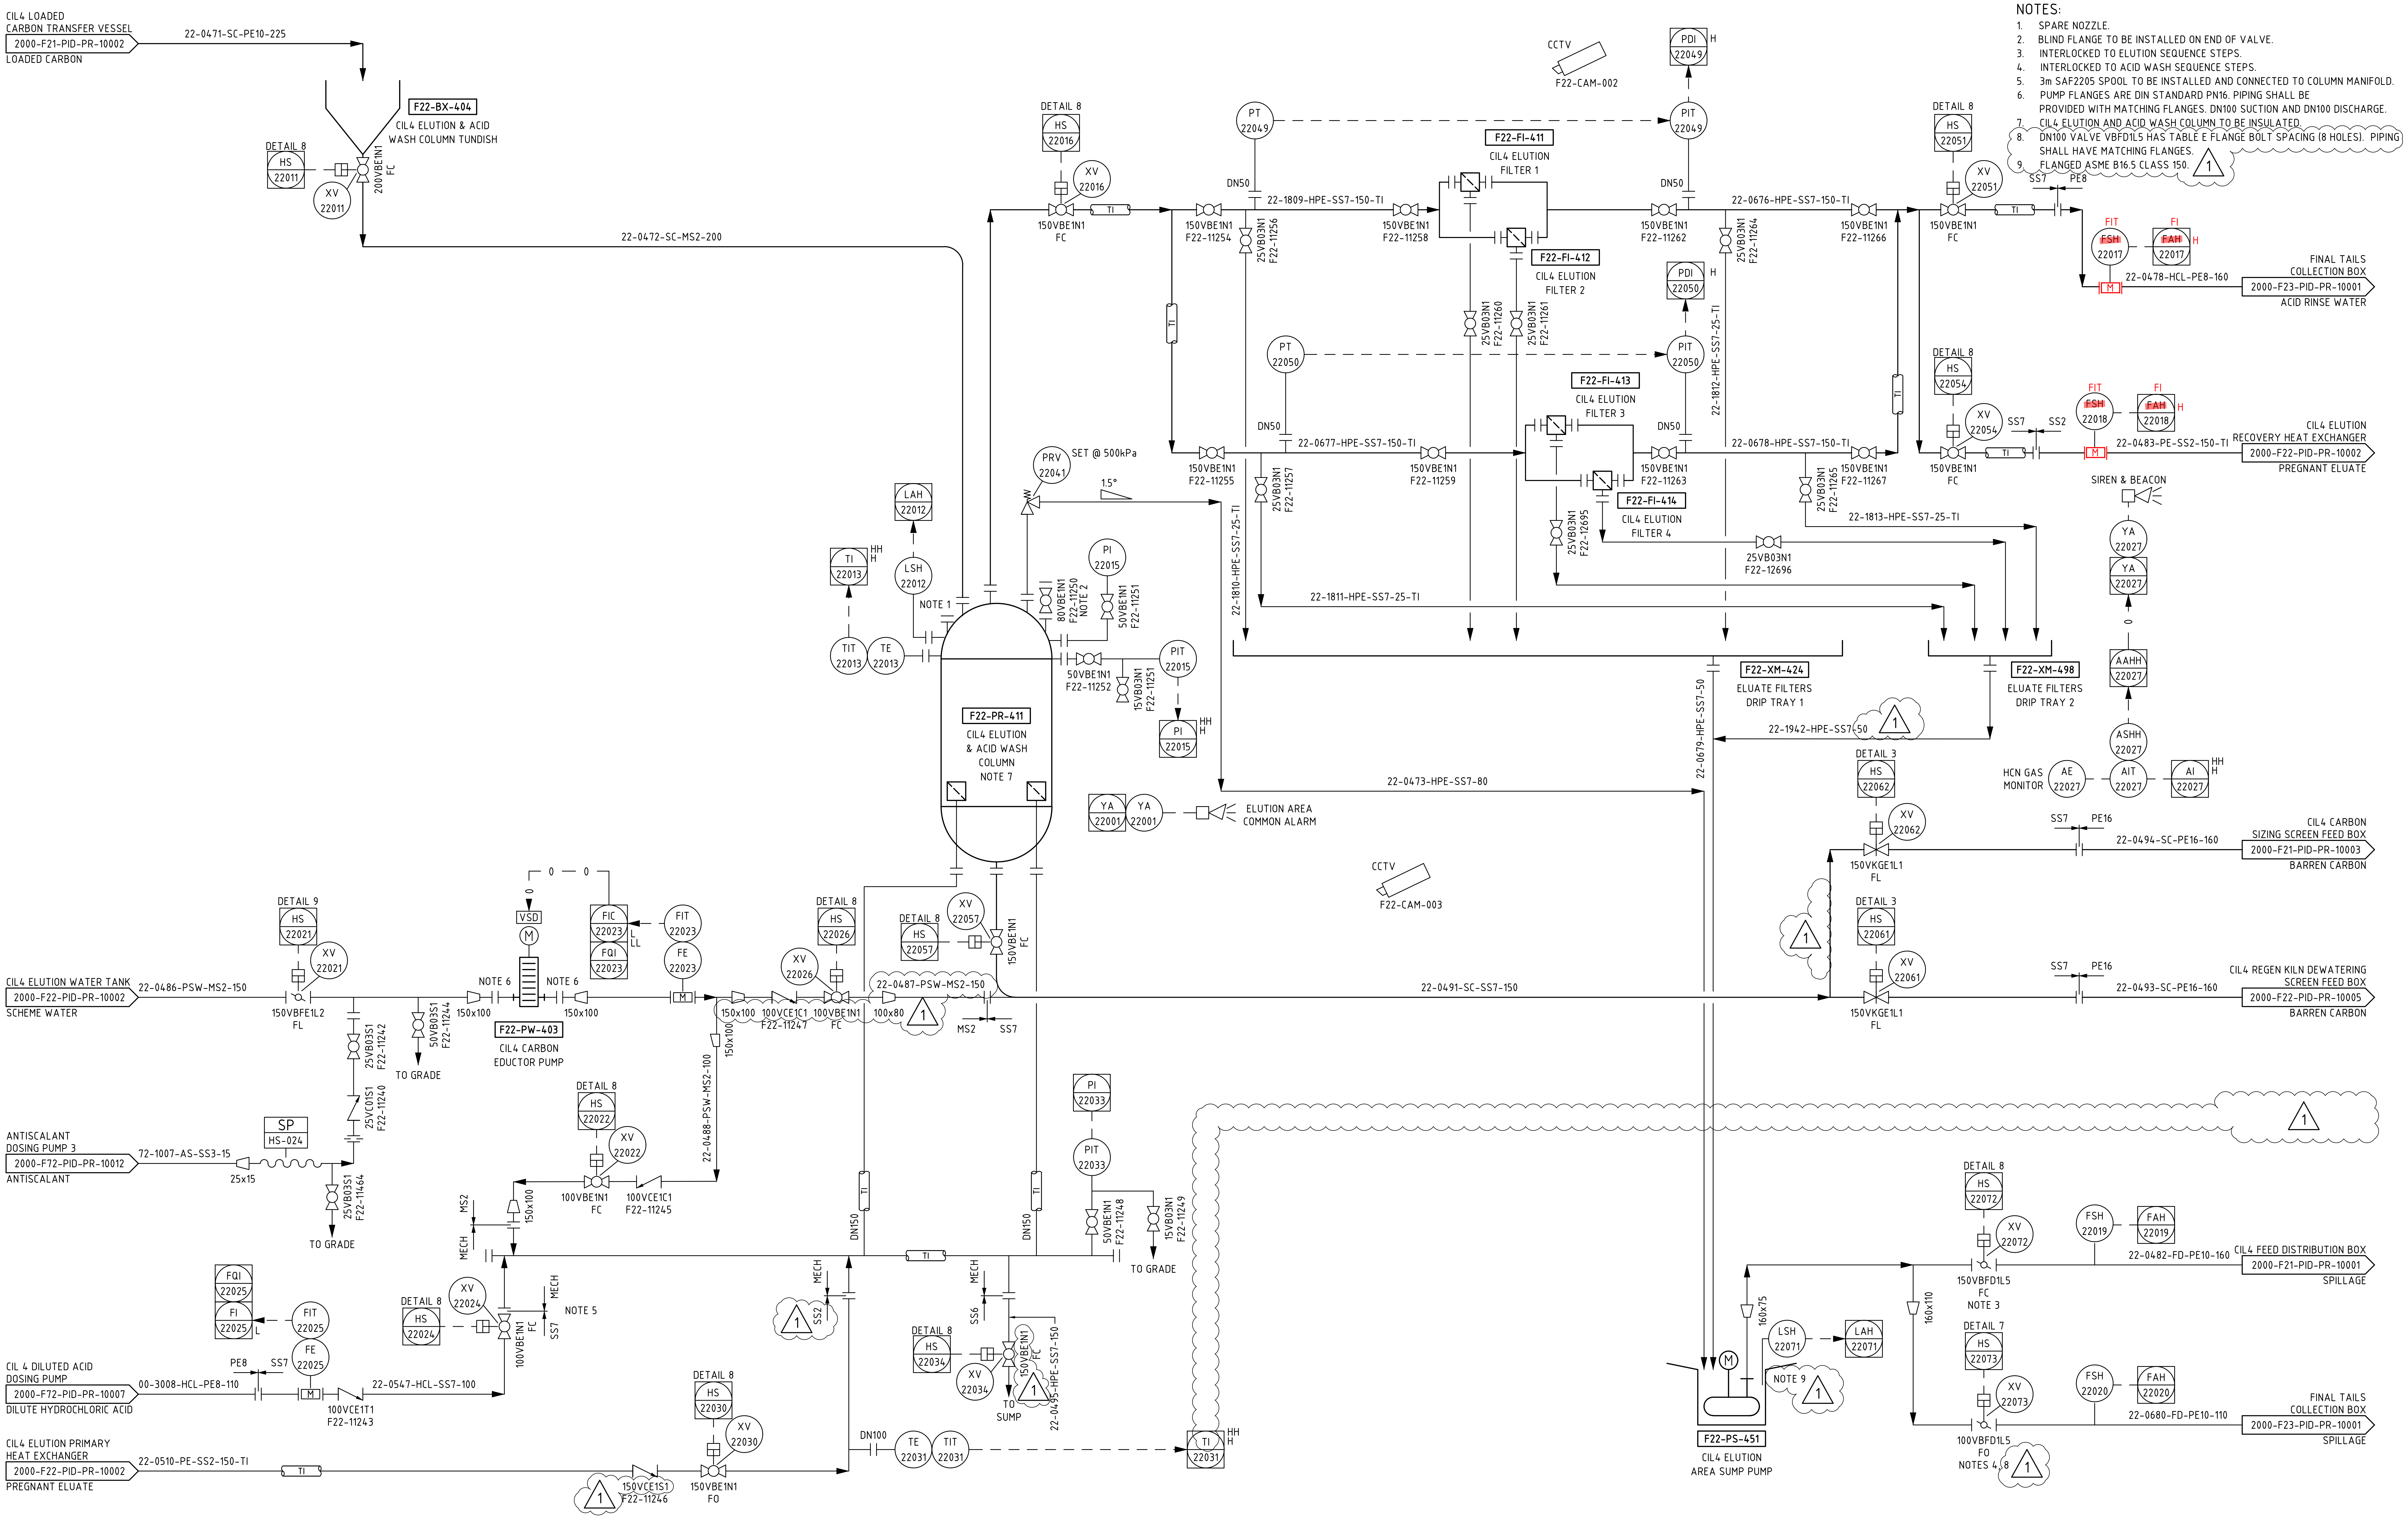

NOTES:

1. SPARE NOZZLE.
2. BLIND FLANGE TO BE INSTALLED ON END OF VALVE.
3. INTERLOCKED TO ELUTION SEQUENCE STEPS.
4. INTERLOCKED TO ACID WASH SEQUENCE STEPS.
5. 3m SAF2205 SPOOL TO BE INSTALLED AND CONNECTED TO COLUMN MANIFOLD.
6. PUMP FLANGES ARE DIN STANDARD PN16. PIPING SHALL BE PROVIDED WITH MATCHING FLANGES. DN100 SUCTION AND DN100 DISCHARGE.
7. CIL4 ELUTION AND ACID WASH COLUMN TO BE INSULATED.
8. DN100 VALVE VBFD1L5 HAS TABLE E FLANGE BOLT SPACING (8 HOLES). PIPING SHALL HAVE MATCHING FLANGES.
9. FLANGED ASME B16.5 CLASS 150.