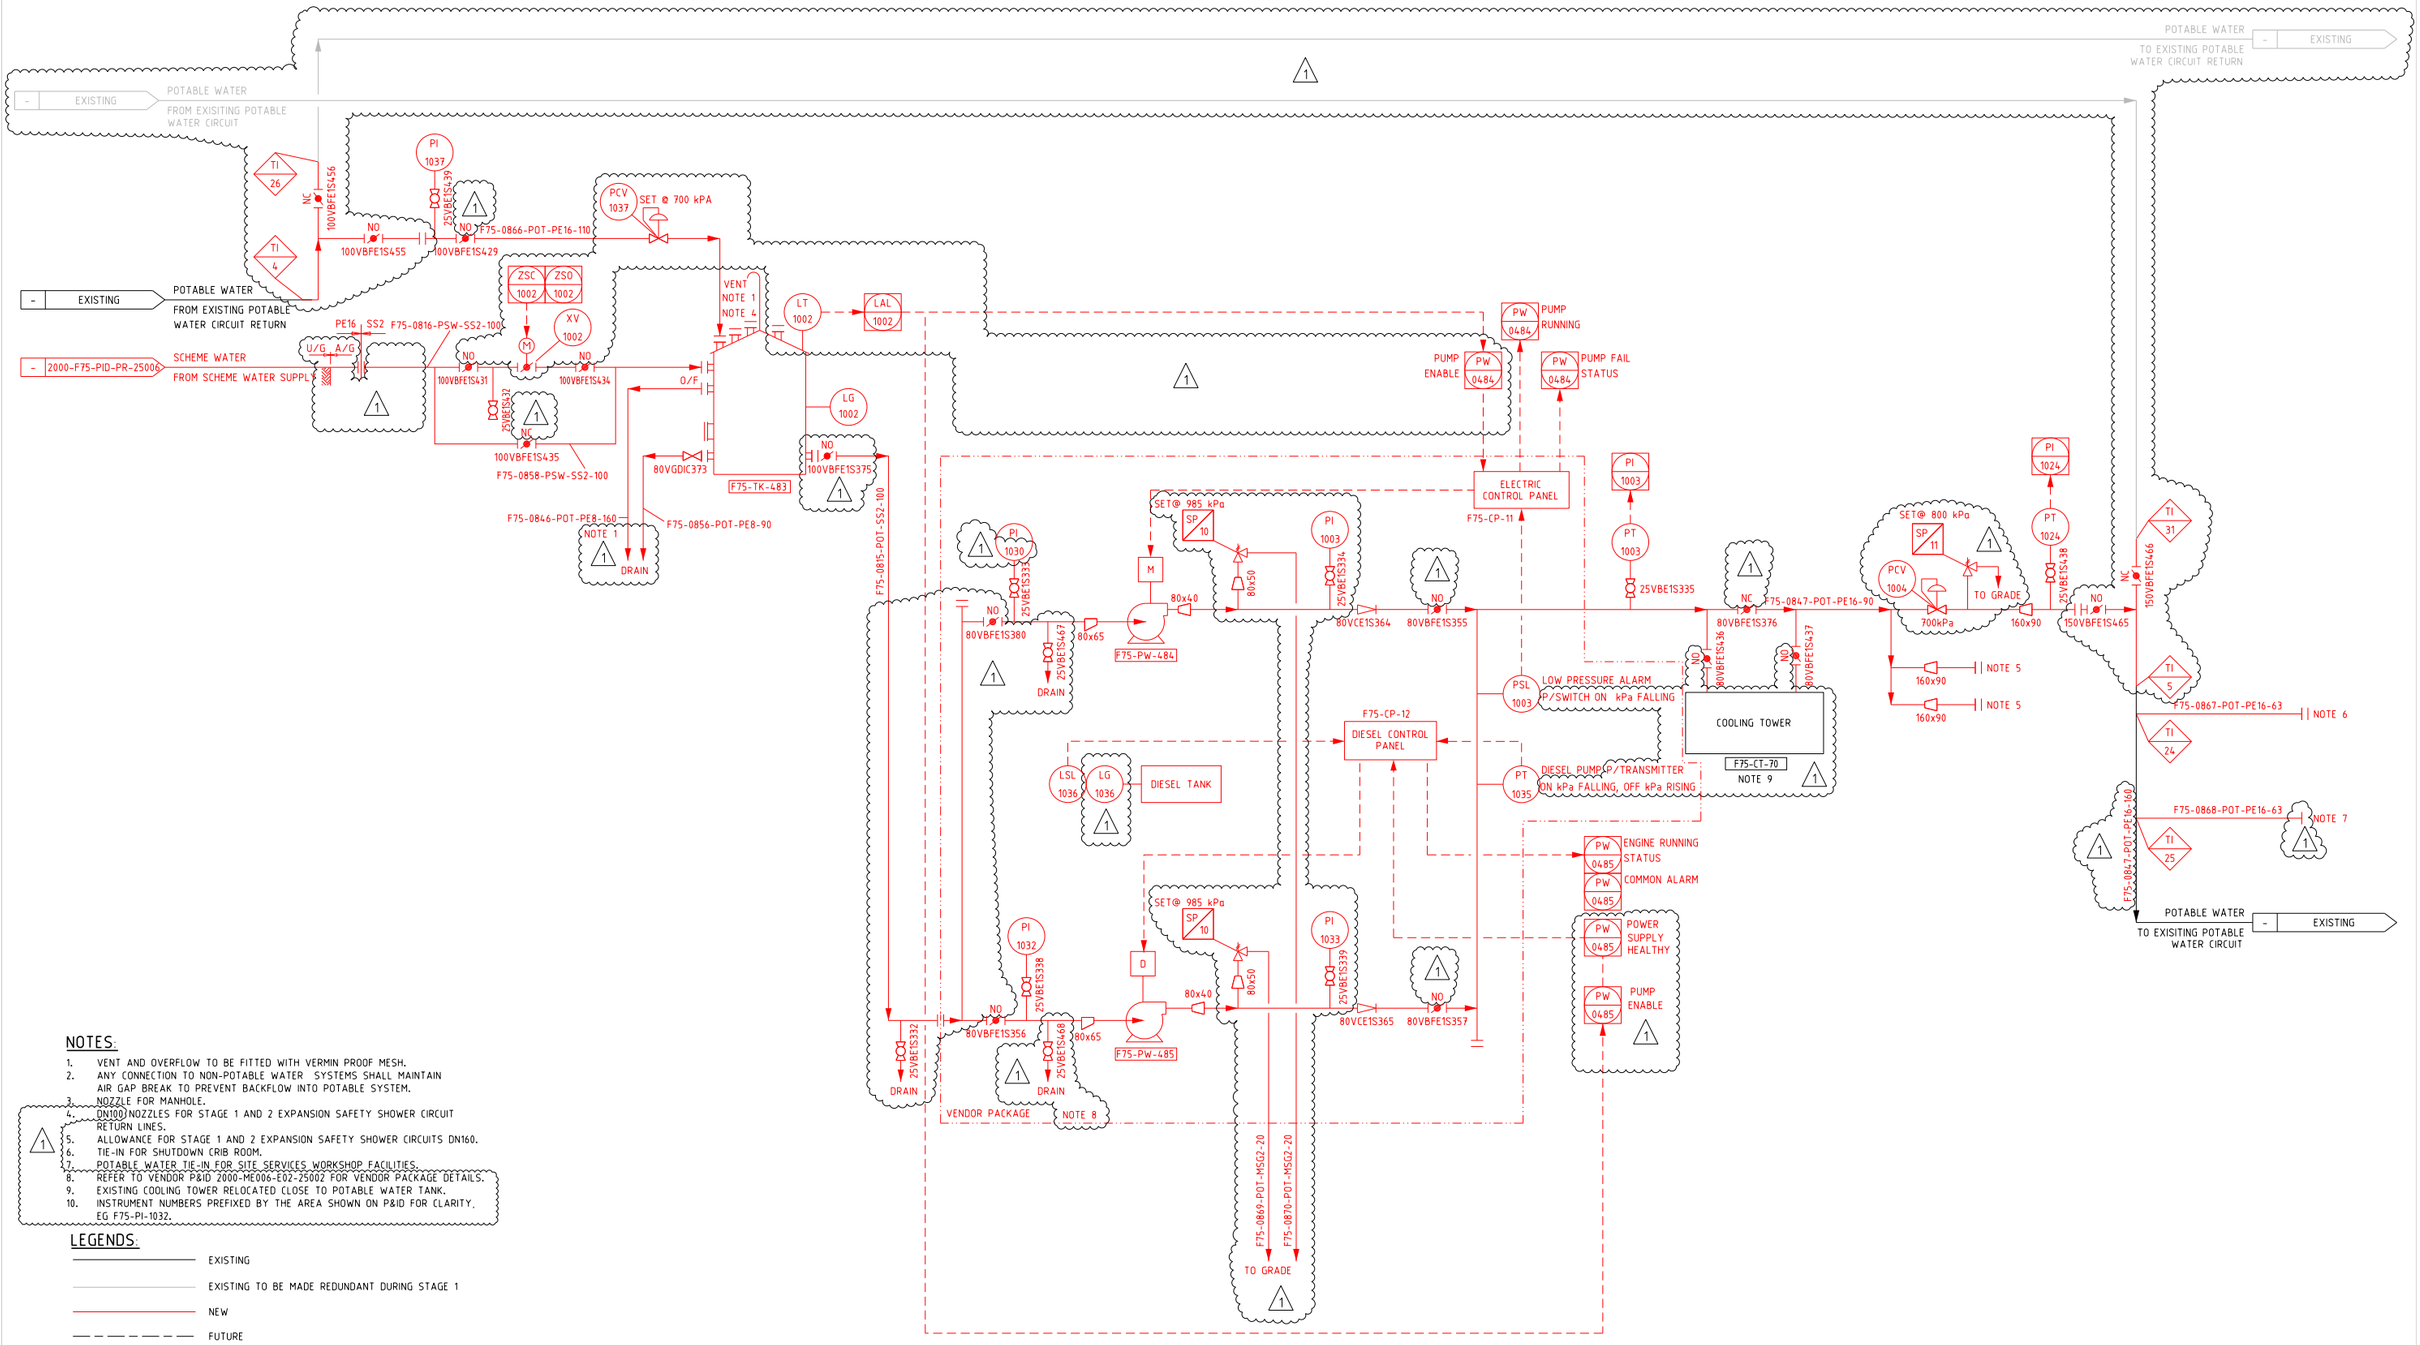


NOTES:

1. VENT AND OVERFLOW TO BE FITTED WITH VERMIN PROOF MESH.
2. ANY CONNECTION TO NON-POTABLE WATER SYSTEMS SHALL MAINTAIN AIR GAP BREAK TO PREVENT BACKFLOW INTO POTABLE SYSTEM.
3. NOZZLE FOR MANHOLE.
4. DN100 NOZZLES FOR STAGE 1 AND 2 EXPANSION SAFETY SHOWER CIRCUIT RETURN LINES.
5. ALLOWANCE FOR STAGE 1 AND 2 EXPANSION SAFETY SHOWER CIRCUITS DN160.
6. TIE-IN FOR SHUTDOWN CRIB ROOM.
7. POTABLE WATER TIE-IN FOR SITE SERVICES WORKSHOP FACILITIES.
8. REFER TO VENDOR P&ID 2000-ME006-E02-25002 FOR VENDOR PACKAGE DETAILS.
9. EXISTING COOLING TOWER RELOCATED CLOSE TO POTABLE WATER TANK.
10. INSTRUMENT NUMBERS PREFIXED BY THE AREA SHOWN ON P&ID FOR CLARITY, EG F75-PI-1032.

LEGENDS:

- EXISTING
- EXISTING TO BE MADE REDUNDANT DURING STAGE 1
- NEW
- FUTURE

POTABLE WATER PUMP	DIESEL POTABLE WATER PUMP	POTABLE WATER TANK	POTABLE WATER WATER CIRCUIT COOLING TOWER
F75-PW-484	F75-PW-485	F75-TK-483	F75-CT-70

APPROVED FOR CONSTRUCTION