
NOTES:

1. FUTURE STAGE 1 HIGH PRESSURE FIRE WATER TIE IN TO BACKFEED LEGACY SYSTEM.
2. BURIED EXISTING FIREWATER LINE TO BE UNCOVERED AND CAPPED USING BUTT WELDED MOULDED END CAP FITTING.

LEGENDS:

- EXISTING
- EXISTING TO BE MADE REDUNDANT DURING STAGE 1
- NEW
- FUTURE

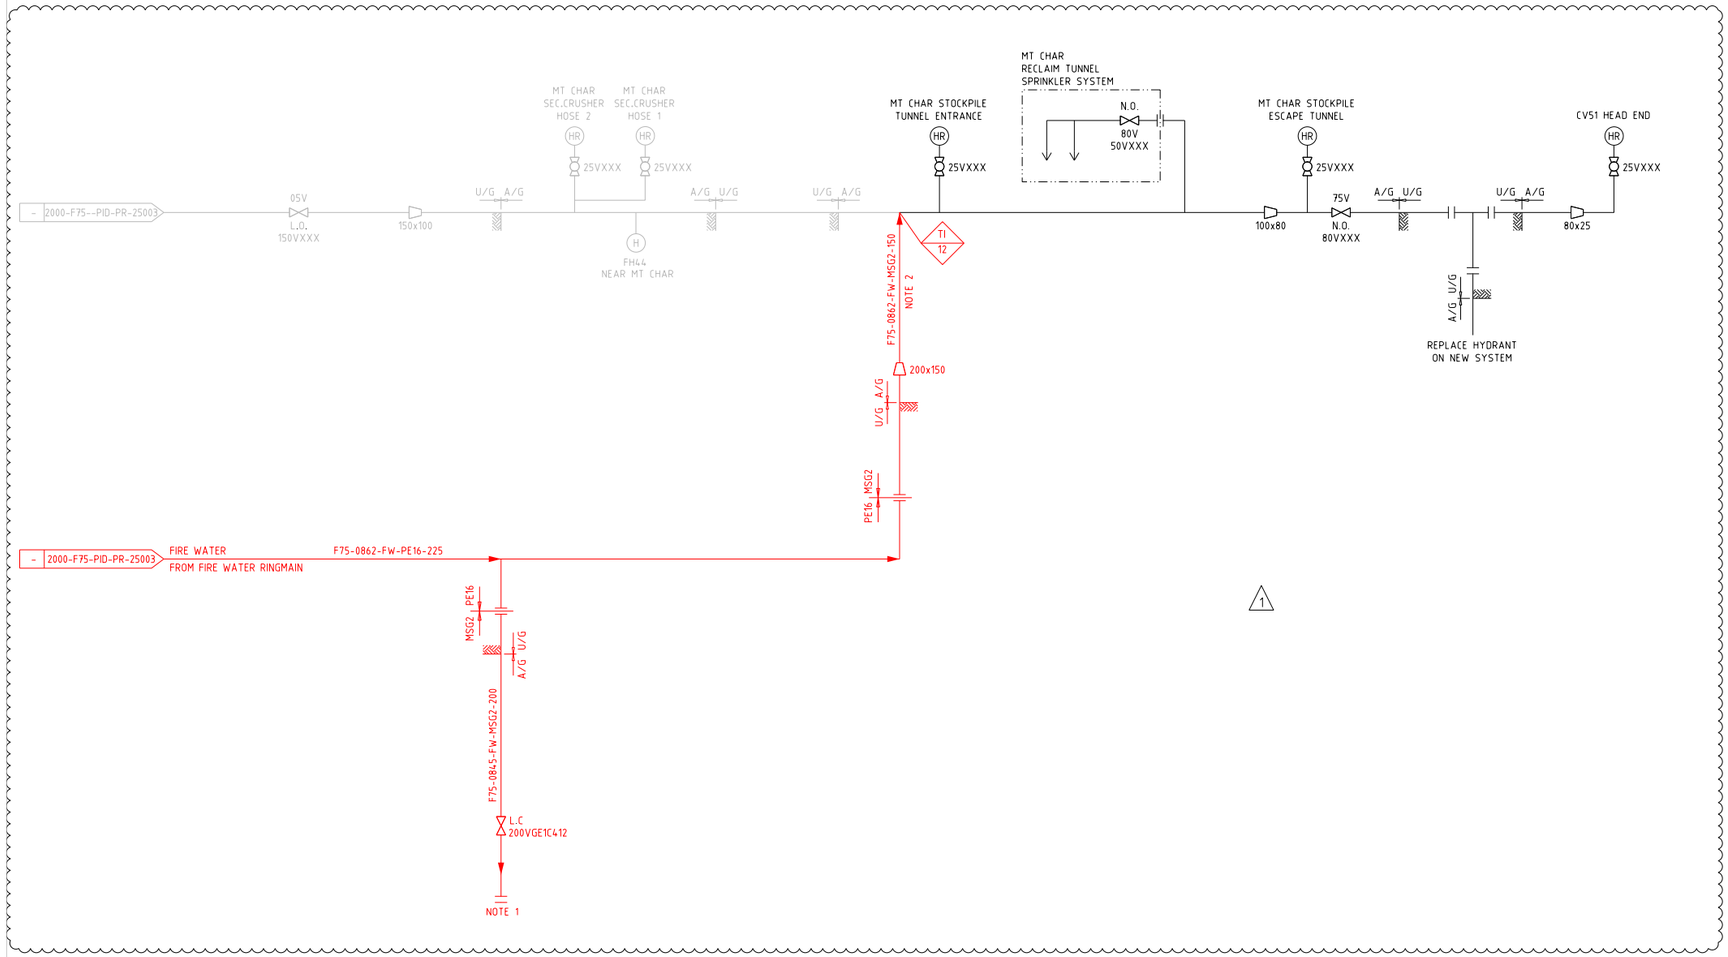

APPROVED FOR CONSTRUCTION