

Docusign Envelope ID: 1C123F4F-48ED-425D-A3F4-754BD8FC0FD6

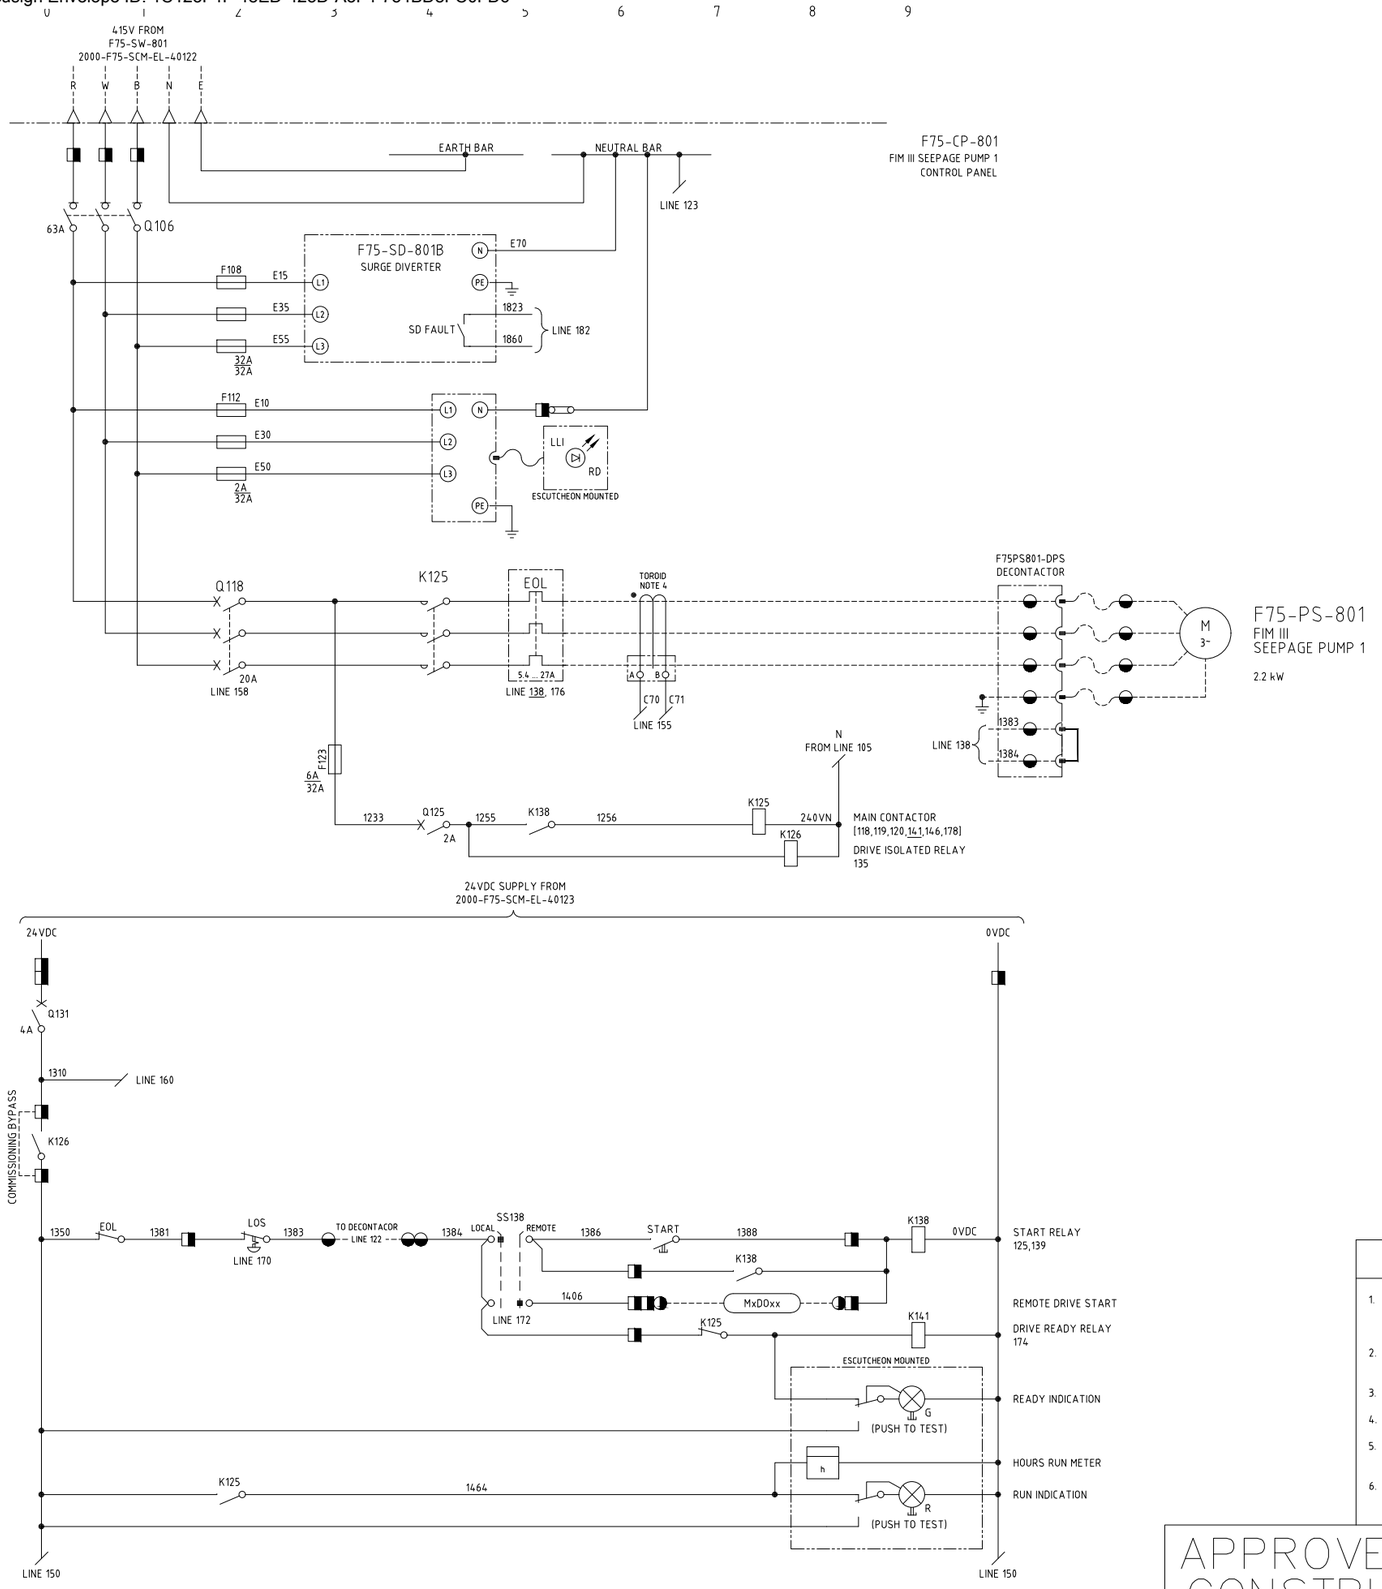

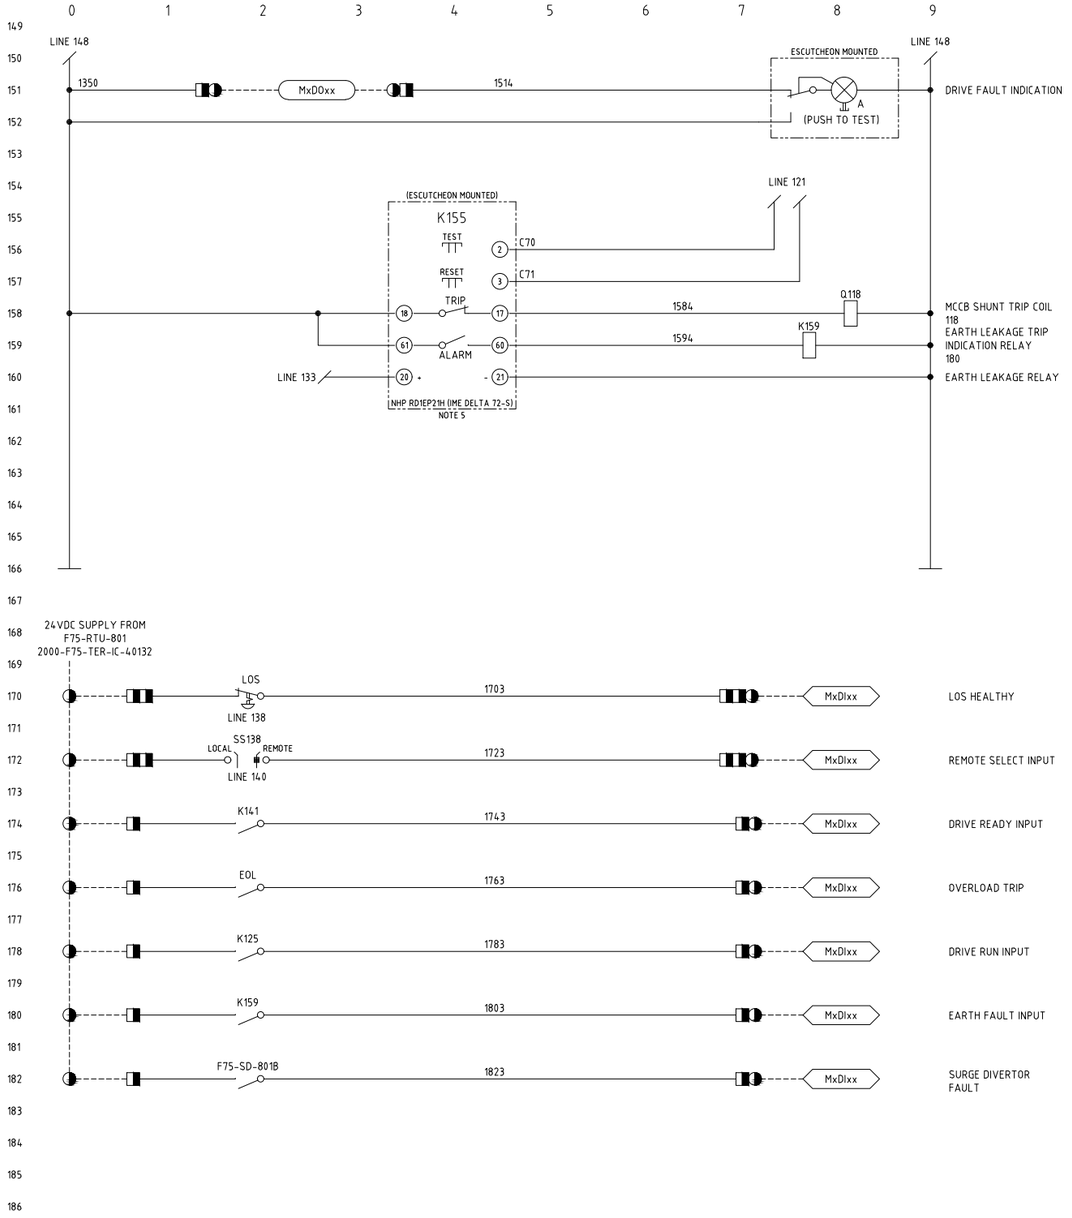


NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. FxxPSxxx-1200.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGx2 TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY USER INTERFACE TO BE MOUNTED ON CONTROL PANEL ESCUTCHEON.
6. REFER 2000-F75-LST-IC-40004 FOR RTU I/O ADDRESSES AND TERMINATION DETAILS.

LEGEND

- MxDIxx — RTU DIGITAL INPUT
- MxDOxx — RTU DIGITAL OUTPUT
- SWITCHBOARD TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- RTU TERMINAL
- CONTROL PANEL TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)

TERMINATION LEGEND

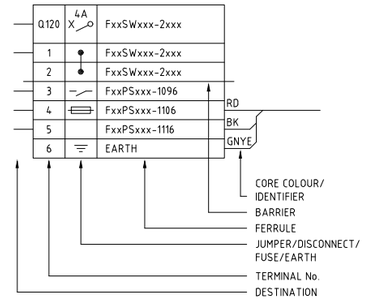

APPROVED FOR CONSTRUCTION

REFERENCES	DWG No	REV	DATE	REVISION	DRN	CHK	TECH APP	PROJ APP
F75-RTU-801 FIM III TSF SWITCHBOARD 3 RTU TERMINATION DIAGRAM SHEET 1	2000-F75-TER-IC-401.32							
F75-CP-801 FIM III SEEPAGE PUMP 1 CONTROL PANEL GENERAL ARRANGEMENT SHEET 1	2000-F75-DRG-EL-40129							
F75-CP-801 FIM III SEEPAGE PUMP 1 CONTROL PANEL TERMINATION DIAGRAM	2000-F75-TER-EL-40114							
F75-SW-801 FIM III TSF SWITCHBOARD 3 SCHEMATIC DIAGRAM SHEET 2	2000-F75-SCM-EL-40123							
F75-SW-801 FIM III TSF SWITCHBOARD 3 SCHEMATIC DIAGRAM SHEET 1	2000-F75-SCM-EL-40122							
GENERAL NOTES AND STANDARD DRAWINGS INDEX	2000-F00-STD-EL-10001	O	29.MAY.25	APPROVED FOR CONSTRUCTION	TG	KVN	KVN	TH
					Initial	Initial	Initial	DS

NORTHERN STAR RESOURCES LIMITED

DRA PACIFIC (PTY) LIMITED

DRAWN	JORRALBA	03.APR.25
CHECKED	KVN	03.APR.25
DESIGNED	JORRALBA	03.APR.25
TECH APP	KVN	29.APR.25
PROJ APP	THANDORN	29.MAY.25
CLIENT APP		

PROJECT: KCGM
FIM TSF PROJECT

TITLE: FIM III TAILINGS DAM
F75-CP-801 FIM III SEEPAGE PUMP 1 CP
SCHEMATIC DIAGRAM

SIZE	SCALE	DRG No.	REV
A1	NTS	2000-F75-SCM-EL-40114	O