


LEGEND:

- EXISTING
- NEW
- FUTURE
- DECOMMISSIONED

NOTES:

- VALVES WILL BE HYDRAULICALLY ACTUATED VIA HYDRAULIC POWER PACK F23-HY-420.
- A DRYING PAD WILL BE INSTALLED ADJACENT TO THE DRIVE IN SUMP. RECLAIMED MATERIAL WILL BE DISCHARGED TO FIM III TSF BY FRONT END LOADER.
- MANUAL OPERATED VALVE WITH PROXIMITY SWITCHES.
- BURSTING DISC RUPTURE PRESSURE TO BE SUITABLE FOR INITIAL OPERATION. WILL BE REQUIRED TO BE REPLACED AT FINAL TSF HEIGHT.
- DIFFERENTIAL FLOW CALCULATION FOR LEAK DETECTION.

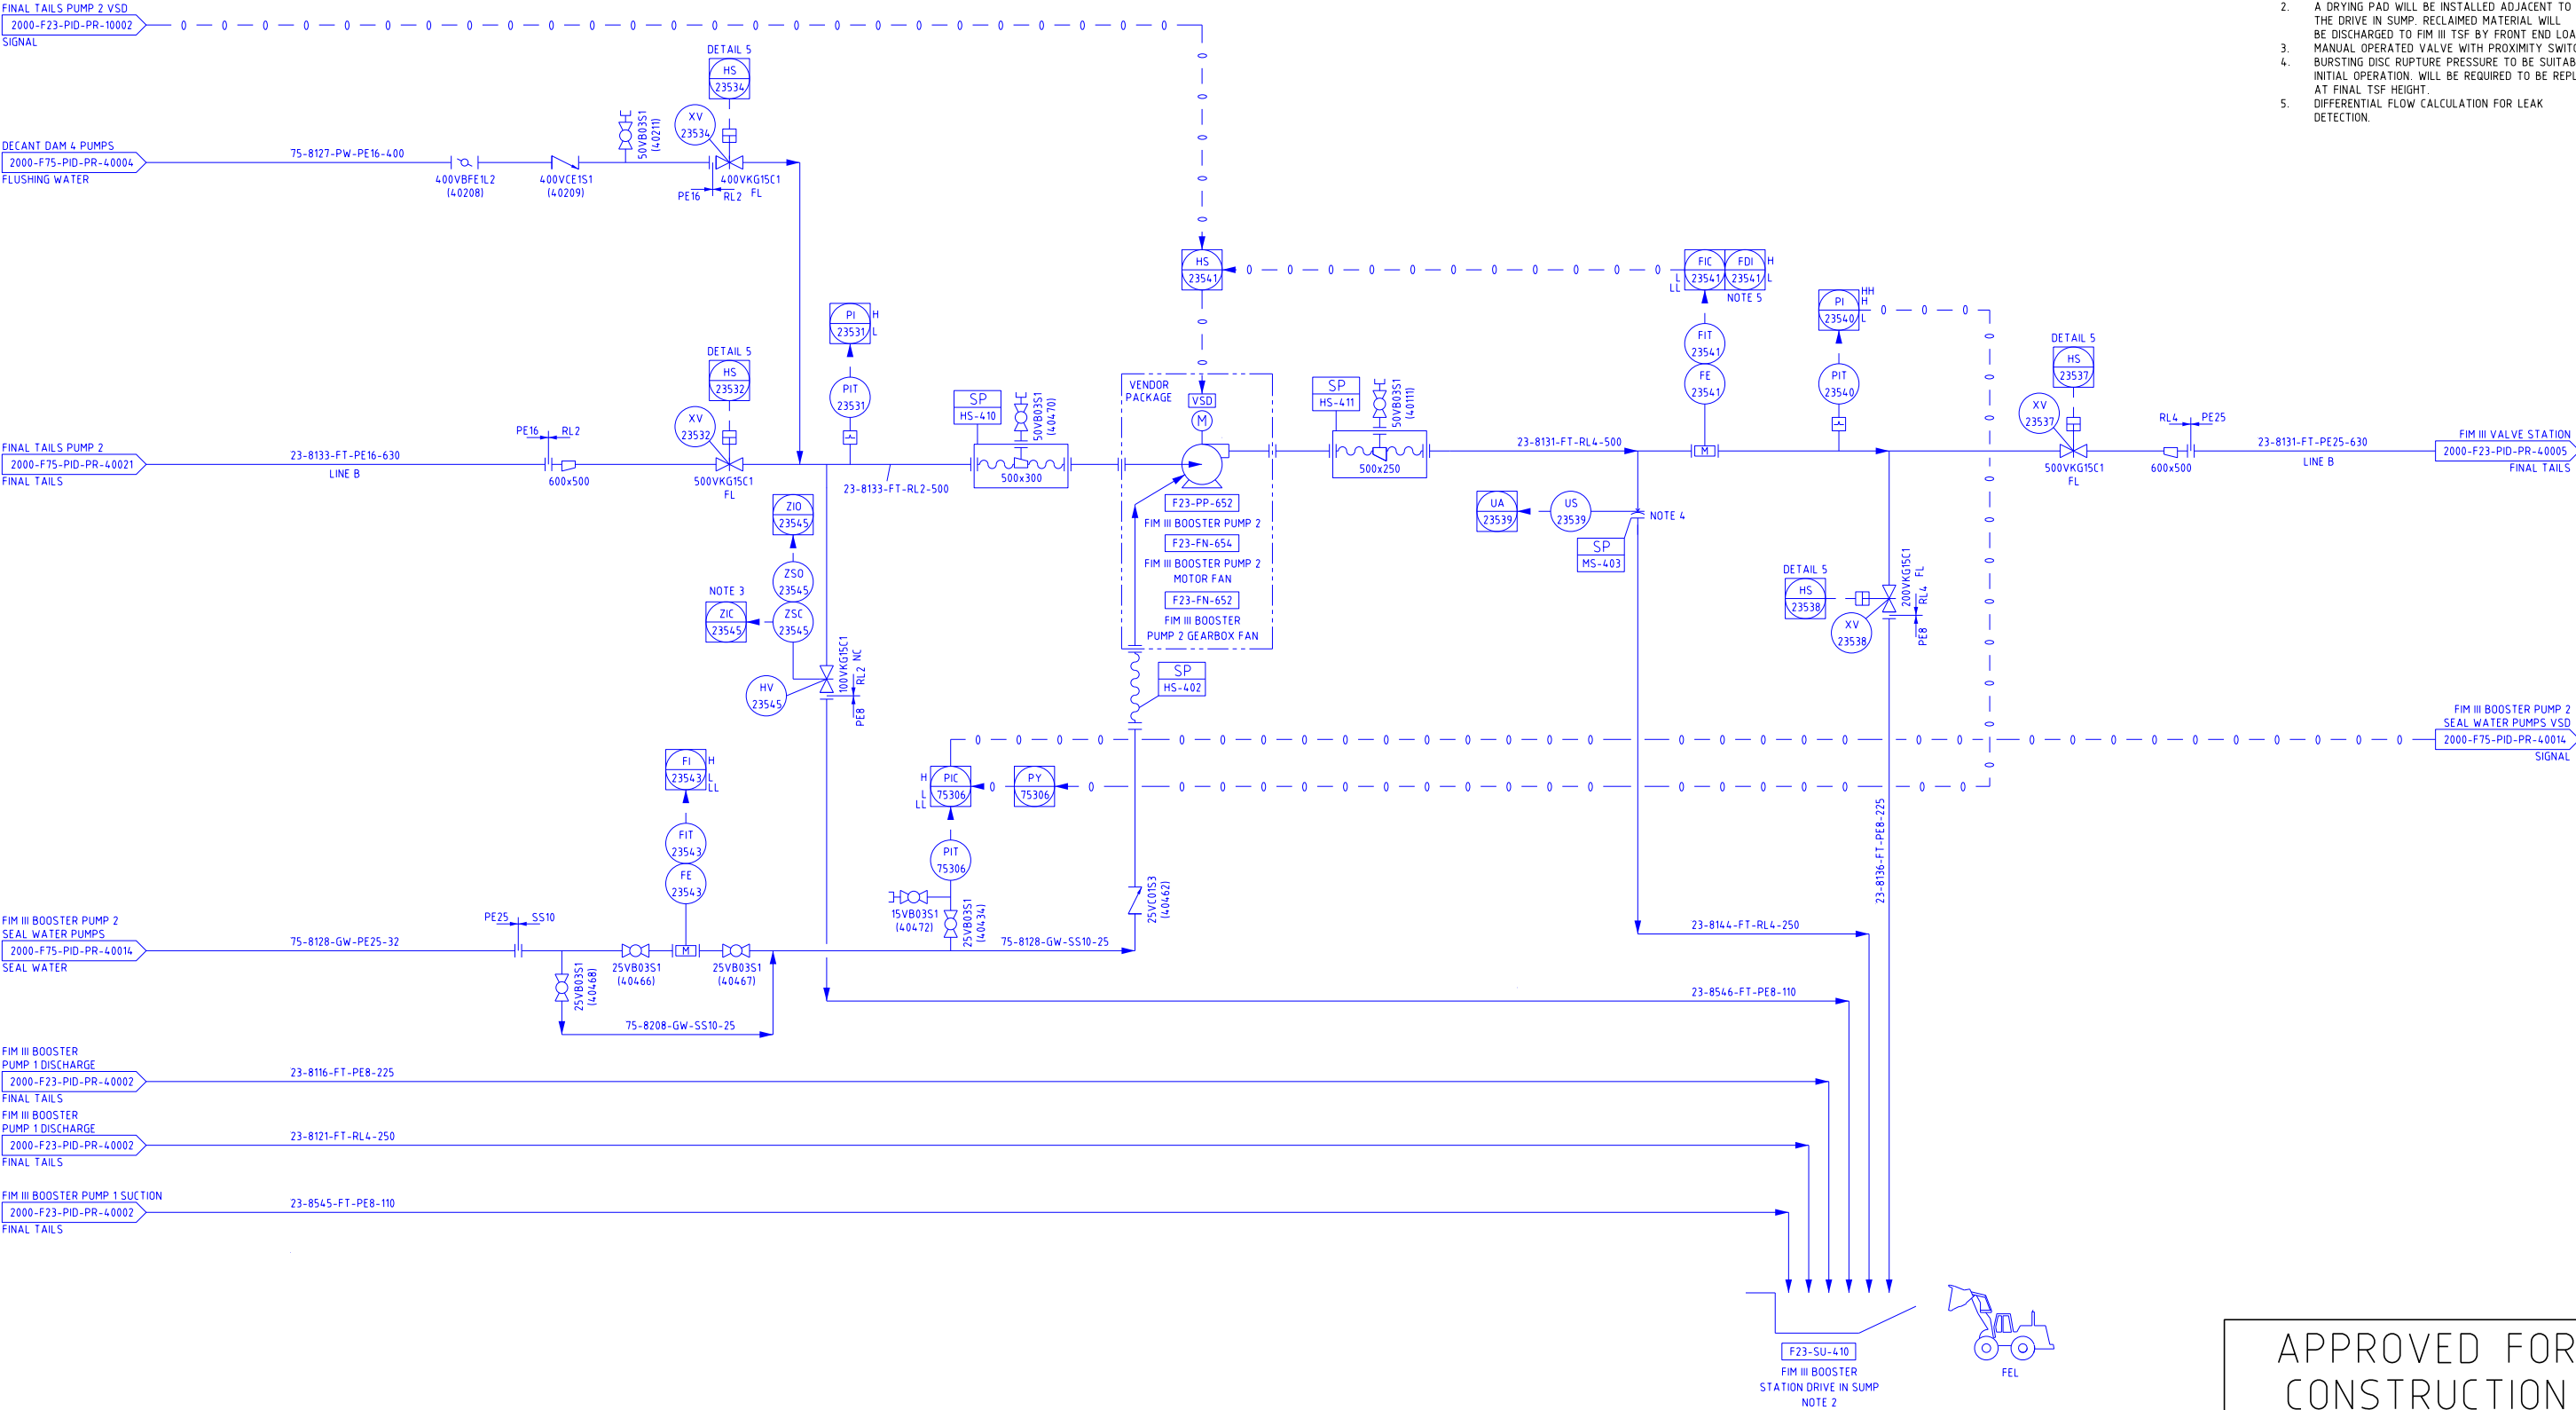

APPROVED FOR
CONSTRUCTION