


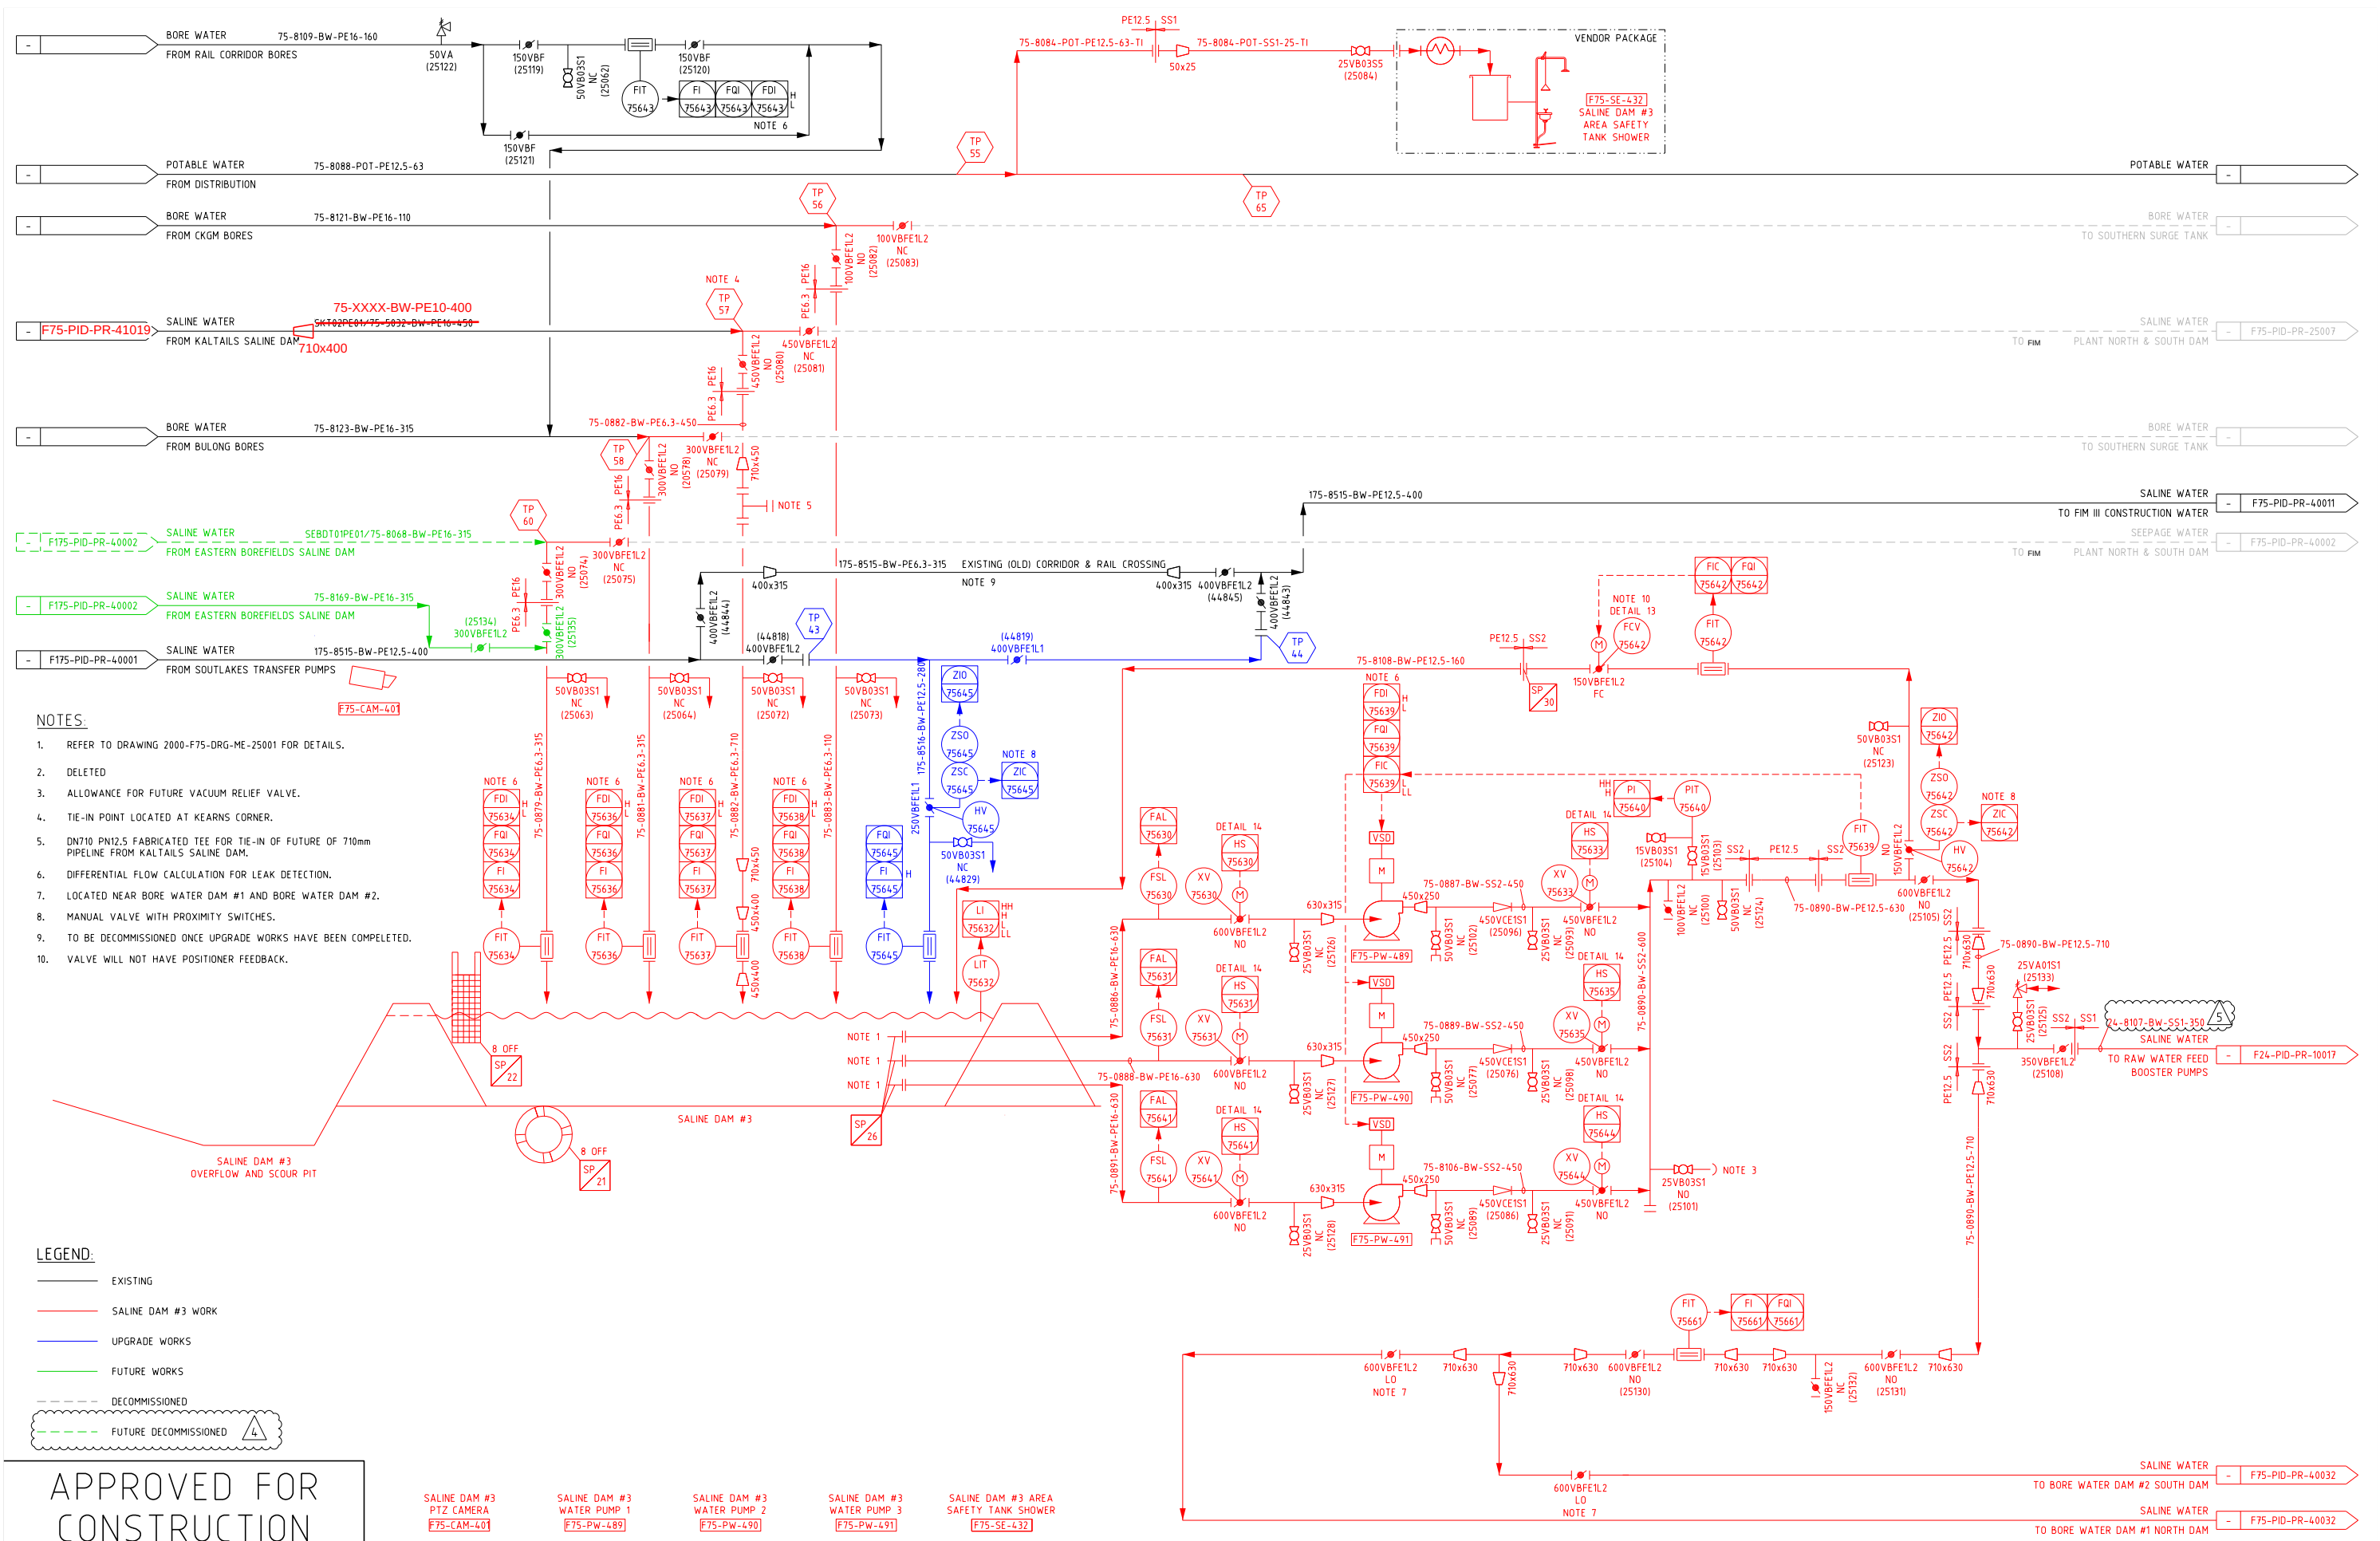

NOTES:

- REFER TO DRAWING 2000-F75-DRG-ME-25001 FOR DETAILS.
- DELETED
- ALLOWANCE FOR FUTURE VACUUM RELIEF VALVE.
- TIE-IN POINT LOCATED AT KEARNS CORNER.
- DN710 PN12.5 FABRICATED TEE FOR TIE-IN OF FUTURE OF 710mm PIPELINE FROM KALTAILS SALINE DAM.
- DIFFERENTIAL FLOW CALCULATION FOR LEAK DETECTION.
- LOCATED NEAR BORE WATER DAM #1 AND BORE WATER DAM #2.
- MANUAL VALVE WITH PROXIMITY SWITCHES.
- TO BE DECOMMISSIONED ONCE UPGRADE WORKS HAVE BEEN COMPLETED.
- VALVE WILL NOT HAVE POSITIONER FEEDBACK.

LEGEND:

- EXISTING
- SALINE DAM #3 WORK
- UPGRADE WORKS
- FUTURE WORKS



APPROVED FOR
CONSTRUCTION

SALINE DAM #3
PTZ CAMERA
F75-CAM-401

SALINE DAM #3
WATER PUMP 1
F75-PW-489

SALINE DAM #3
WATER PUMP 2
F75-PW-490

SALINE DAM #3
WATER PUMP 3
F75-PW-491

SALINE DAM #3 AREA
SAFETY TANK SHOWER
F75-SE-432