


LEGEND:

- EXISTING
- NEW
- FUTURE
- DECOMMISSIONED

NOTES:

- PIPE ON TOP OF TSF TO BE FLANGED EVERY 40m.
- VALVE TO BE INSTALLED WITHOUT A HANDLE.
- DIESEL POWERED PUMP TO BE USED DURING COMMISSIONING WORKS. CONTROL OF ELECTRIC PUMP TO BE FUTURE BY OTHERS.

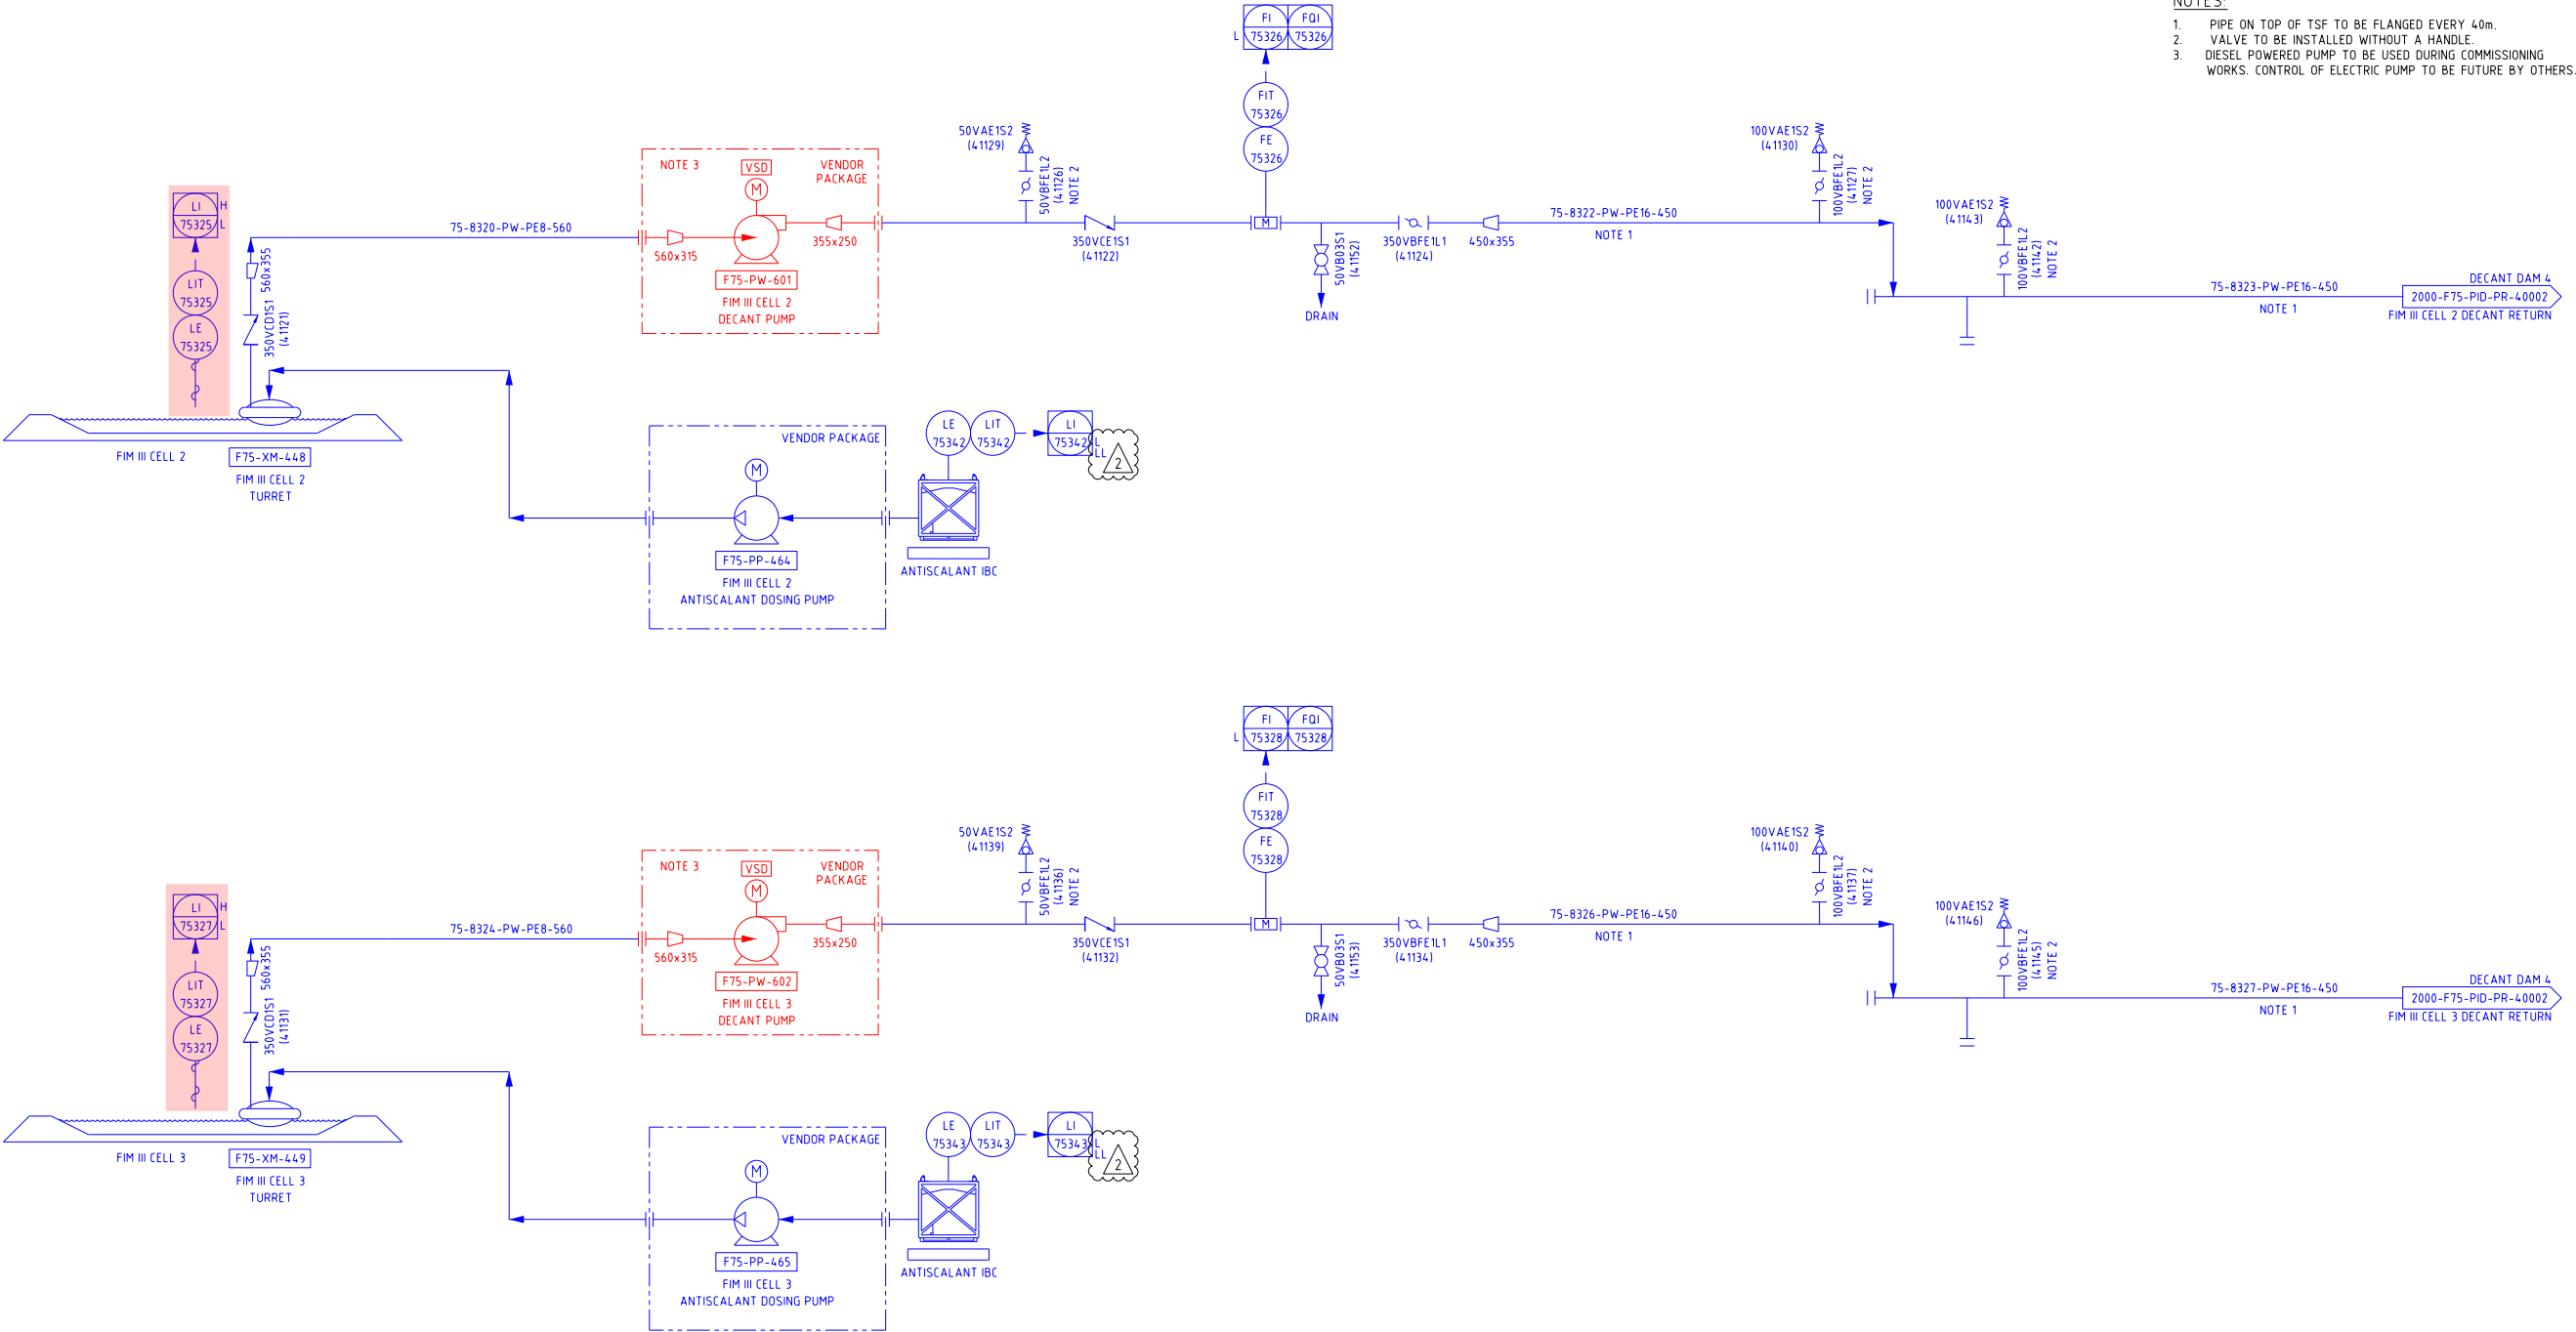

APPROVED FOR
CONSTRUCTION