


NOTES:
1. REFER TO 2000-F75-PID-PR-40008 FOR PUMP AND PUMP HEADER DETAILS.
2. SEEPAGE WATER HEADER HAS BEEN SIZED FOR A MAXIMUM OF 20 FUTURE SEEPAGE BORE PUMPS ACCORDING TO HYDROGEOLOGY REPORT 2000-T00-REP-GE-40001.
3. DIFFERENTIAL FLOW CALCULATION FOR LEAK DETECTION.

LEGEND:
— EXISTING
— NEW
— FUTURE
- - - DECOMMISSIONED

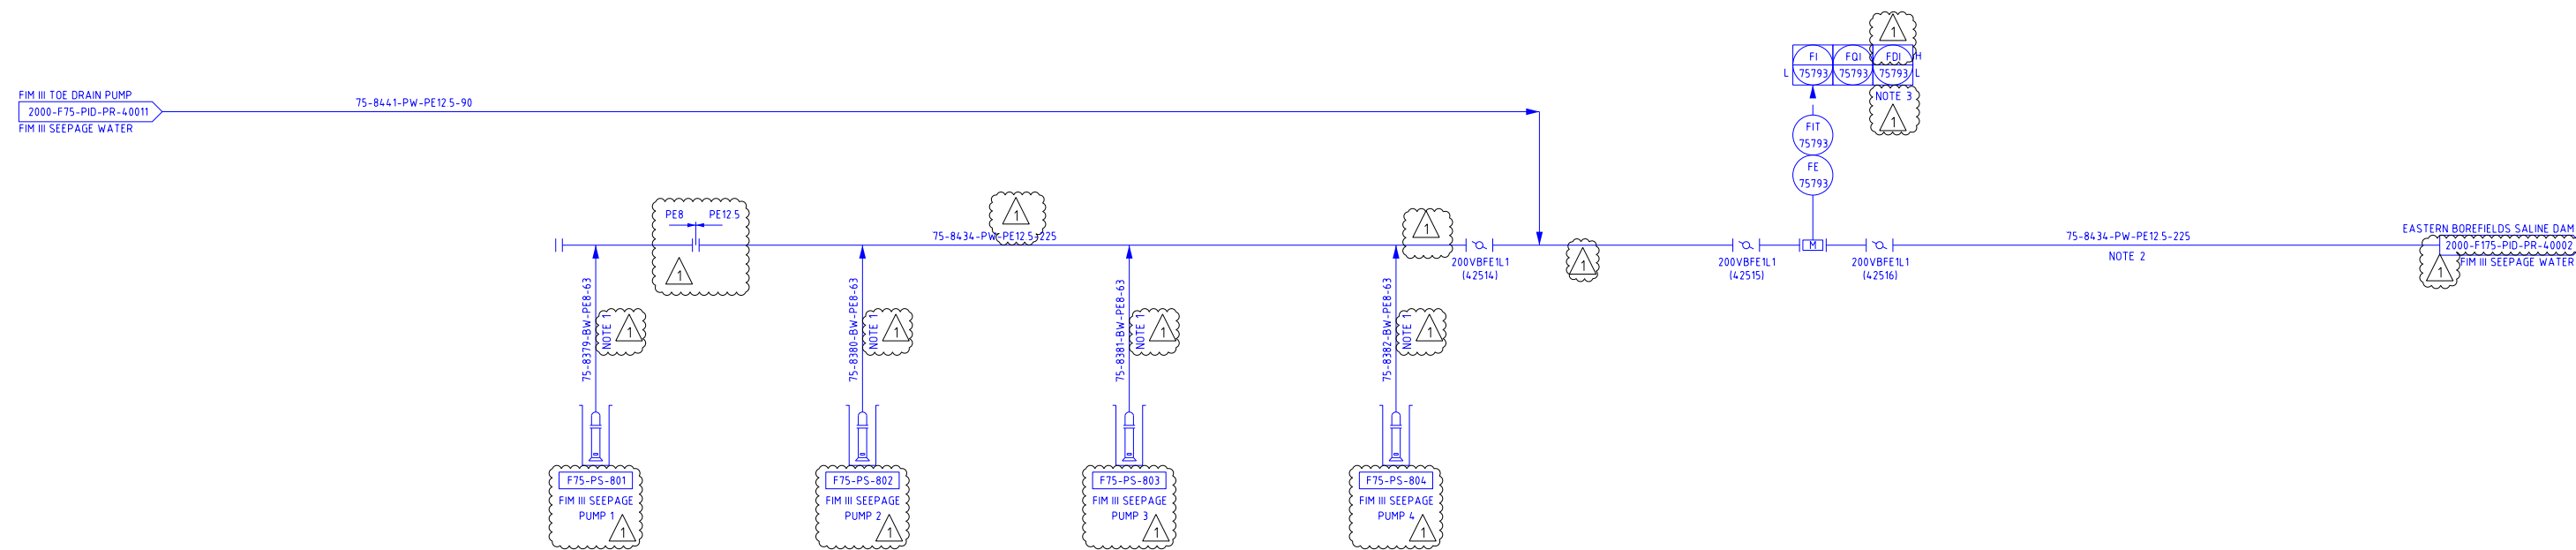

APPROVED FOR
CONSTRUCTION