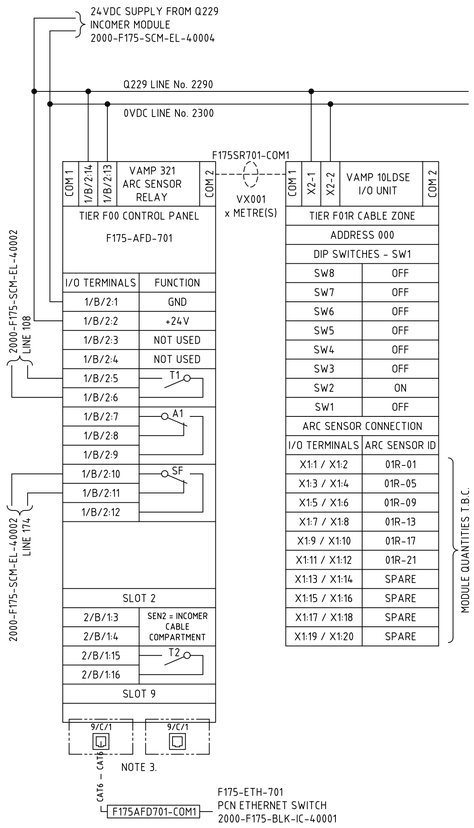


NOTES

1. CABLE NUMBER FOR ARC FLASH SENSOR VA1DA SHALL BE THE EQUIPMENT NUMBER FOLLOWED BY C FOR CONTROL AND A SEQUENTIAL NUMBER e.g. F175SW701-COMx.
2. EACH CABLE SHALL BE IDENTIFIED AT BOTH ENDS WITH CABLE NUMBER.
3. VAMP 321 ARC FAULT PROTECTION RELAY SHALL BE MOUNTED TO THE DOOR OF THE PANEL INCOMER CONTROL CUBICLE.
4. VAM 10LDSE INTERFACE SHALL BE MOUNTED ON THE CABLE ZONE DOOR.
5. MAXIMUM 16 VAM10LDSE I/O UNITS IN SERIES.
6. MAXIMUM LENGTH OF VX001 CABLE BETWEEN 2 UNITS (I/O UNITS OR VAMP321 UNIT) IS 30m & TOTAL LENGTH OF THE BUS CABLE FROM THE START TO THE END OF 100m SHALL NOT BE EXCEEDED.

LEGEND

FxxSRxxx-COMx — CABLE MARKER LABEL

———— 24VDC SUPPLY CABLE

- - - - - - - - - COMMUNICATION CABLE

DIP SWITCHES KEY VAMP 10LDSE		
	ON	OFF
SW8	1	0
SW7	2	0
SW6	4	0
SW5	8	0
SW4	16	0
SW3	L>	L> + I>
SW2	LATCH	NON LATCHING
SW1	L> INT	L> EXT

L = LIGHT / I = CURRENT

NORTHERN STAR RESOURCES LIMITED

Approved	X
Approved as Noted	
Not Approved	
For Information Only	

Signed [redacted] 10/11/2025
C Laird

ACCEPTANCE DOES NOT RELIEVE THE SUPPLIER / CONTRACTOR OF ITS RESPONSIBILITY OR LIABILITIES UNDER THE PURCHASE ORDER / CONTRACT

PRELIMINARY
NOT FOR CONSTRUCTION

REFERENCES	DWG No	REV	DATE	REVISION	DRN	CHK	TECH APP	APP
SOUTHLAKES BOOSTER STATION CONTROL SYSTEM & COMMUNICATIONS BLOCK DIAGRAM	2000-F175-BLK-IC-40001							
F175-SW-701 LV MOTOR CONTROL CENTRE 24VDC DISTRIBUTION SCHEMATIC DIAGRAM	2000-F175-SCM-EL-40004							
F175-SW-701 LV MOTOR CONTROL CENTRE INCOMER SCHEMATIC DIAGRAM SHEET 2	2000-F175-SCM-EL-40002							
F175-SW-701 LV MOTOR CONTROL CENTRE SINGLE LINE DIAGRAM	2000-F175-SLD-EL-40001	O	21.OCT.25	APPROVED FOR CONSTRUCTION	Initial			DS

NORTHERN STAR RESOURCES LIMITED

DRA PACIFIC (PTY) LIMITED

[redacted]	GROOM	13.MAR.2025
CHECKED	CHARLESWORTH	10.APR.2025
DESIGNED	[redacted]	10.APR.2025
TECH APP	CHARLESWORTH	20.OCT.2025
[redacted] APP	MDORF	21.OCT.2025
CLIENT APP		

PROJECT: KCGM
FIM TSF PROJECT

TITLE: SOUTHLAKES BOOSTER STATION
F175-SW-701 LV MOTOR CONTROL CENTRE
ARC FLASH CONNECTION DIAGRAM

A1	SCALE NTS	DRG No. 2000-F175-SCM-EL-40003	REV 0