
CONTINUED FROM DWG. 30\E\0414-001

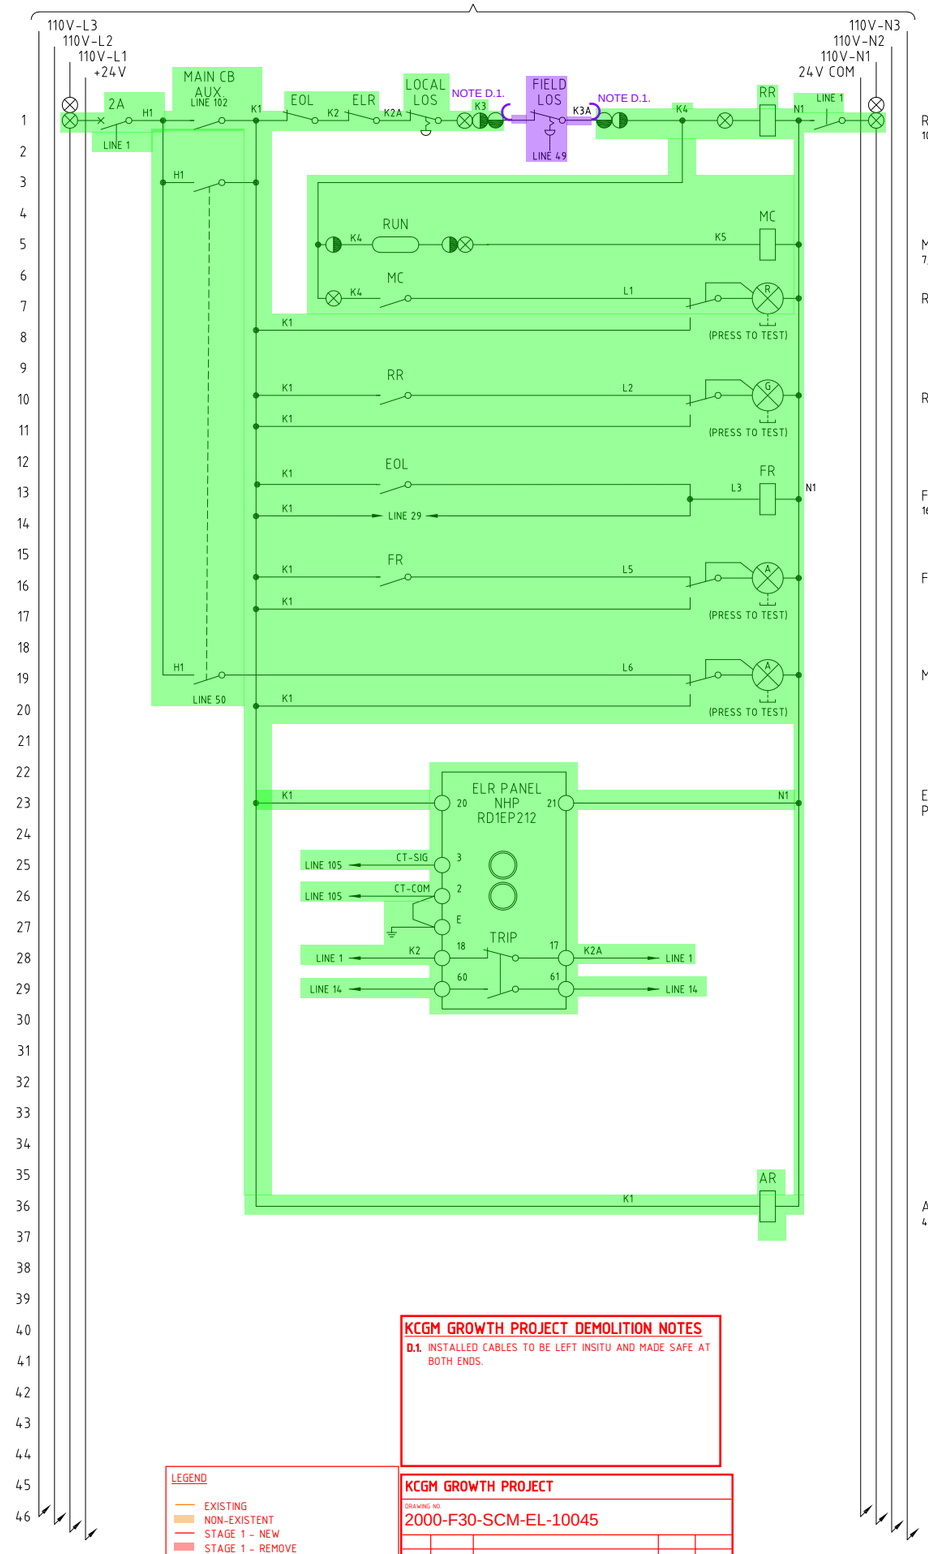

READY RELAY
10, 52

MAIN CONTACTOR
7, 60, 100, 101, 102

RUN INDICATION

READY INDICATION


FAULT RELAY
16,58

FAULT INDICATION


MAINTENANCE MODE

EARTH LEAKAGE RELAY
POWER SUPPLY

AUX. RELAY
49

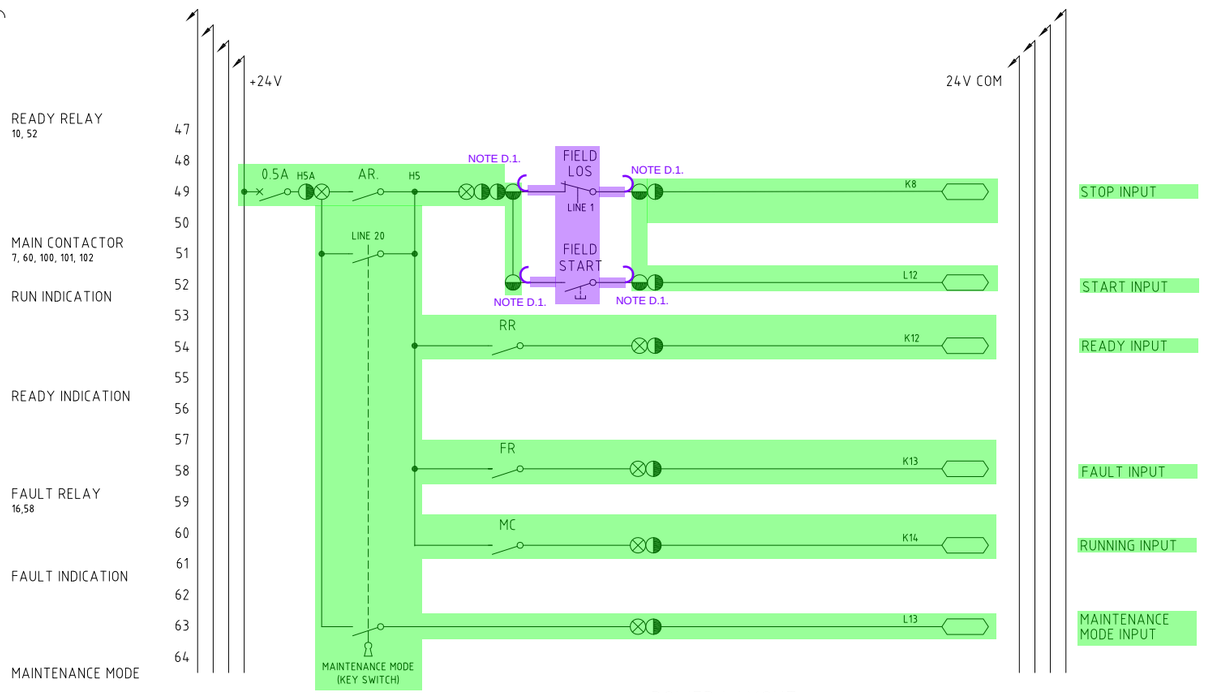

POWER LAYOUT

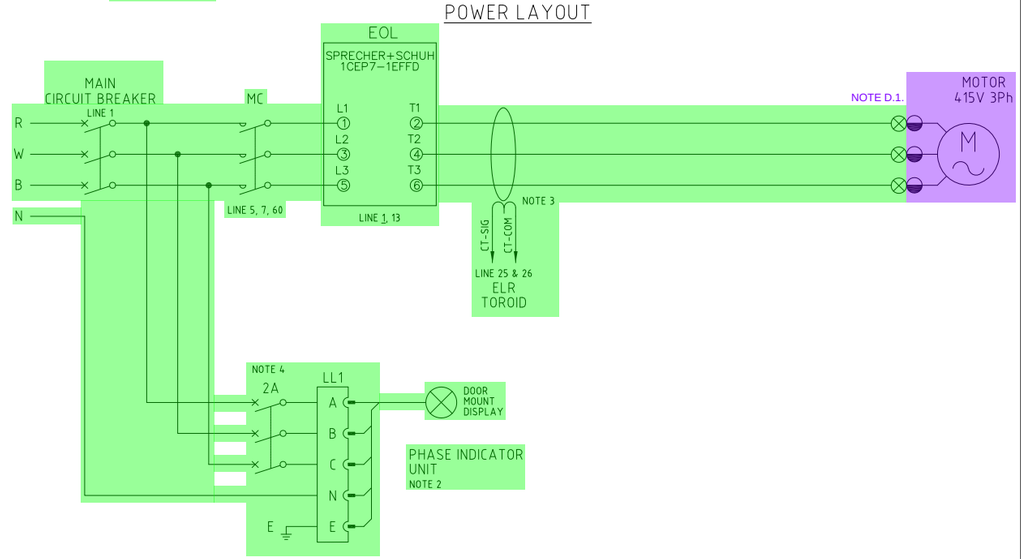

KCGM GROWTH PROJECT DEMOLITION NOTES

D.1. INSTALLED CABLES TO BE LEFT INSITU AND MADE SAFE AT BOTH ENDS.

LEGEND
- EXISTING
- NON-EXISTENT
- STAGE 1 - NEW
- STAGE 1 - REMOVE
- STAGE 1 - DECOMMISSIONED (OTHERS)
- STAGE 2 - NEW
- STAGE 2 - REMOVE
- STAGE 2 - DECOMMISSIONED (OTHERS)

KCGM GROWTH PROJECT

DRAWING NO. 2000-F30-SCM-EL-10045

REV	DATE	DESCRIPTION	CHECK	TECH APP
0	10/11/25	APPROVED FOR CONSTRUCTION	AE [redacted]	

SPARE

EQUIPMENT NUMBER	DESCRIPTION	POWER RATING (kW)	MODULE NUMBER	FERRULE PREFIX	24V CB NUMBER	START DIGITAL OUTPUT	STOP DIGITAL INPUT	START DIGITAL INPUT
30-PP-65A-1	CIL3 TANK A CARBON RECOVERY PUMP	18.5	2R9	PP65A-1	R3 CB19	%Y083306	%Y083103	%Y083104

EQUIPMENT NUMBER	FAULT DIGITAL INPUT	RUN DIGITAL INPUT	READY INPUT	MAINTENANCE MODE INPUT				
30-PP-65A-1	%Y083105	%Y083109	%Y083117	%Y083118				

LEGEND

TERMINALS
- MOTOR CONTROL CENTRE (MCC)
- FIELD
- TELEMETRY/PLC
- FIELD EQUIPMENT CONTROL PANEL
- LINE CONDITIONER
- SOFT STARTER TERMINAL
- VARIABLE SPEED DRIVE
- DISTRIBUTION BOARD
- HV MOTOR CONTROL CENTRE
- TERMINAL STRIP CONNECTION
- MISC. ELECTRICAL DEVICE REFER NOTES FOR SPECIFIC DESC.

DIGITAL FUNCTIONS
- PLC INPUT
- PLC INPUT WITH ALARM FUNCTION
- PLC OUTPUT

ANALOGUE FUNCTION
- 4-20mA PLC INPUT
- 4-20mA PLC OUTPUT

ANCILLARY EQUIPMENT
- CIRCUIT BREAKER
- COMBINATION FUSE SWITCH
- ISOLATOR
- PUSH BUTTON
- LOS (LOCK OFF STOP)
- PULL WIRE SWITCH
- NORMALLY CLOSED CONTACT
- LIMIT SWITCH
- CONTACTOR CONTACT
- NORMALLY OPEN CONTACT
- TIMER CONTACT
- FUNCTION CONTACT
  - P - PRESSURE
  - °t - TEMPERATURE
  - F - FLOW
  - L - FLOAT
- SIREN
- HORN
- RELAY
- LINK
- THERMISTOR
- INDICATION LAMP R - RED, G - GREEN, A - AMBER
- PLUG CONNECTION

NOTES

1. ALL WIRES EXCEPT CONTROL SUPPLIES & THOSE WITHIN FORM 4 MODULES SHALL BE FERRULED WITH PREFIX LISTED IN ABOVE TABLE.
2. PHASE INDICATOR DETAILS: - NHP REM LIVE RL-24i
3. EARTH LEAKAGE RELAY:- NHP TOROID 60mm TDGH2
4. PROTECTION FOR PHASE INDICATOR: DEPEND UPON FAULT LEVEL, USE OF FUSE OR BREAKER SHALL BE ADOPTED

COPYRIGHT ©
This drawing remains the property of Northern Star Resources and may not be copied in any way without prior written approval from this company.

NORTHERN STAR RESOURCES LIMITED

MK	DATE	REVISION	BY	CKD	APP	REFERENCE DRAWINGS	DWG NO.
2	29.10.24	CIL 3 PROJECT - MODIFICATIONS	[redacted]	MS	[redacted]		
1	31.07.24	RE-ISSUED FOR CONSTRUCTION		CB	CL		
0	08.07.24	ISSUED FOR CONSTRUCTION		KVN	[redacted]		

SCALE	NTS	
DRAWN	[redacted]	05/12/2023
DESIGNED	[redacted]	09/07/2024
CHECKED	[redacted]	09/07/2024
APPROVED	P. KNIGHT	09/07/2024
PROJ.APP	R. HERBST	09/07/2024
PROJ. FILE #.		

FIMISTON PLANT
CARBON IN LEACH (C.I.L 3)
SUB No.68 415V MCC 30-SW-64
SCHEMATIC DIAGRAM

SIZE	DRAWING NUMBER	REV
A1	30\E\0588-003	2

KALGOORLIE CONSOLIDATED GOLD MINES OPERATIONS