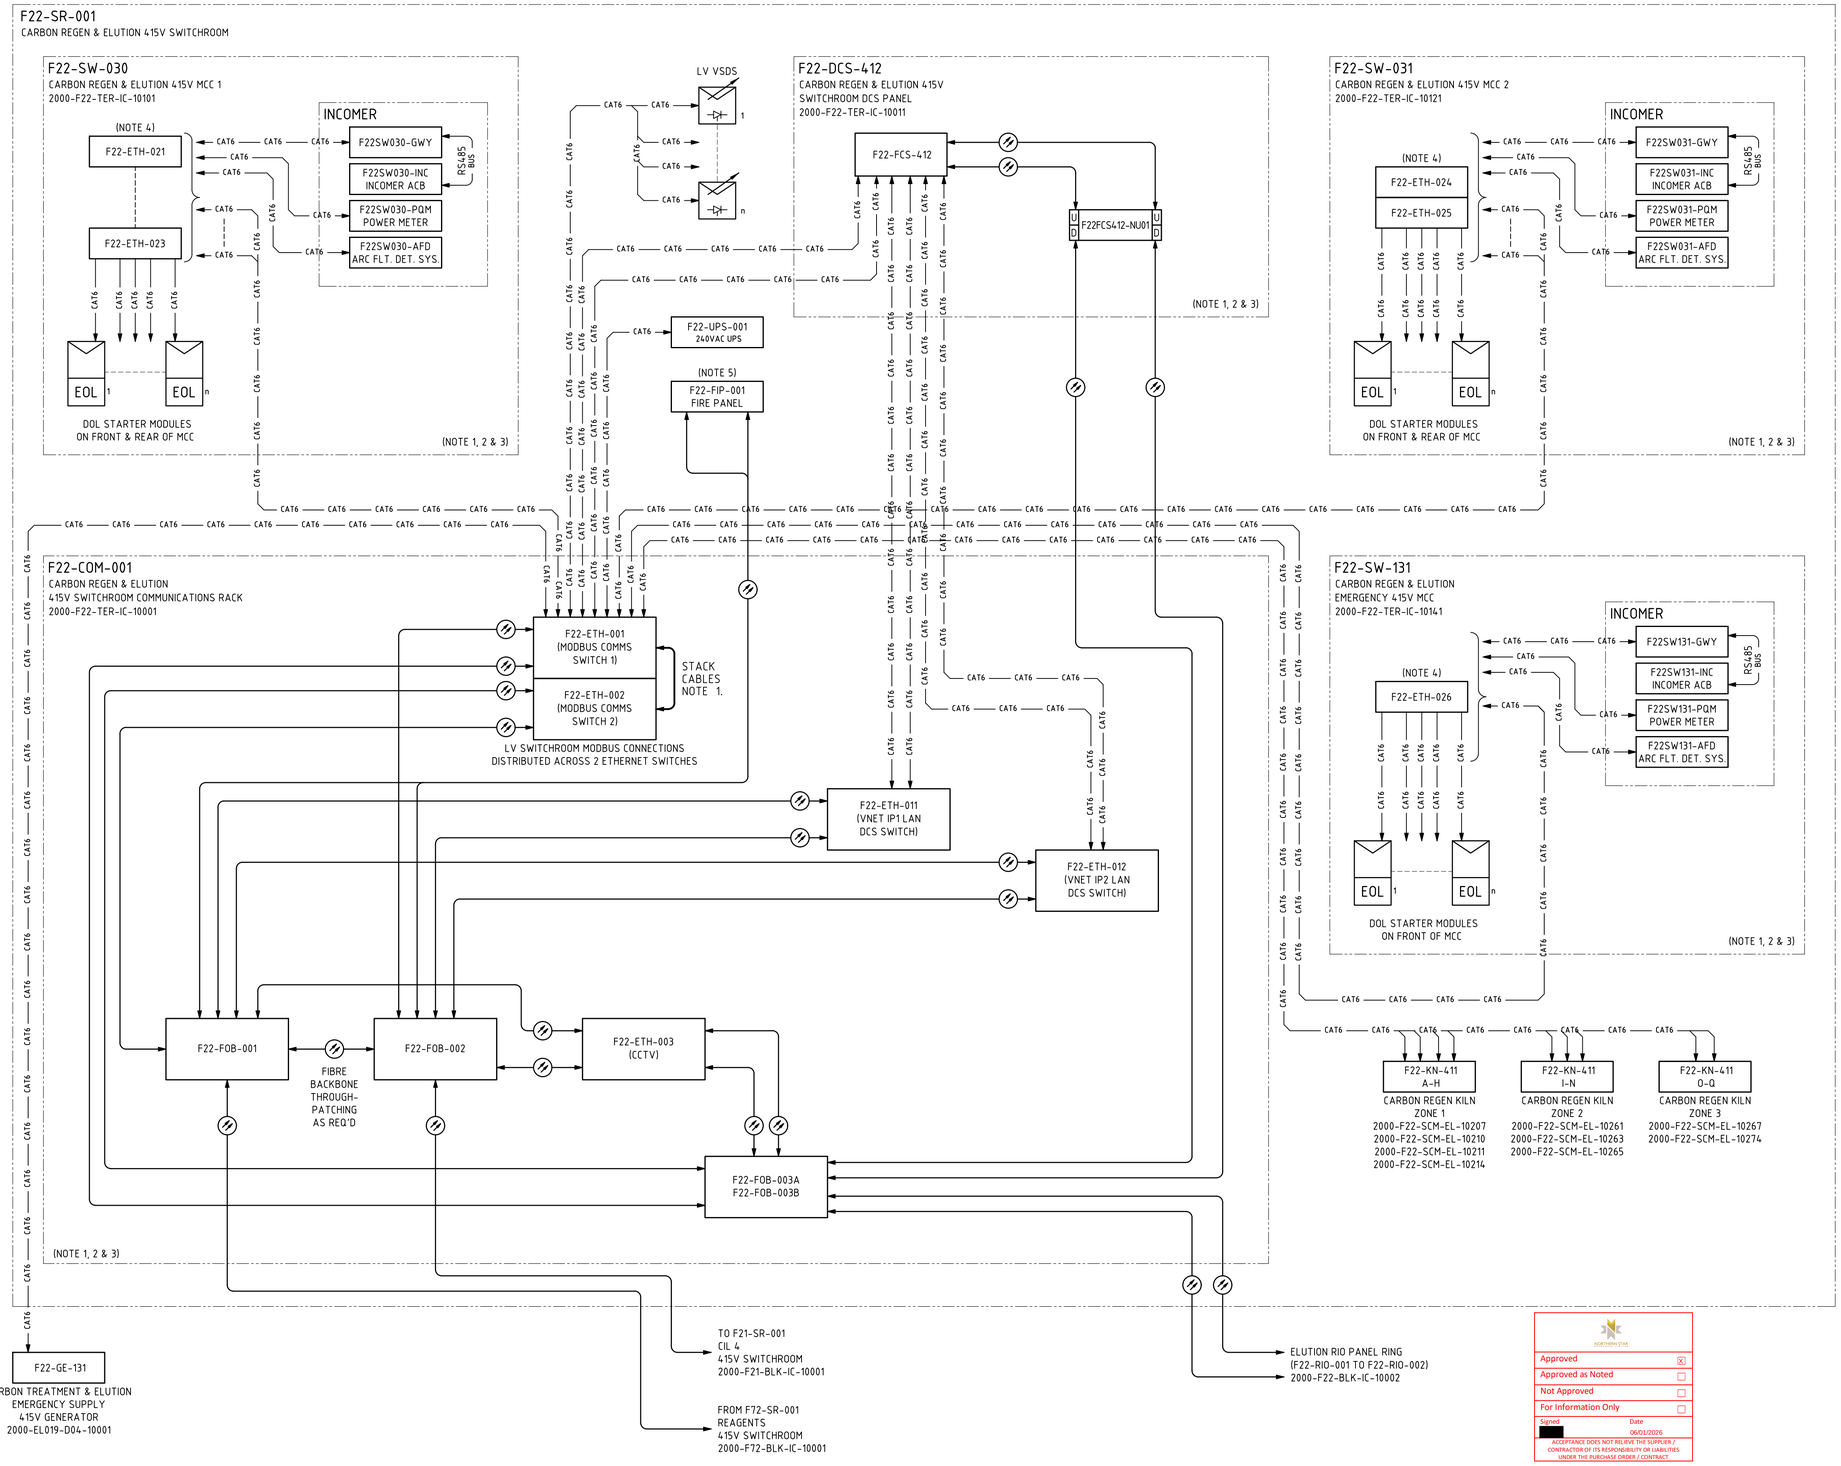


NOTES

1. FOR INTERNAL FIBRE OPTIC, CAT6 PATCH LEAD (& STACK CABLING IN SWITCHROOM COMMS CABINETS) EQUIPMENT CONNECTION DETAILS REFER TO SPECIFIC TERMINATION DIAGRAMS.
2. REFER TO SPECIFIC COMMUNICATIONS TERMINATION DRAWINGS FOR EXTERNAL EQUIPMENT CONNECTION DETAIL.
3. COM CABINET, DCS PANEL, RIO PANEL, MCC & SWITCHBOARD HARDWARE/INTERCONNECTIONS (E.G. NIO NODE) & INTER-FOBOT PATCHING NOT SHOWN FOR CLARITY. REFER TO SPECIFIC COMMUNICATIONS TERMINATION DRGS FOR DETAIL.
4. ETHERNET SWITCHES LOCATED IN CABLE ZONE OF 415VAC MCC, FRONT & BACK - AS REQUIRED.
5. FIRE INDICATION PANELS SHALL BE ON A FIBRE OPTIC RING AND WILL TIE-IN TO EXISTING MAIN PLANT FIRE ANNUNCIATOR PANEL. FIP CONNECTS TO FIBRE INFRASTRUCTURE VIA 2 FIBRE OPTIC PATCH CABLES.

LEGEND

- FOB — FIBRE OPTIC BREAK OUT TRAY
- ETH — ETHERNET SWITCH
  HIRSCHMANN = DCS NETWORKS
  CISCO = ALL OTHER NETWORKS
- FCS — YOKOGAWA FIELD CONTROL UNIT
- U/D xxxFCS4xx-NUxx U/D — YOKOGAWA NODE INTERFACE UNIT (DUAL OPTICAL ESB PORTS: U = UPLINK, D = DOWNLINK) TAG RELATED TO PARENT FCS
- GWY — COMMUNICATIONS GATEWAY
- MC — FIBRE TO CAT6 MEDIA CONVERTER
- xxx — EQUIPMENT OR VENDOR PACKAGE PANELS AS NOTED WITHIN BLOCK.
- EOL — MCC MODULE DOL INTELLIGENT ELECTRONIC DEVICE/OVERLOAD
- UPS — UNINTERRUPTIBLE POWER SUPPLY
- VSD — VSD - VARIABLE SPEED DRIVE (WALL MOUNTED)
- MULTI CORE FIBRE OPTIC CABLE OR DUPLEX PATCH LEADS
- CAT6 — CAT6 ETHERNET CABLE CONNECTION

DRG No.	REFERENCES
2000-F22-TER-IC-10101	SWITCHROOM MCC COMMUNICATIONS TERMINATION DRAWING SHEET 1 (& SHEET 2 -10102)
2000-F22-TER-IC-10011	SWITCHROOM DCS PANEL COMMUNICATIONS TERMINATION DIAGRAM
2000-F22-TER-IC-10001	SWITCHROOM COM RACK COMMUNICATIONS TERMINATION DIAGRAM SHEET 1 (TO SHEET 3 -10003)
2000-F00-BLK-IC-10001	OVERALL SITEWIDE FIBRE OPTIC COMMUNICATIONS BLOCK DIAGRAM
2000-F00-BLK-IC-10011	OVERALL SITEWIDE NETWORK ARCHITECTURE BLOCK DIAGRAM SHEET 1 (TO SHEET 5 -10015)
2000-F00-STD-EL-10001	GENERAL NOTES AND STANDARD DRAWINGS INDEX

REV	DATE	DESCRIPTION	DRAW	CHECK	DESIGN	TECH APP	PROJ APP
1	24NOV25	FAT REDLINED INCORPORATED - NO CHANGE					
0	11MAR25	APPROVED FOR CONSTRUCTION					

Approved [X]
Approved as Noted [ ]
Not Approved [ ]
For Information Only [ ]
Signed [redacted] Date 06/01/2026
ACCEPTANCE DOES NOT RELIEVE THE SUPPLIER / CONTRACTOR OF ITS RESPONSIBILITY OR LIABILITIES UNDER THE PURCHASE ORDER / CONTRACT

NORTHERN STAR RESOURCES LIMITED

PRIMERO
primero.com.au | DESIGN | CONSTRUCT | OPERATE
PRIMERO PROJECT NUMBER: 23517

INFORMATION AND REPRESENTATIONS ON THIS DRAWING ARE THE INTELLECTUAL PROPERTY OF PRIMERO UNLESS SPECIFICALLY IDENTIFIED OTHERWISE. ALL RIGHTS INCLUDING USE RESERVED

PROJECT: NORTHERN STAR RESOURCES LTD
KCGM GROWTH PROJECT

TITLE: CARBON TREATMENT & ELUTION
F22-SR-001 415V SWITCHROOM & N-IO PANELS
COMMUNICATIONS BLOCK DIAGRAM SHEET 1

SHEET	SCALE	DRG No.	REVISION
A1	NONE	2000-F22-BLK-IC-10001	1

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\IC\F22 - CIL4 CARBON TREAMENT & ELUTION\2000-F22-BLK-IC-10001.DWG 18DEC25 12:12PM HOTSEAT04