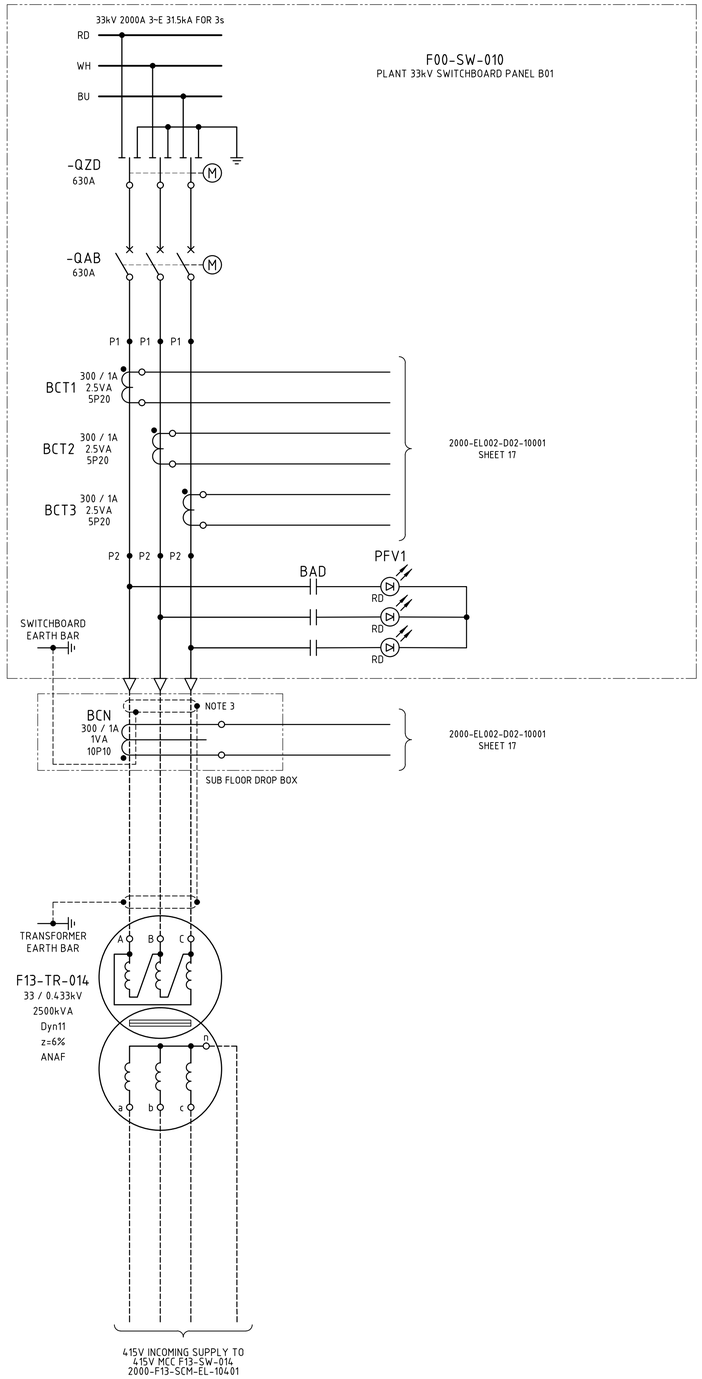


NOTES

1. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F00SW010-1200, UNLESS OTHERWISE NOTED.
2. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
3. IF THE CABLE SCREENS PASS THROUGH CORE BALANCE CT BEFORE BREAKING OUT THEN THE SCREEN EARTHS MUST BE BOUGHT BACK THROUGH THE CORE BALANCE CT AND TERMINATED TO EARTH.

LEGEND

- ⊗ 33kV SWITCHBOARD TERMINAL
- ◓ VSD TERMINAL
- ◒ FIELD TERMINAL
- ◑ DCS OR I/O TERMINAL
- ◧ MARSHALLING TERMINAL
- (x) DEVICE TERMINAL

PANEL B01

2000-F00-SCM-EL-10101_Rev2

F00-SW-010 - F13-TR-014 recycle crushing 415V MCC feeder - schematic diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\ELF00 - GENERAL FIMISTON SITE\2000-F00-SCM-EL-10101.DWG 09SEP26 11:46AM ROBINLAW