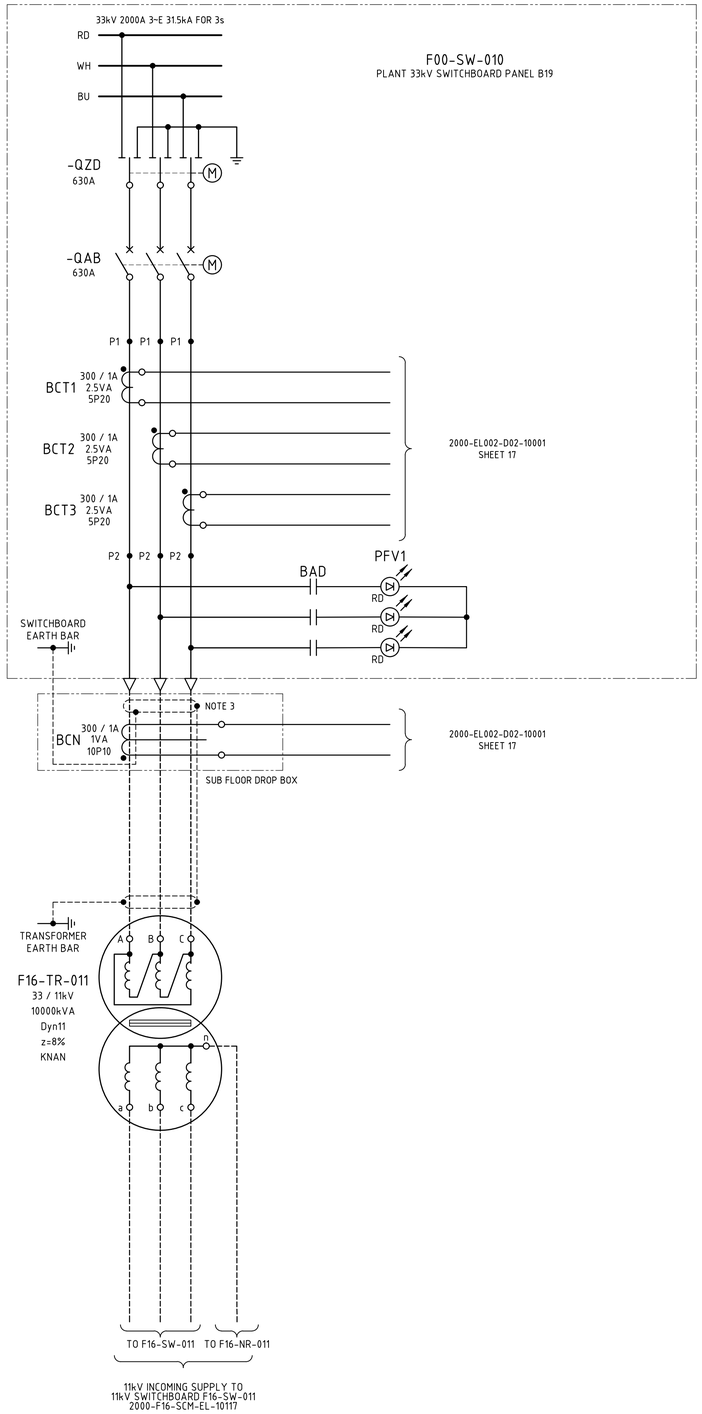


NOTES

1. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F00SW010-1200, UNLESS OTHERWISE NOTED.
2. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
3. IF THE CABLE SCREENS PASS THROUGH CORE BALANCE CT BEFORE BREAKING OUT THEN THE SCREEN EARTHS MUST BE BOUGHT BACK THROUGH THE CORE BALANCE CT AND TERMINATED TO EARTH.

LEGEND

- ⊗ 33kV SWITCHBOARD TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- DCS OR I/O TERMINAL
- MARSHALLING TERMINAL
- (x) DEVICE TERMINAL

PANEL B19

2000-F00-SCM-EL-10137_Rev1

F00-SW-010 - F16-TR-011 flotation 11kV switchboard feeder - schematic diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\235I7 KCGM GROWTH PROJECT\03 DELIVERABLES\ELF00 - GENERAL FIMISTON SITE\2000-F00-SCM-EL-10137.DWG 03JUN25 5:56AM SANDRA CULL