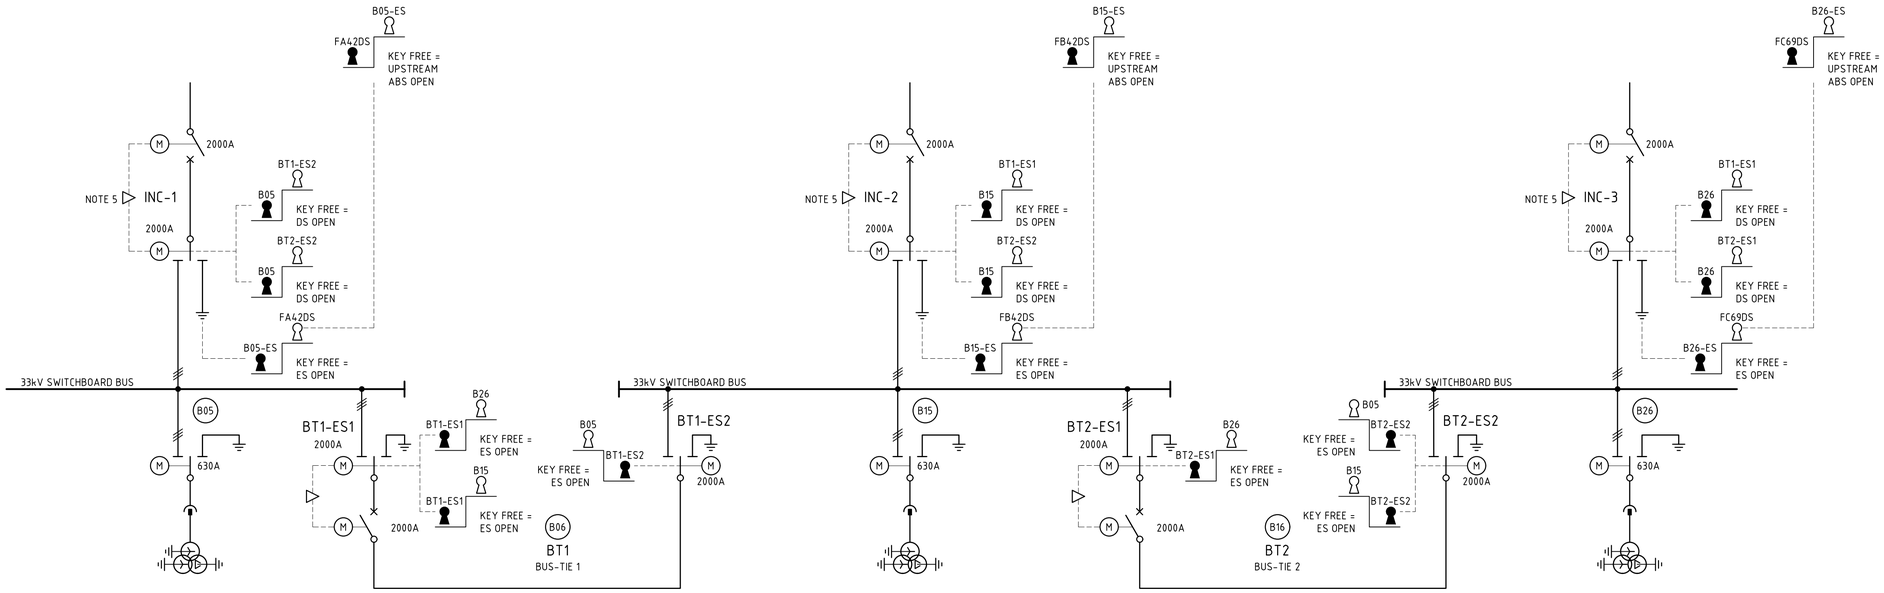


F00-SW-010 33kV BUS EARTH SWITCH KEY INTERLOCKING SCHEME
ALL INTERLOCKING IS SINGLE KEY - 1 OUT OF 2 - INTERLOCKING

NOTES

1. INCOMER 1 (INC-1) DISCONNECTOR SHALL BE KEY INTERLOCKED WITH BUS-TIE 1 (BT1) EARTH SWITCH BT1-ES2 AND BUS-TIE 2 (BT2) EARTH SWITCH BT2-ES2 SUCH THAT THESE EARTH SWITCHES MAY ONLY BE CLOSED WITH THE INCOMER 1 (INC-1) DISCONNECTOR LOCKED IN AN OPEN STATE .
2. INCOMER 2 (INC-2) DISCONNECTOR SHALL BE KEY INTERLOCKED WITH BUS-TIE 1 (BT1) EARTH SWITCH BT1-ES1 AND BUS-TIE 2 (BT2) EARTH SWITCH BT2-ES2 SUCH THAT THESE EARTH SWITCHES MAY ONLY BE CLOSED WITH THE INCOMER 2 (INC-2) DISCONNECTOR LOCKED IN AN OPEN STATE.
3. INCOMER 3 (INC-3) DISCONNECTOR SHALL BE KEY INTERLOCKED WITH BUS-TIE 1 (BT1) EARTH SWITCH BT1-ES1 AND BUS-TIE 2 (BT2) EARTH SWITCH BT2-ES1 SUCH THAT THESE EARTH SWITCHES MAY ONLY BE CLOSED WITH THE INCOMER 3 (INC-3) DISCONNECTOR LOCKED IN AN OPEN STATE.
4. EARTHED KEY CONDITION ONLY VALID WHEN THE EARTH SWITCH & CIRCUIT BREAKER ARE CLOSED.
5. 415V SWITCHROOM TRANSFORMER ROOM DOOR SHALL BE FORTRESS KEY INTERLOCKED (KEYED ALIKE) WITH THE UPSTREAM 33kV FEEDER EARTH SWITCH.
6. 33kV EARTH SWITCH SHALL BE FORTRESS KEY INTERLOCKED WITH THE VSD HV COMPARTMENT DOORS VIA THE KEY EXCHANGE BOX.
7. UPSTREAM 33kV OVERHEAD LINE POLE MOUNTED DISCONNECTOR SWITCH SHALL BE KEY INTERLOCKED WITH THE 33kV INCOMER EARTH SWITCH SUCH THAT THE UPSTREAM 33kV OVERHEAD LINE DISCONNECTOR SWITCH CAN ONLY BE CLOSED WHEN THE 33kV INCOMER EARTH SWITCH IS OPEN.
8. AN ELECTRICAL INTERLOCK PREVENTS OPERATION OF THE THREE-POSITION SWITCH WHEN THE CIRCUIT BREAKER IS CLOSED, TO PREVENT THE THREE-POSITION SWITCH FROM SWITCHING ON LOAD.
9. TRANSFORMER ENCLOSURE DOOR STATUS SHALL BE MONITORED BY THE DCS. OPENING OF DOOR SHALL RAMP STOP THE RELEVANT SWITCHROOM AREA AND OPEN THE UPSTREAM CB.

LEGEND

- MECHANICAL OR ELECTRICAL INTERLOCK DEVICE
- KEY FREE
- KEY CAPTIVE
- KEY EXCHANGE BOX

33kV FEEDER TO 415V SWITCHROOM
TRANSFORMER ACCESS DOOR
KEY INTERLOCKING SCHEME
ALL INTERLOCKING IS SINGLE KEY
1 OUT OF 2 INTERLOCKING

33kV FEEDER TO 11kV SWITCHBOARD
INCOMER EARTH SWITCH
KEY INTERLOCKING SCHEME
ALL INTERLOCKING IS SINGLE KEY
1 OUT OF 2 INTERLOCKING

33kV FEEDER TO HV VSD
MAIN PANEL ACCESS DOOR
KEY INTERLOCKING SCHEME

2000-F00-SLD-EL-10051_Rev2

General Fimiston site F00-SW-010 33kV switchboard electrical interlocking single line diagram sheet 1

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\235TI KCGM GROWTH PROJECT\03 DELIVERABLES\EL\F00 - GENERAL FIMISTON SITE\2000-F00-SLD-EL-10051.DWG 09SEP26 9:02AM ROBIN.LAW