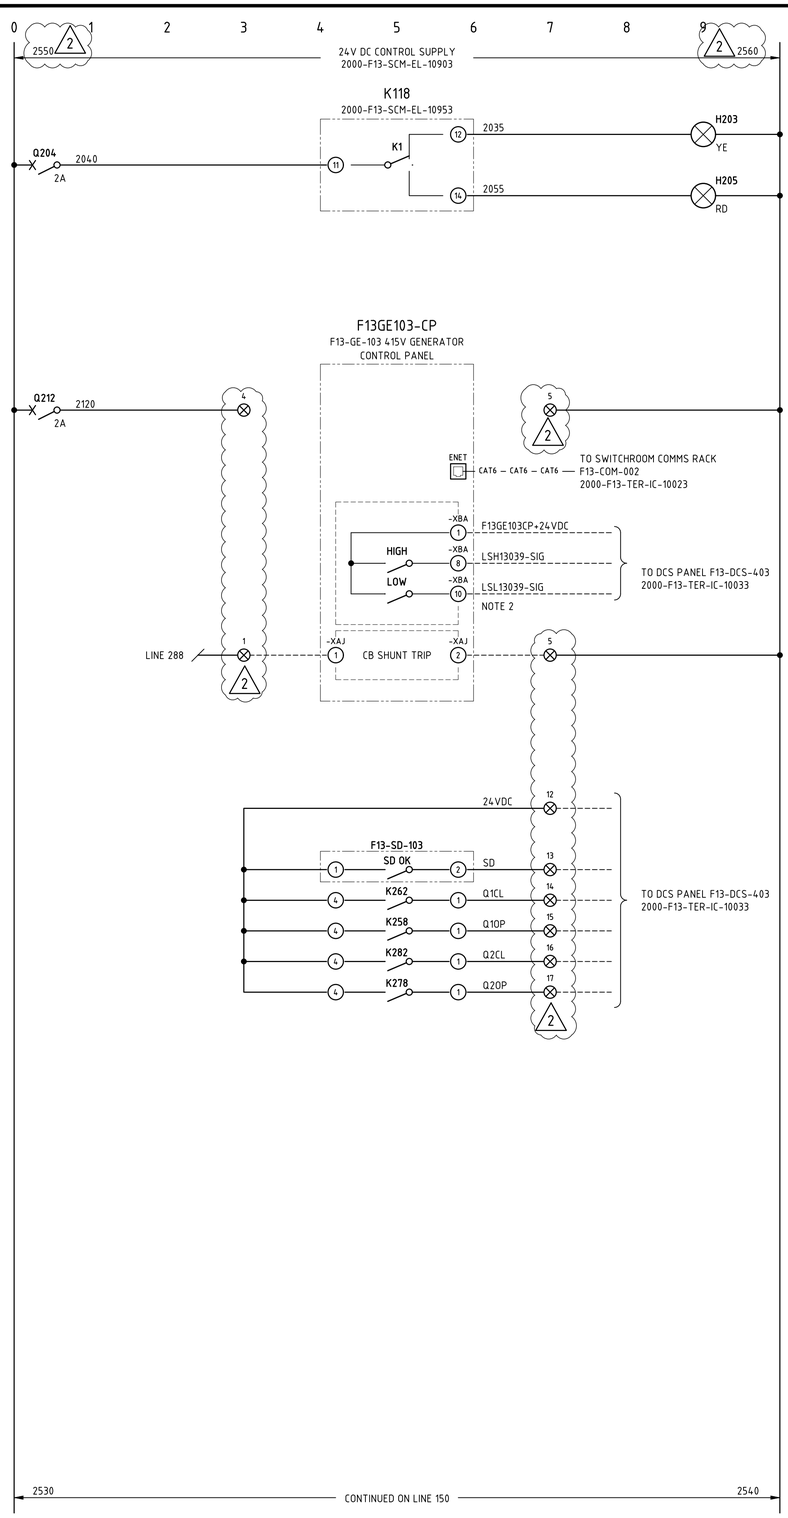


GENERATOR SUPPLY
PHASE RELAY STATUS

GENERATOR SUPPLY PHASE FAULT / NOT READY

GENERATOR SUPPLY PHASE HEALTHY / READY

GENERATOR CONTROL
2000-EL019-D04-10003

GENERATOR CONTROL PANEL 24VDC CONTROL POWER

DCS 24VDC CONTROL SUPPLY

GENERATOR FUEL LEVEL HIGH

GENERATOR FUEL LEVEL LOW

GENERATOR REMOTE SHUNT TRIP COMMAND

DCS 24VDC CONTROL SUPPLY


GENERATOR SUPPLY SURGE DIVERTER F13-SD-103 HEALTHY

MAINS SUPPLY CIRCUIT BREAKER CLOSED

MAINS SUPPLY CIRCUIT BREAKER OPENED

GENSET SUPPLY CIRCUIT BREAKER CLOSED

GENSET SUPPLY CIRCUIT BREAKER OPENED

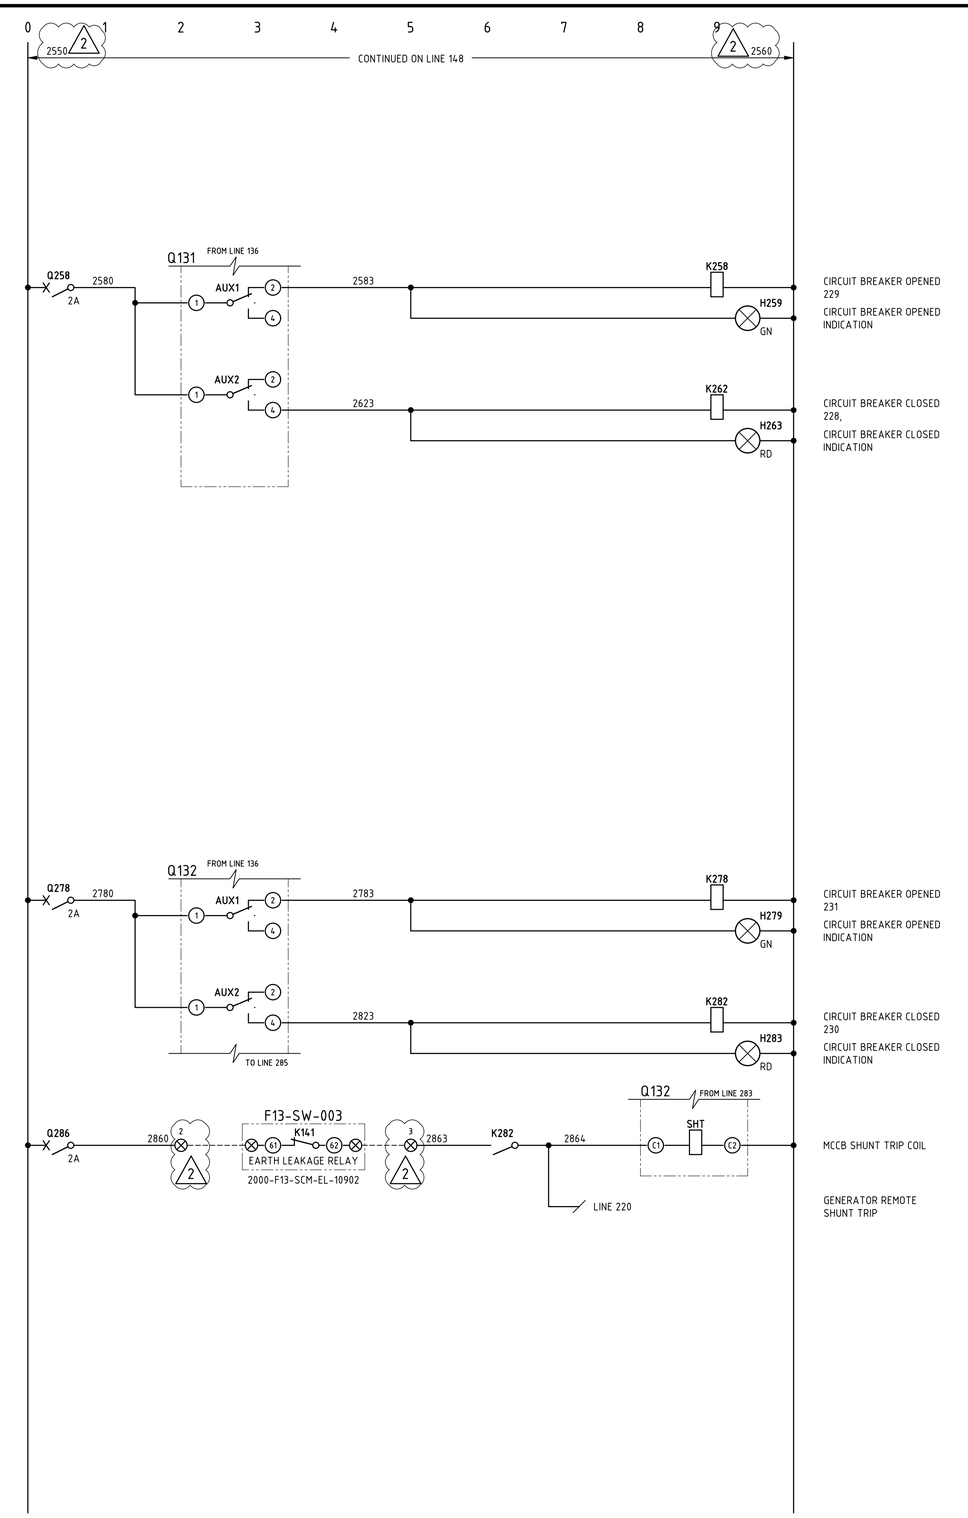

CIRCUIT BREAKER OPENED 229

CIRCUIT BREAKER OPENED INDICATION

CIRCUIT BREAKER CLOSED 228;

CIRCUIT BREAKER CLOSED INDICATION

CIRCUIT BREAKER OPENED 231

CIRCUIT BREAKER OPENED INDICATION

CIRCUIT BREAKER CLOSED 230

CIRCUIT BREAKER CLOSED INDICATION

MCCB SHUNT TRIP COIL

GENERATOR REMOTE SHUNT TRIP

NOTES

1. REFER TO NOTES ON SCHEMATIC DIAGRAM SHEET 1
2. GENERATOR FERRULES TO BE PREFIXED WITH F13GE103-×××

LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- MCC TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- DCS OR I/O TERMINAL
- MARSHALLING TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP cc = COLOUR

2000-F13-SCM-EL-10954_Rev2

F13-SW-103 - F13-SW-103 415V essential switchboard incomer - schematic diagram sheet 2

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\ELV\F13 - MILLING & CLASSIFICATION\2000-F13-SCM-EL-10954.DWG 25SEP25 12:52PM HOTSEAT04