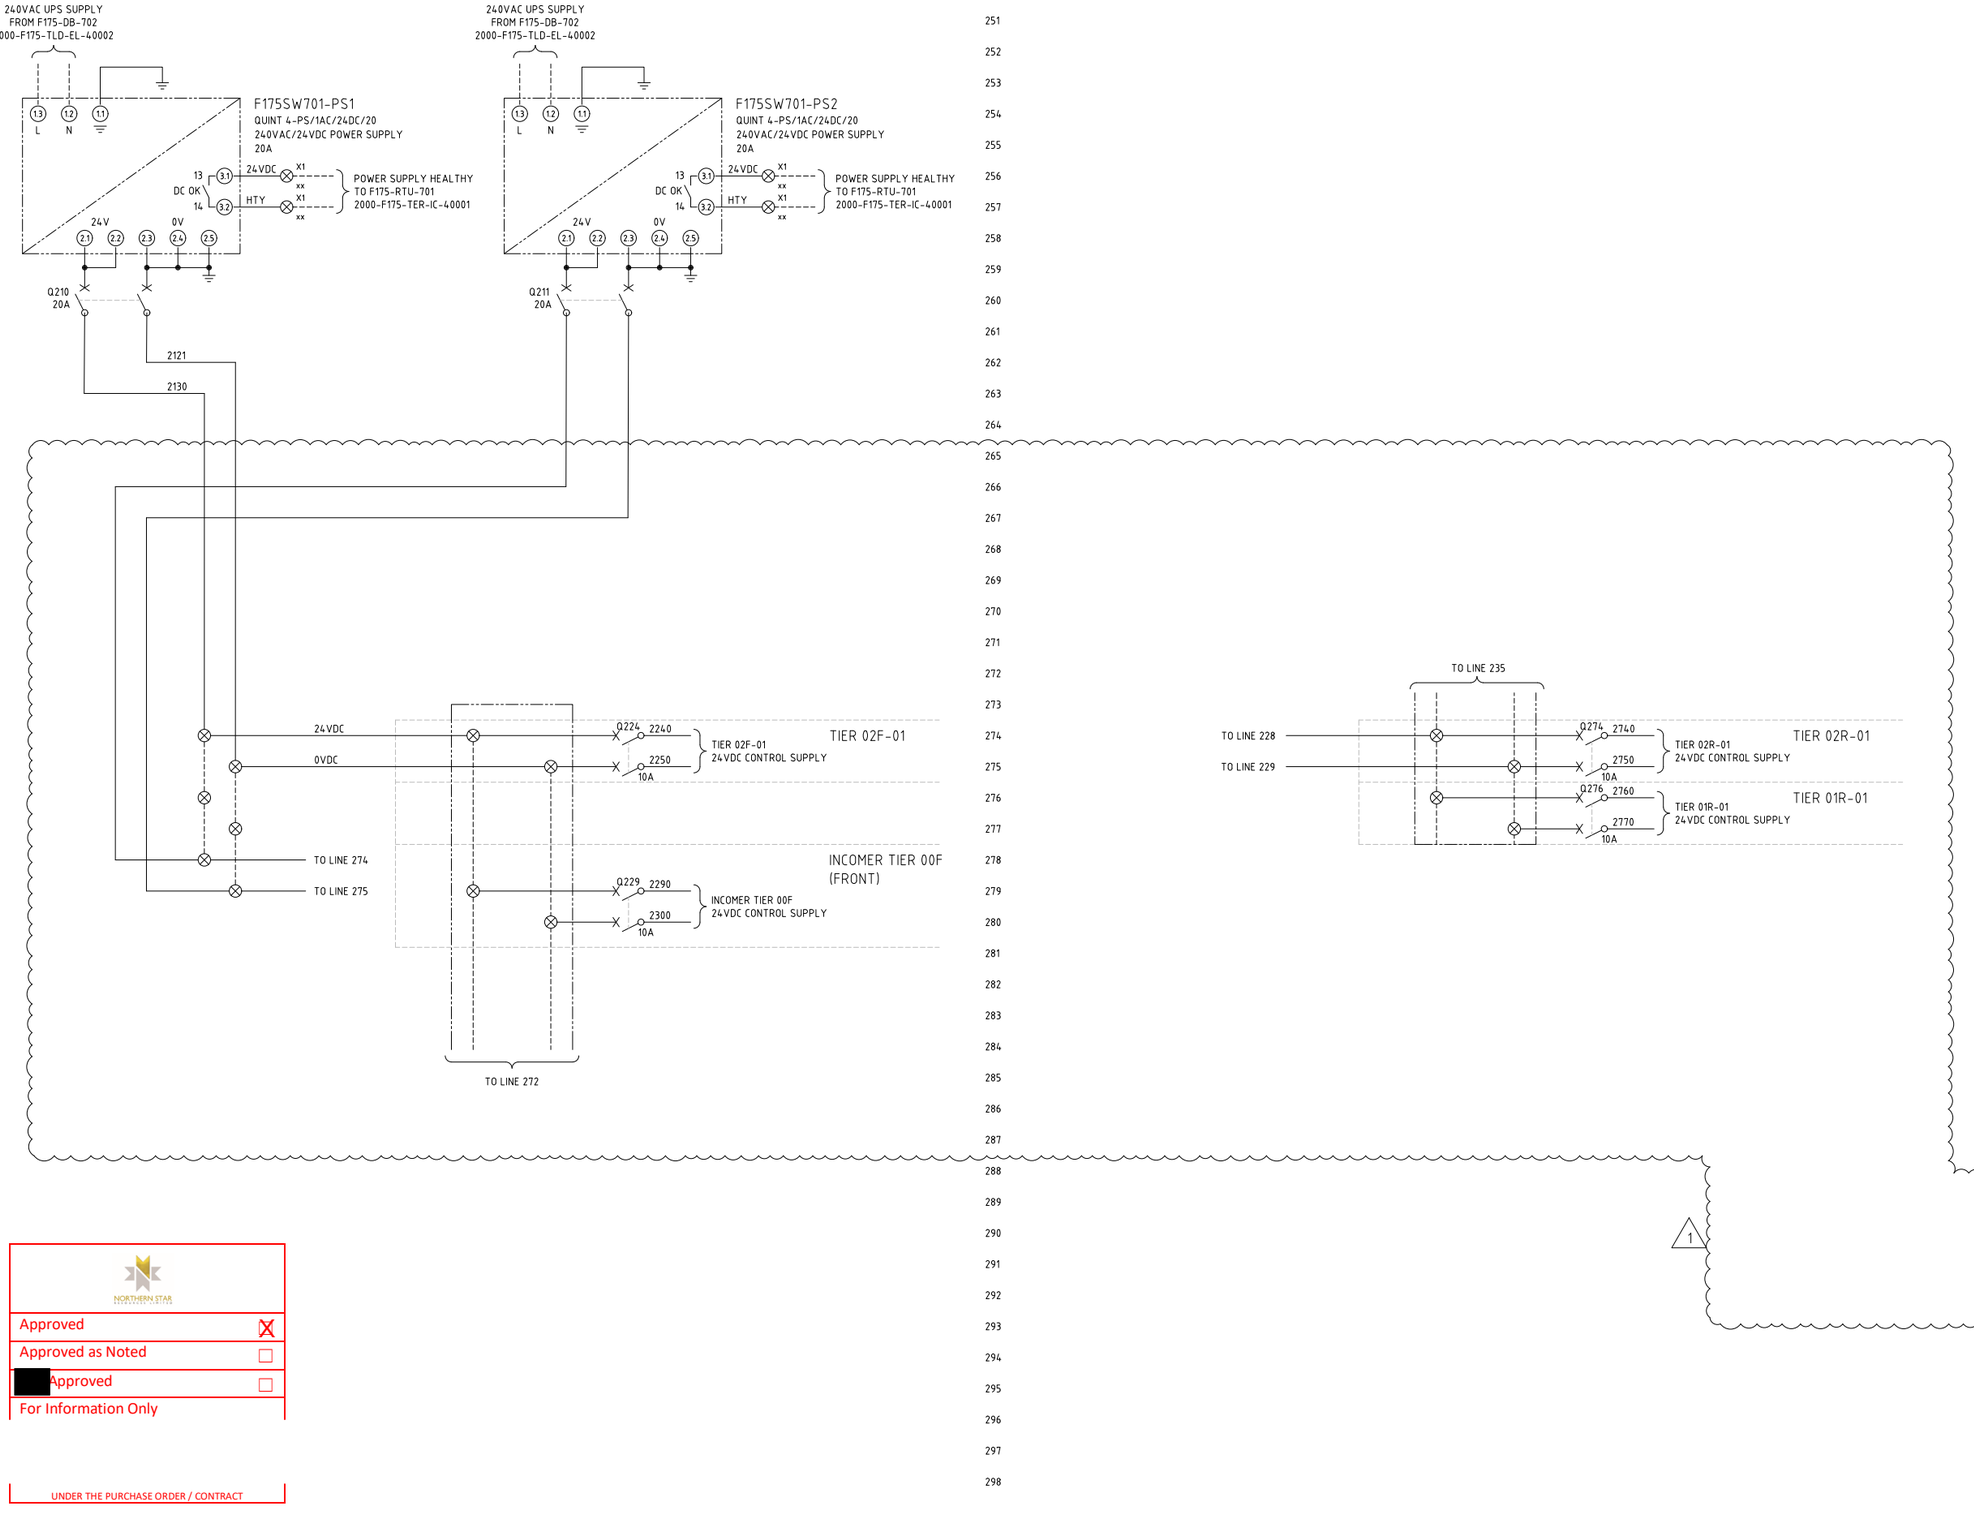



## NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F175SW701-1200.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.

## LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- MCC TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- DCS OR I/O TERMINAL
- MARSHALLING TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)

## TERMINATION LEGEND




NORTHERN STAR

| | |
|---|---|
| Approved | X |
| Approved as Noted | ☐ |
| [redacted]Approved | ☐ |
| For Information Only | |

UNDER THE PURCHASE ORDER / CONTRACT

APPROVED FOR CONSTRUCTION

# 2000-F175-SCM-EL-40004_Rev1

Southlakes booster station F175-SW-701 LV MCC
24VDC distribution schematic diagram