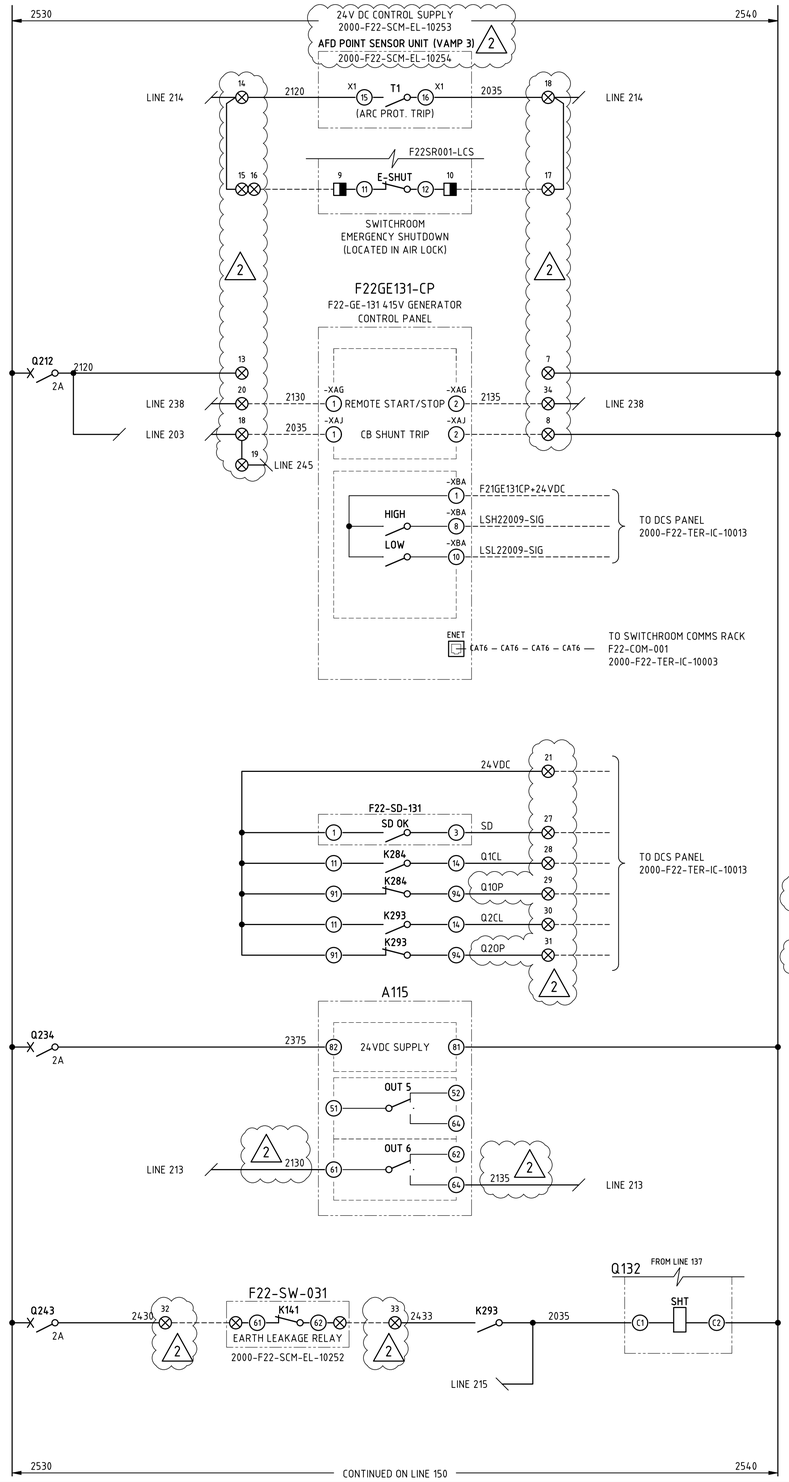


GENERATOR TRIP
CB SHUNT TRIP CIRCUIT

ARCH FLASH TRIP

SWITCHROOM EMERGENCY SHUTDOWN. RELAY ENERGISED IN NORMAL OPERATION. NORMALLY CLOSED CONTACT WILL BE OPEN

GENERATOR CONTROL
2000-EL019-D04-10002

GENERATOR CONTROL PANEL 24VDC CONTROL POWER

GENERATOR REMOTE START/STOP COMMAND

GENERATOR REMOTE SHUNT TRIP COMMAND

DCS 24VDC CONTROL SUPPLY

GENERATOR FUEL LEVEL HIGH

GENERATOR FUEL LEVEL LOW

DCS 24VDC CONTROL SUPPLY

GENERATOR SUPPLY SURGE DIVERTER HEALTHY

MAINS SUPPLY CIRCUIT BREAKER CLOSED

MAINS SUPPLY CIRCUIT BREAKER OPENED

GENSET SUPPLY CIRCUIT BREAKER CLOSED

GENSET SUPPLY CIRCUIT BREAKER OPENED


AUTO CHANGEOVER CONTROLLER 24VDC CONTROL SUPPLY

SPARE

GENERATOR REMOTE START/ STOP COMMAND

MCCB SHUNT TRIP COIL. EARTH LEAKAGE RELAY ENERGISED IN NORMAL OPERATION. NORMALLY CLOSED CONTACT WILL BE OPEN

GENERATOR REMOTE SHUNT TRIP

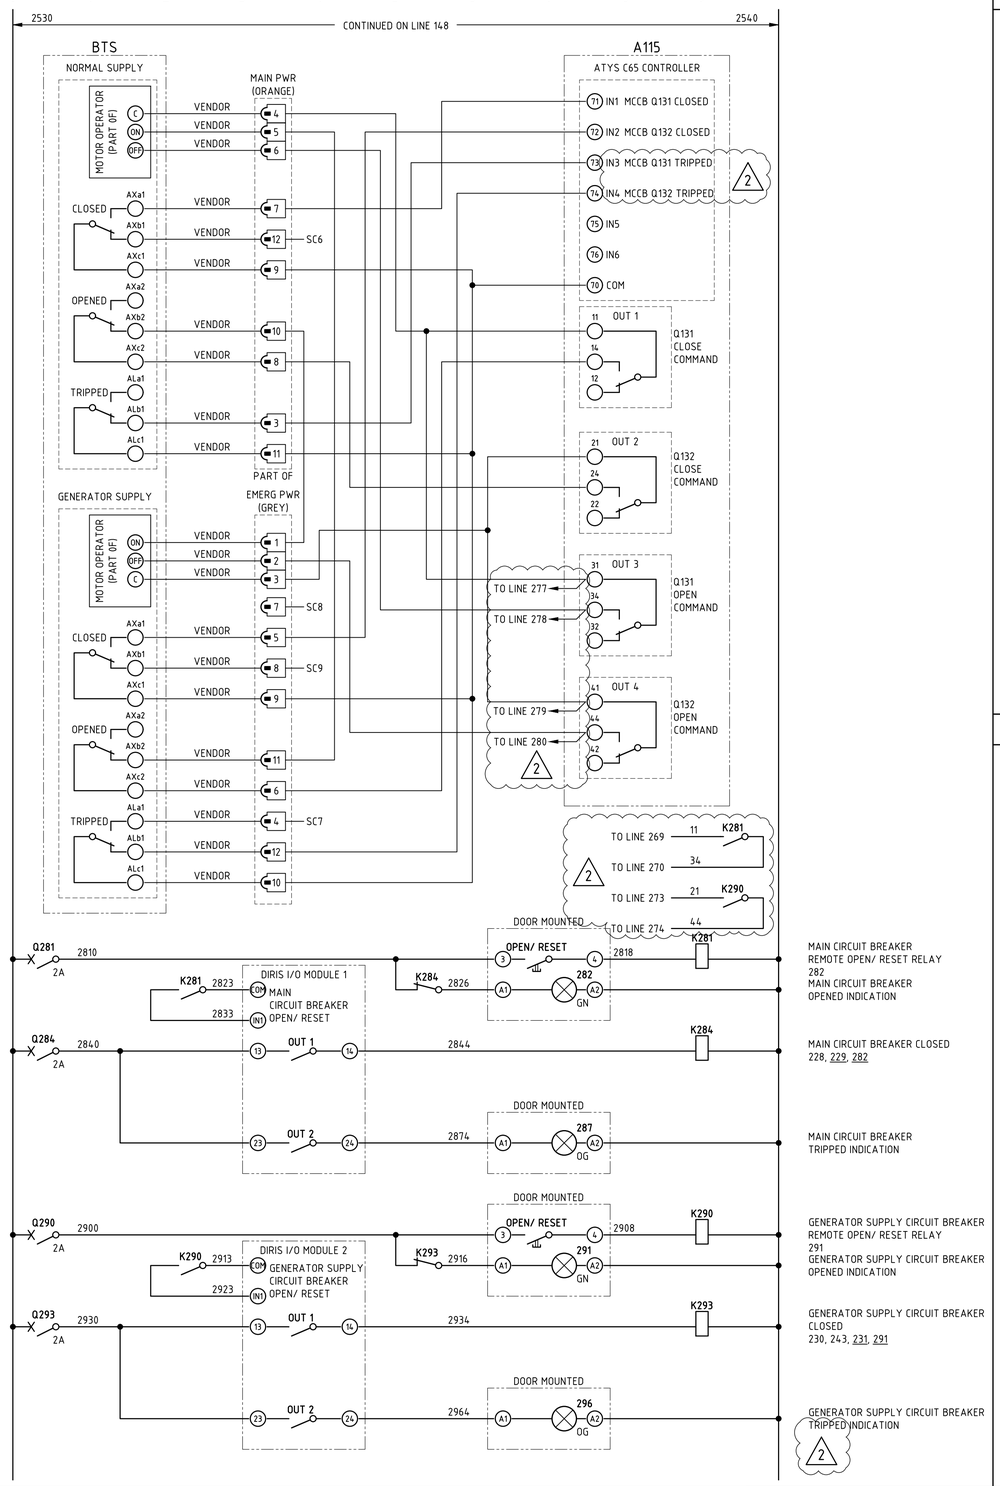

NOTES

1. REFER TO NOTES ON SCHEMATIC DIAGRAM SHEET 1

LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- MCC TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- DCS OR I/O TERMINAL
- MARSHALLING TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)

2000-F22-SCM-EL-10273_Rev2

F22-SW-131 - F22-SW-131 415V emergency switchboard incomer - schematic diagram sheet 2

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\235177 KCGM GROWTH PROJECT\03 DELIVERABLES\ELV\F22 - CIL4 CARBON TREAMENT & ELUTION\2000-F22-SCM-EL-10273.DWG 18DEC25 12:14PM HOTSEAT04