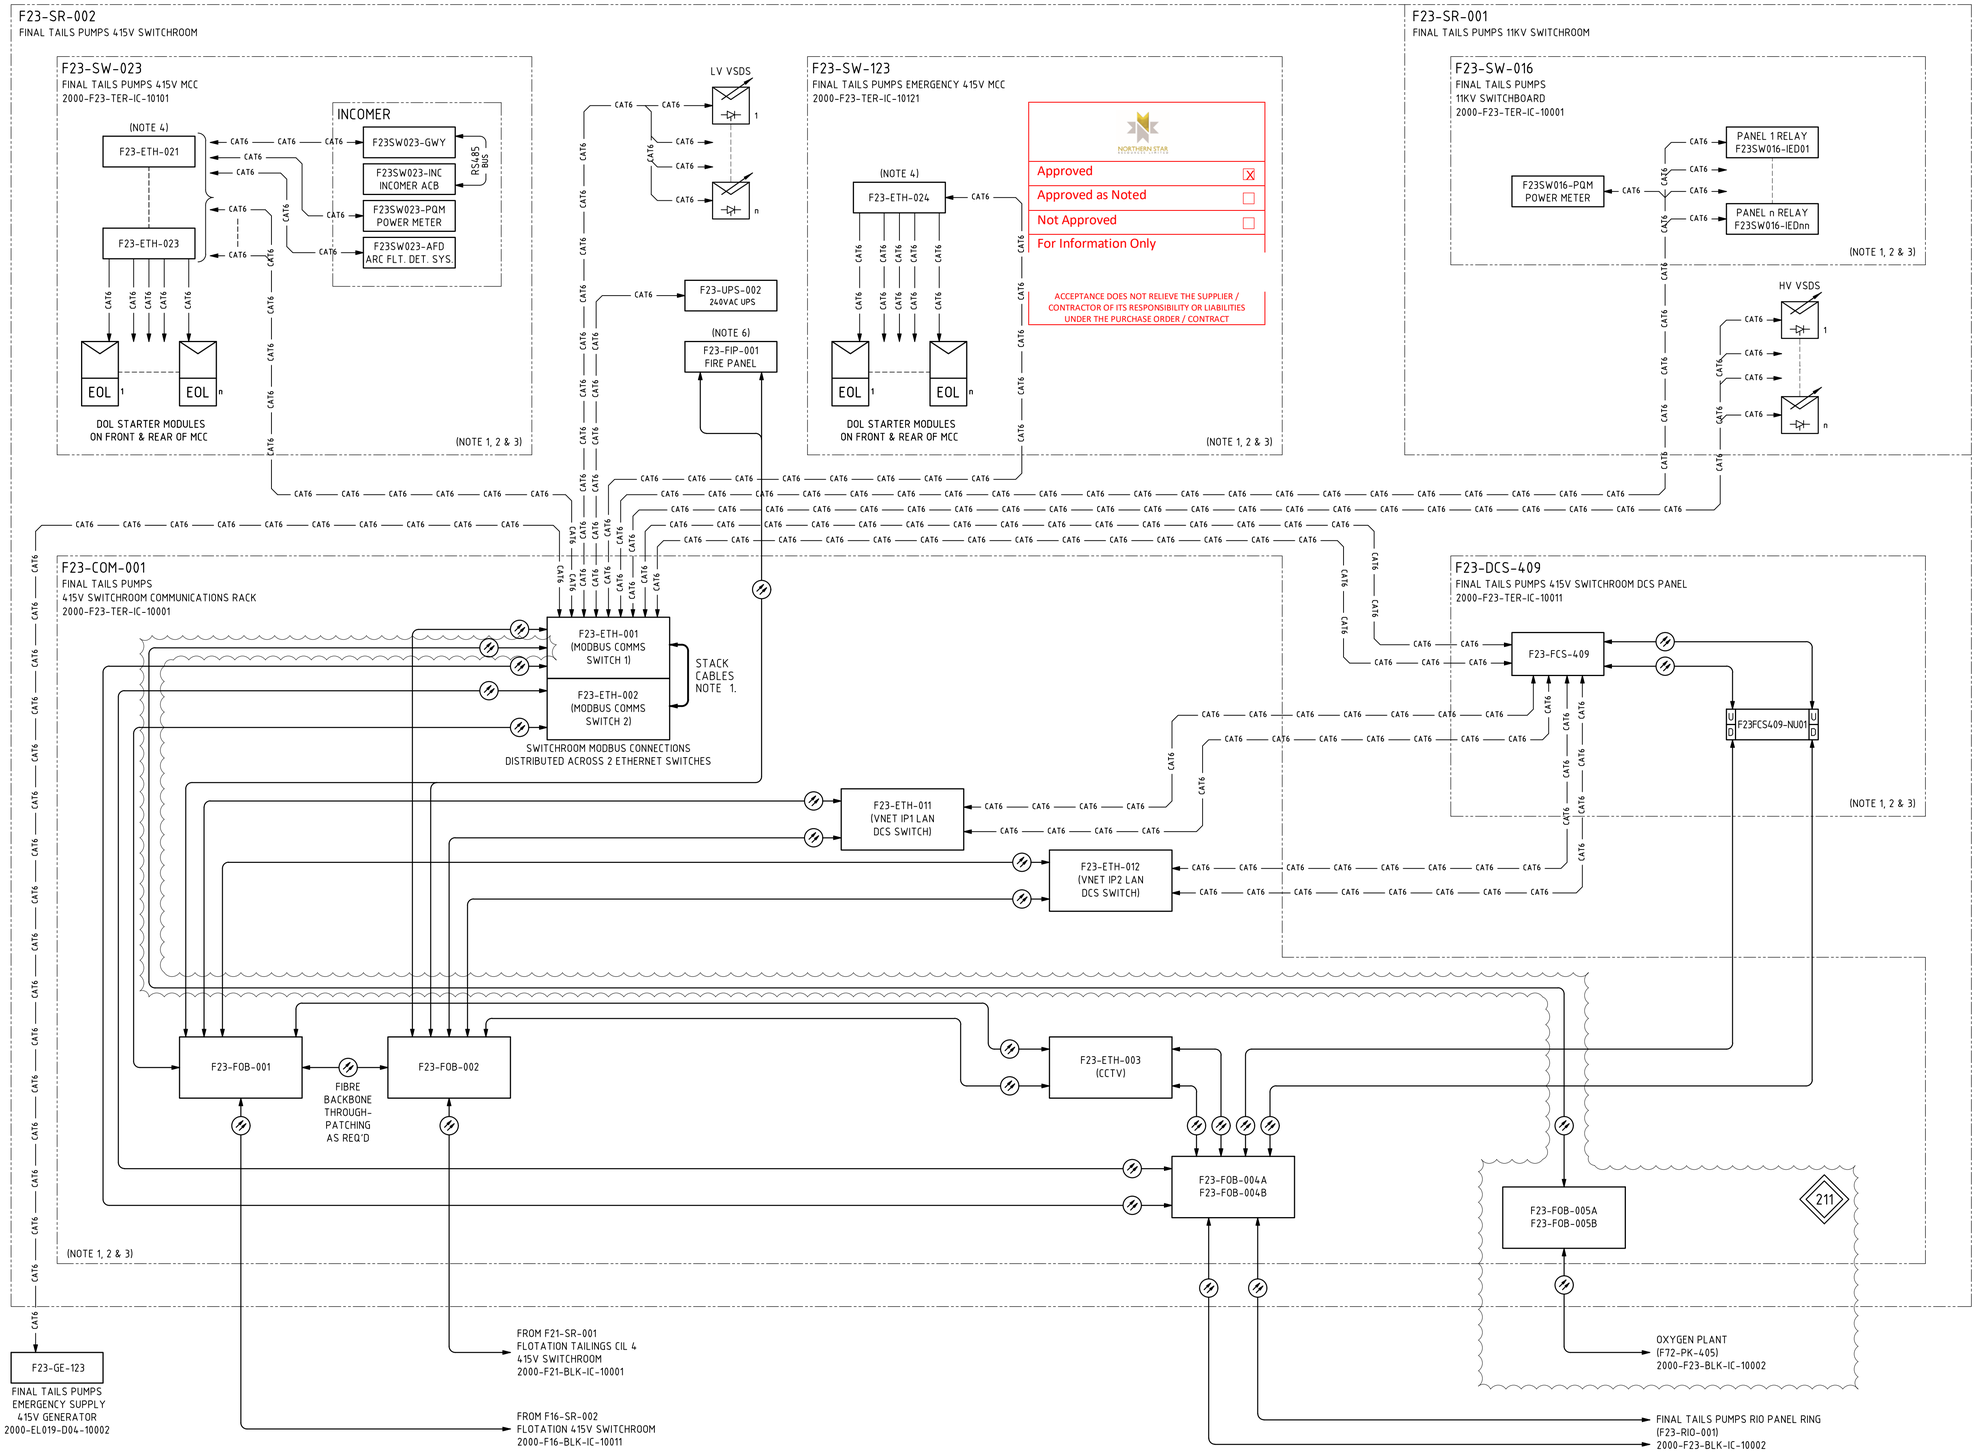


NOTES

1. FOR INTERNAL FIBRE OPTIC, CAT6 PATCH LEAD (& STACK CABLING IN SWITCHROOM COMMS RACKS) EQUIPMENT CONNECTION DETAILS REFER TO SPECIFIC TERMINATION DIAGRAMS.
2. REFER TO SPECIFIC COMMUNICATIONS TERMINATION DRAWINGS FOR EXTERNAL EQUIPMENT CONNECTION DETAIL.
3. COM RACK, DCS PANEL, RIO PANEL, MCC & SWITCHBOARD HARDWARE/INTERCONNECTIONS (E.G. NIO NODE) & INTER-FOBOT PATCHING NOT SHOWN FOR CLARITY. REFER TO SPECIFIC COMMUNICATIONS TERMINATION DRGS FOR DETAIL.
4. ETHERNET SWITCHES LOCATED IN CABLE ZONE OF 415VAC MCC, FRONT & BACK - AS REQUIRED.
5. REMOTE CCTV CAMERA REQUIRES PRE-TERMINATED FIBRE OPTIC CABLE WITH MEDIA CONVERSION EQUIPMENT AT THE RIO PANEL AND REMOTE CCTV CAMERA JUNCTION BOX.
6. FIRE INDICATION PANELS SHALL BE ON A FIBRE OPTIC RING AND WILL TIE-IN TO EXISTING MAIN PLANT FIRE ANNUNCIATOR PANEL. FIP CONNECTS TO FIBRE INFRASTRUCTURE VIA 2 FIBRE OPTIC PATCH CABLES.

HOLD REGISTER No./DETAIL

211. F.O OXYGEN PLANT VENDOR TIE IN DETAILS TBC

LEGEND

- FOB — FIBRE OPTIC BREAK OUT TRAY
- ETH — ETHERNET SWITCH
  HIRSCHMANN = DCS NETWORKS
  CISCO = ALL OTHER NETWORKS
- FCS — YOKOGAWA
  FIELD CONTROL UNIT
- U D xxxFCS4xx-NUxx U D — YOKOGAWA NODE INTERFACE UNIT (DUAL OPTICAL ESB PORTS: U = UPLINK, D = DOWNLINK) TAG RELATED TO PARENT FCS
- GWY — COMMUNICATIONS GATEWAY
- MC — FIBRE TO CAT6
  MEDIA CONVERTER
- xxx — EQUIPMENT OR VENDOR PACKAGE PANELS AS NOTED WITHIN BLOCK.
- EOL — MCC MODULE
  DOL INTELLIGENT ELECTRONIC DEVICE/OVERLOAD
- UPS — UNINTERRUPTIBLE POWER SUPPLY
- VSD - VARIABLE SPEED DRIVE (WALL MOUNTED)
- MULTI CORE FIBRE OPTIC CABLE OR DUPLEX PATCH LEADS
- CAT6 — CAT6 ETHERNET CABLE CONNECTION

2000-F23-BLK-IC-10001_Rev0

F23-SR-001/F23-SR-002 switchrooms & N-IO panels - communications block diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\235171 KCGM GROWTH PROJECT\03 DELIVERABLES\IC\F23 - FINAL TAILINGS HANDLING & STORAGE\2000-F23-BLK-IC-10001.DWG 13MAR25 1:46PM ANTONY.DECAPRIO