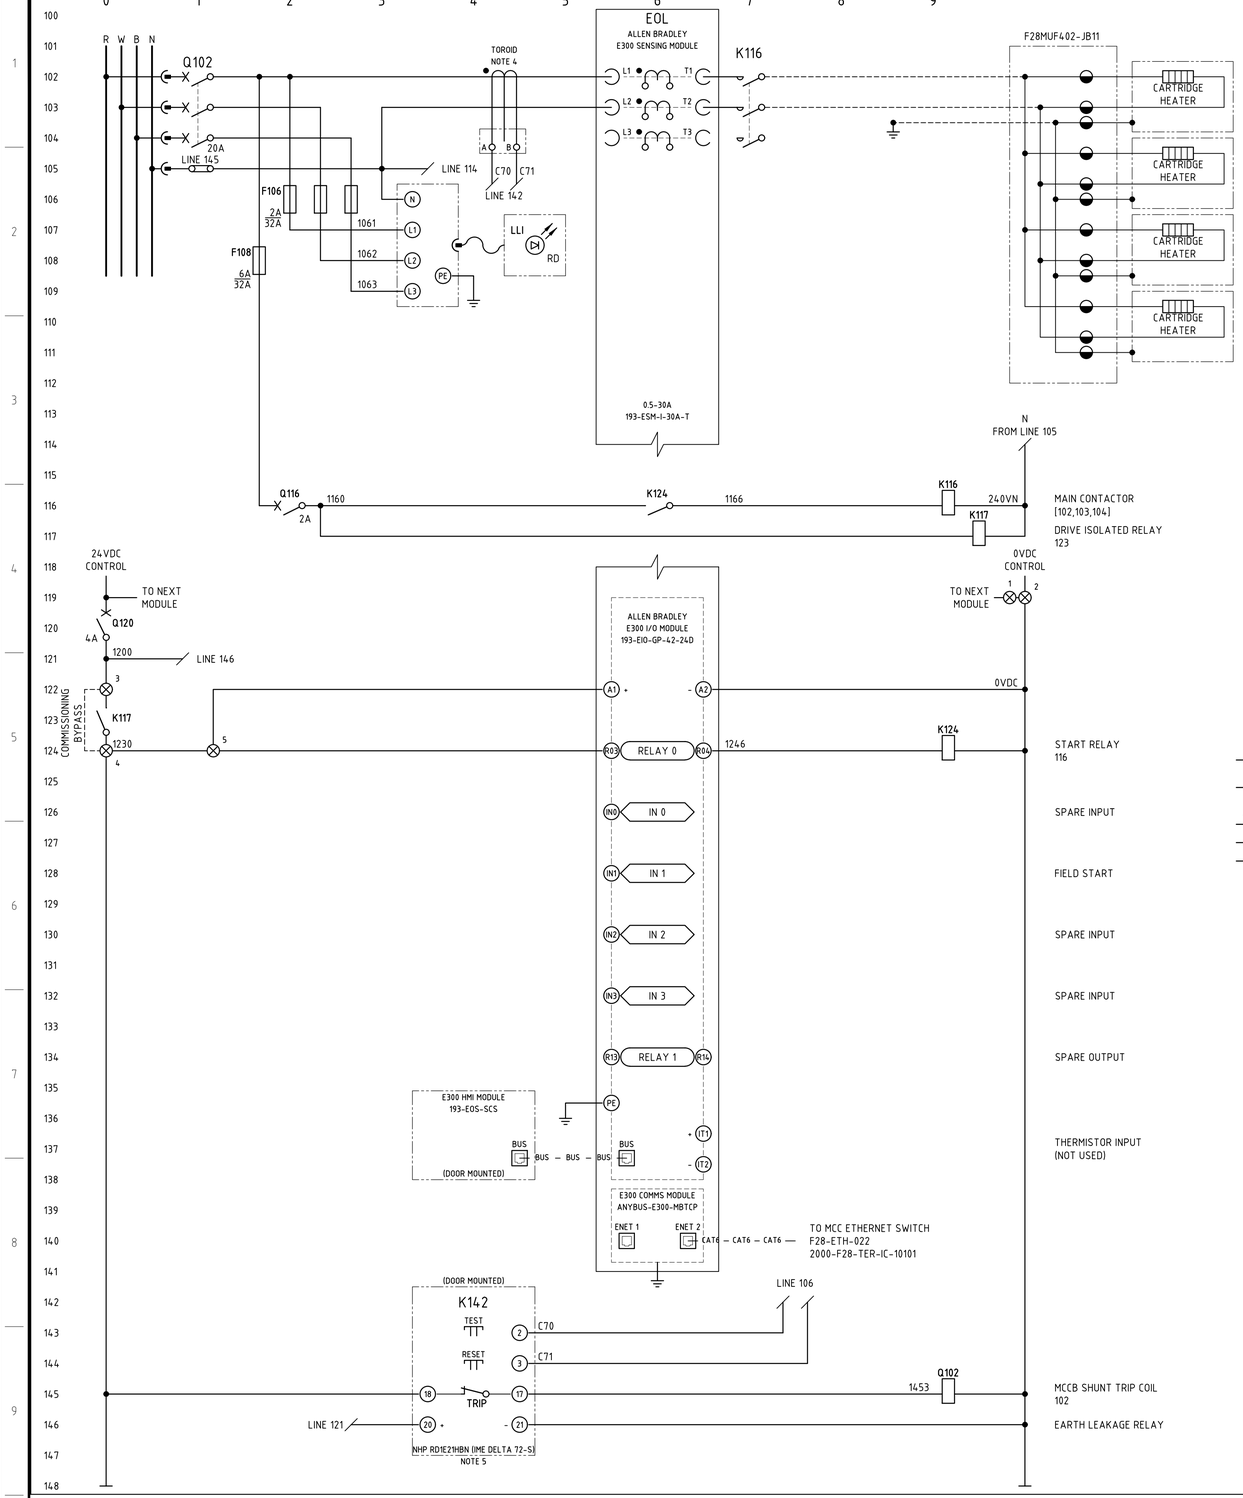


F28-HT-482
UFG MILL 2
GEARBOX OLS
HEATERS
3.2 kW

CABLE ZONE
24VDC TERMINALS

24VDC LOOPED POWER
NEXT MODULE
PREV MODULE

Q120	4A	F12SW001-2290
1		F12SW001-2300
2		F12SW001-2300
3		F28HT482-1200
4		F28HT482-1230
5		
6		
7		
8		
9		
10		
11		
12		
13	⏚	EARTH

COMMISSIONING BYPASS

NOTE 2

NOTES


1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F28HT482-1200, UNLESS OTHERWISE NOTED.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGB2
   IN:70A IΔN MIN:0.03A TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR. RELAY ENERGISED (NORMALLY CLOSED CONTACT OPEN) IN NORMAL OPERATION.

LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- ⊗ — MCC TERMINAL
- ◕ — VSD TERMINAL
- ◒ — FIELD TERMINAL
- ◑ — DCS OR I/O TERMINAL
- ◧ — MARSHALLING TERMINAL
- (x) — DEVICE TERMINAL
- ⊗cc — INDICATION LAMP, cc = COLOUR

TERMINATION LEGEND

Q120	4A	F28SW009-2xxx
1		F28SW009-2xxx
2		F28SW009-2xxx
3		F28HT482-1200
4		F28HT482-1230
5		F28HT482-1230
6	⏚	EARTH

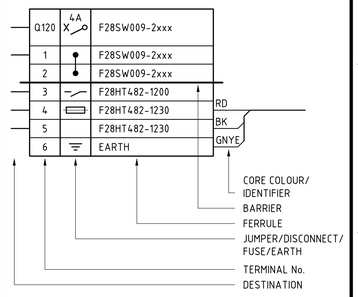

2000-F28-SCM-EL-10217_Rev2

F28-SW-009 - F28-HT-482 UFG mill 2 gearbox ols heaters - schematic and termination diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\ELV\F28 - ULTRAFINE GRINDING 2 & 3\2000-F28-SCM-EL-10217.DWG 25SEP26 2:53PM ROBINLAW