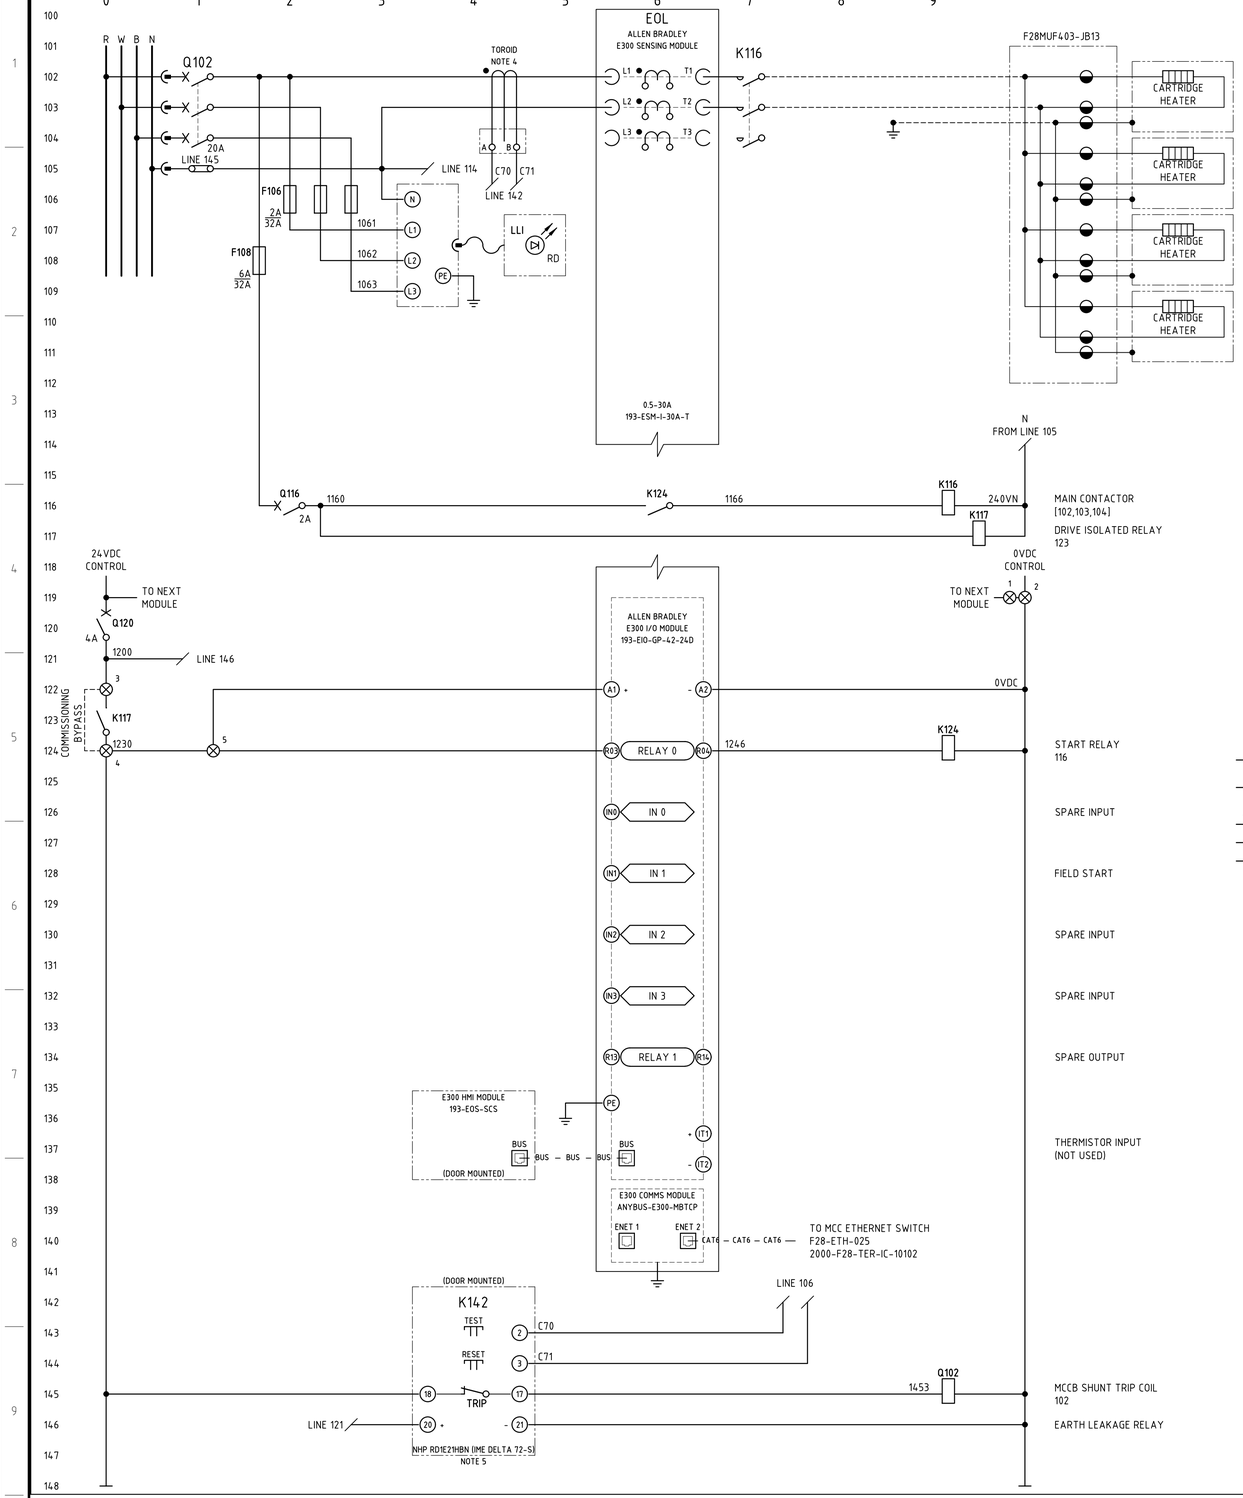


F28-HT-484
UFG MILL 3
BEARING OLS
HEATERS
2.4 kW

CABLE ZONE
24VDC TERMINALS

24VDC LOOPED POWER
NEXT MODULE | PREV MODULE

Q120	4A	F12SW001-2720
1		F12SW001-2730
2		F12SW001-2730
3		F28HT484-1200
4		F28HT484-1230
5		
6		
7		
8		
9		
10		
11		
12		
13	⏚	EARTH

COMMISSIONING BYPASS

NOTE 2


NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F28HT484-1200, UNLESS OTHERWISE NOTED.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGB2
   IN:70A IΔN MIN:0.03A TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR. RELAY ENERGISED (NORMALLY CLOSED CONTACT OPEN) IN NORMAL OPERATION.

LEGEND

00/01/00	DCS DIGITAL INPUT
00/02/00	DCS DIGITAL OUTPUT
⊗	MCC TERMINAL
◓	VSD TERMINAL
◒	FIELD TERMINAL
◑	DCS OR I/O TERMINAL
◧	MARSHALLING TERMINAL
⊗ x	DEVICE TERMINAL
⊗ cc	INDICATION LAMP cc = COLOUR

TERMINATION LEGEND

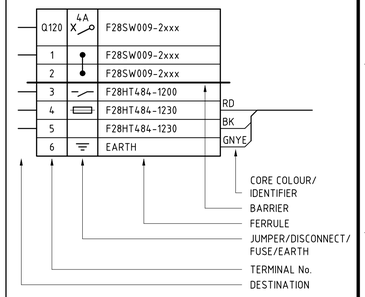

2000-F28-SCM-EL-10218_Rev2

F28-SW-009 - F28-HT-484 UFG mill 3 bearing ols heater - schematic and termination diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\ELV\F28 - ULTRAFINE GRINDING 2 & 3\2000-F28-SCM-EL-10218.DWG 25SEP26 2:48PM ROBIN.LAW