


240VAC UPS SUPPLY
FROM 30-DB-62
2000-F30-TLD-EL-10001



F30SW401-PS
QUINT 4-PS/1AC/24DC/40
240VAC/24VDC POWER SUPPLY
40A

Q210
40A

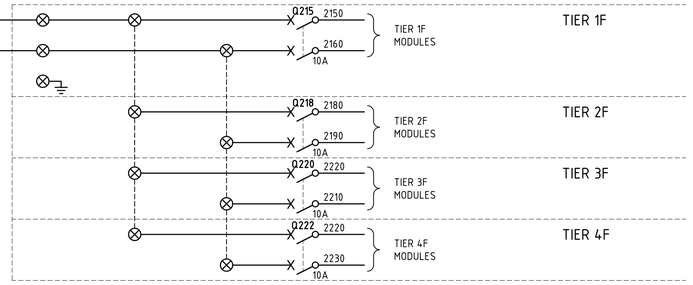

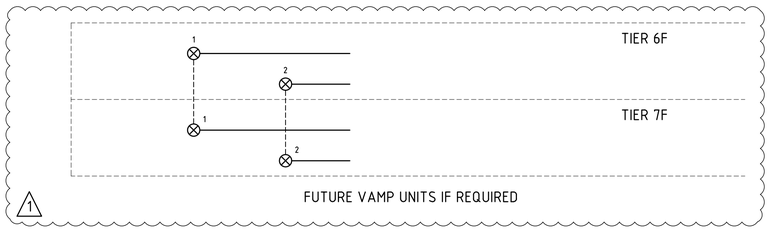


NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F30SW401PS-1200, UNLESS OTHERWISE NOTED.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.

LEGEND



TERMINATION LEGEND

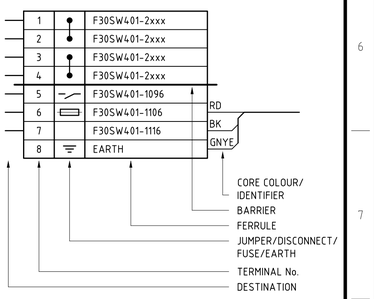

2000-F30-SCM-EL-10034_Rev1

Substation no. 68 MCC F30-SW-401 F30-SW-401
24VDC distribution schematic diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\EL\F30 - CIL2_3 & CONCENTRATE THICKENING\2000-F30-SCM-EL-10034.DWG 19NOV25 11:45AM HOTSEAT04