DISTRIBUTION BOARD NO. 6368A

415V 3 PHASE 50Hz 200A
FAULT LEVEL 18kA FOR 0.3 sec.
POSITIONED IN SUB STATION No.68

MAIN CIRCUIT BREAKER
415V SUPPLY FROM CIRCUIT BREAKER POSITIONED IN 30-SW-62 IN TIER 6R/4
REF DRG 101L1058-002 2000-F30-SLD-EL-10102

L1 L2 L3 N

200A

EARTH BAR EARTH BAR
NEUTRAL BAR NEUTRAL BAR


30-PP-62A TAILINGS DISPOSAL PUMP HEATER	6A	R1		R2	16A 30mA	EAST SPLIT A/C/ N36 **(NOTE 3.)**
30-PP-62B TAILINGS DISPOSAL PUMP HEATER	6A	W1		W2	16A 30mA	EAST SPLIT A/C N37 **(NOTE 3.)**
30-PP-62C TAILINGS DISPOSAL PUMP HEATER	6A	B1		B2	32A	UNKNOWN **(NOTE 3.)**
		R3		R4	63A	TRANSPORTABLE OFFICES **(NOTE 3.)**
		W3		W4		
		B3		B4		
SILT POND 3-PHASE OUTLET **(NOTE 3.)**	63A 30mA	R5		R6	16A	A/C 1 **(NOTE 3.)**
		W5		W6		
		B5		B6		
3 POLE RCD MODULE FOR CCT RWB5 **(NOTE 3.)**		R7		R8	16A	A/C 2 **(NOTE 3.)**
		W7		W8		
		B7		B8		
SILT TRAP & TRANSFER TANK GPOs **(NOTE 3.)**	20A 30mA	R9		R10	20A	TR62 COOLING FANS **(NOTE 3.)**
		W9		W10		
		B9		B10		
		R11		R12	20A	TR63 COOLING FANS **(NOTE 3.)**
		W11		W12		
		B11		B12		
TOP OF SCRUBBER 3-PHASE OUTLET **(NOTE 3.)**	32A 30mA	R13	NOTE C.1.	R14	20A 30mA	F72-PK-407 ANTISCALANT DOSING SKID 2 REF. DRG. 2000-ME069-xxx-xxxxx
		W13	NOTE C.1.	W14	20A 30mA	F72-PK-408 ANTISCALANT DOSING SKID 3 REF. DRG. 2000-ME069-xxx-xxxxx
		B13	NOTE C.1.	B14	20A 30mA	F72-PP-709 ANTISCALANT DOSING SKID 4 REF. DRG. 2000-ME069-xxx-xxxxx
2 POLE RCD MODULE FOR CCT RWB13 **(NOTE 3.)**		R15	NOTE C.1.	R16	32A 30mA	TBA - RESERVED FOR GROWTH PROJECT REF. DRG. TBA
		W15	NOTE C.1.	W16	32A 30mA	TBA - RESERVED FOR GROWTH PROJECT REF. DRG. TBA
		B15		B16		
CARBON SAFETY SCREEN GPOs **(NOTE 3.)**	32A 30mA	R17		R18		
		W17		W18		
		B17		B18		
2 POLE RCD MODULE FOR CCT RWB17 **(NOTE 3.)**		R19		R20		
		W19		W20		
		B19		B20	16A 30mA	KILN SCRUBBER GPOs **(NOTE 3.)**

(NOTE 3.)

LEGEND

LOCATION

SUB STATION 68
30-DB-68
NORMAL SUPPLY

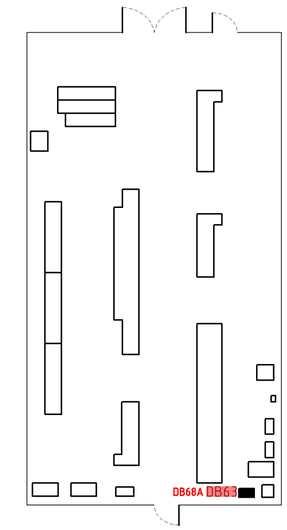

NOTES

1. ALL EARTH LEAKAGE CIRCUIT BREAKERS FOR GPO CIRCUITS SHALL HAVE 30mA SENSITIVITY.
2. ALL SMALL POWER CABLES SHALL BE 2.5mm2 Cu PVC UNLESS NOTED OTHERWISE.
3. EXISTING INSTALL BY OTHERS, CIRCUIT DESCRIPTIONS ARE AS PER MARKINGS / LABELS ON THE ESCUTCHEON AS CHECKED NOVEMBER 2023. THESE HAVE NOT BEEN VERIFIED FOR ACCURACY.

LEGEND
- STAGE 1 - NEW
- STAGE 1 - REMOVE
- STAGE 1 - DECOMMISSIONED (OTHERS)
- STAGE 2 - NEW
- STAGE 2 - REMOVE
- STAGE 2 - DECOMMISSIONED (OTHERS)

KCGM GROWTH PROJECT CONSTRUCTION NOTES

C.1. INSTALL 5OFF NEW RCBO's INTO DISTRIBUTION BOARD SPARE POLES: R14, W14, B14, R16, W16.

KCGM GROWTH PROJECT
DRAWING NO.
2000-F30-TLD-EL-10003

REV	DATE	DESCRIPTION	CHECK	TECH APP
0	11/06/25	APPROVED FOR CONSTRUCTION		MB/DM

2000-F30-TLD-EL-10003_Rev0

Carbon in leach (CIL3) 415V small power normal d.b. no. 68a power schematic