
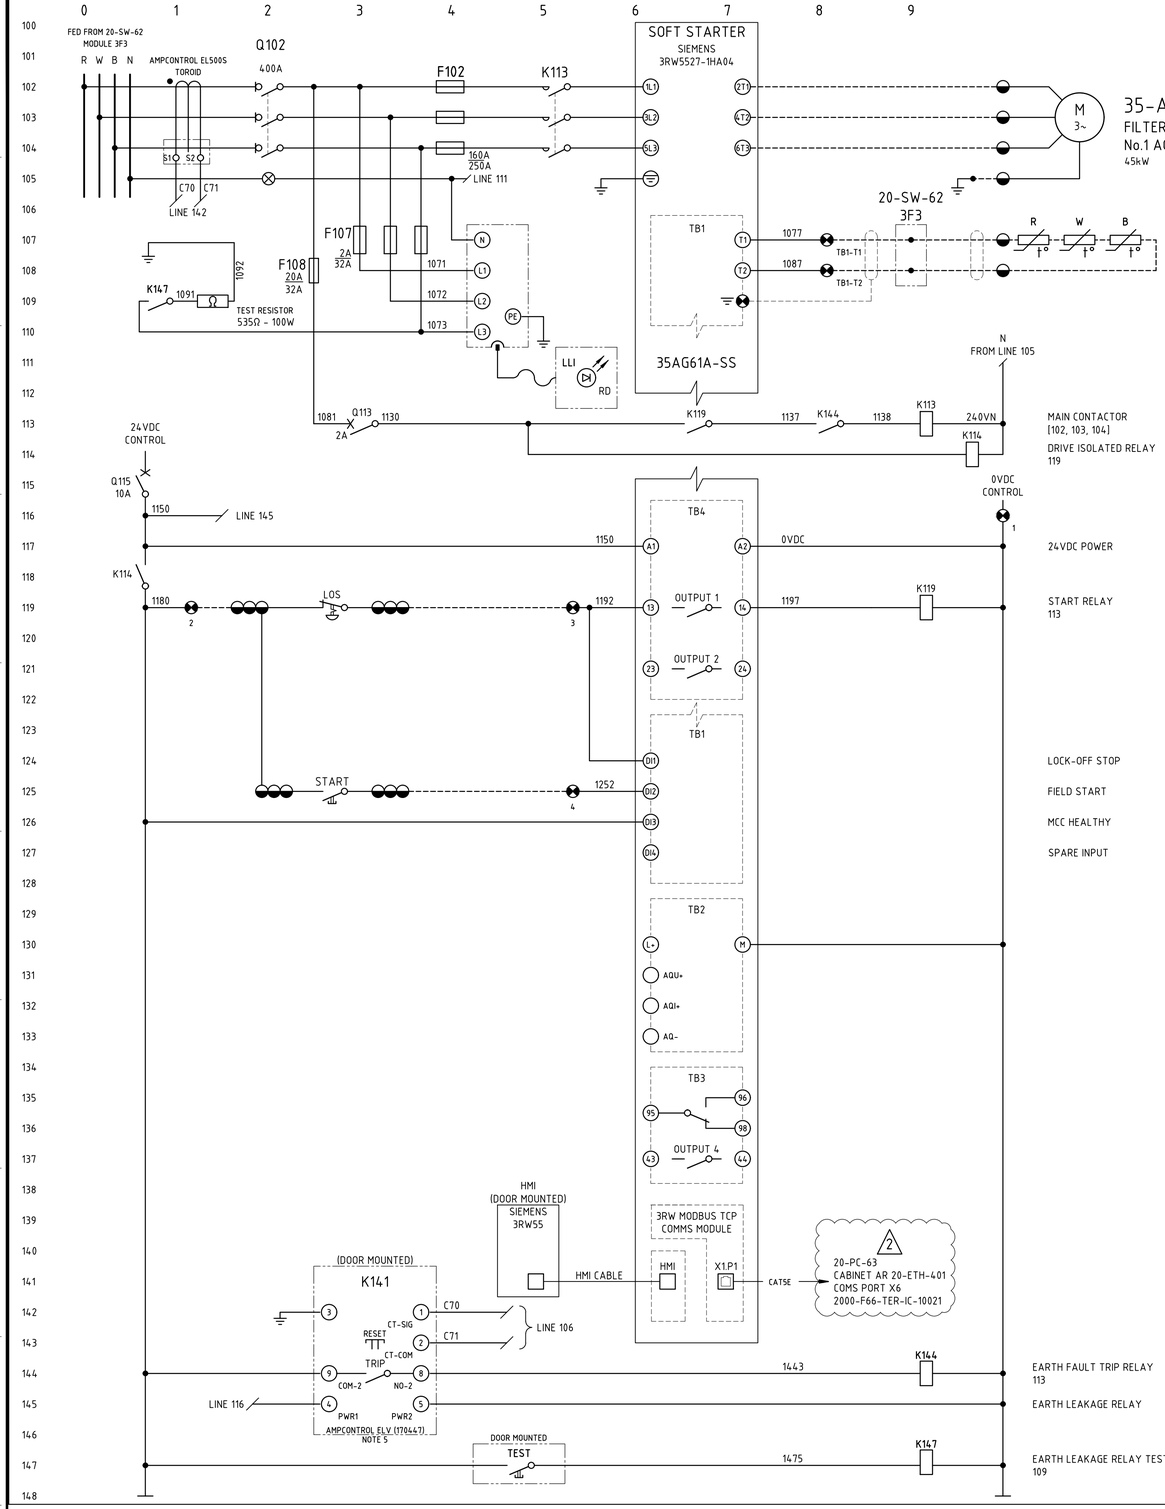


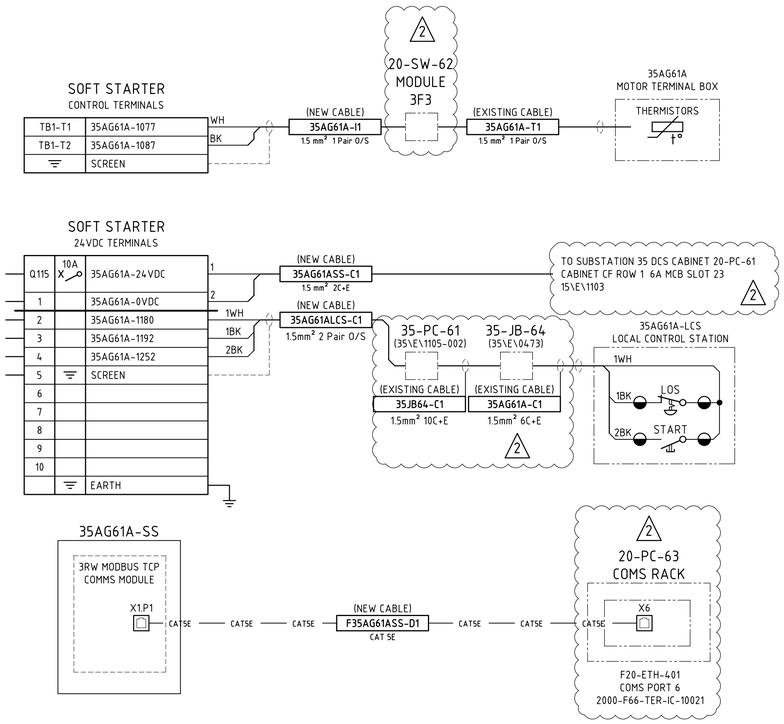


NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER i.e. 35AG61A-1200, UNLESS OTHERWISE NOTED.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. AMPCONTROL 101649 100/1A TOROID.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR. RELAY ENERGISED (NORMALLY CLOSED CONTACT OPEN) IN NORMAL OPERATION.
6. SWITCHGEAR SELECTED SHALL PROVIDE TYPE-2 CO-ORDINATION SUITABLE FOR HIGH-EFFICIENCY MOTORS.

LEGEND

- MCC MODULE TERMINAL
- FIELD TERMINAL
- DEVICE TERMINAL
- SOFT STARTER TERMINAL
- DCS OR I/O TERMINAL

TERMINATION LEGEND

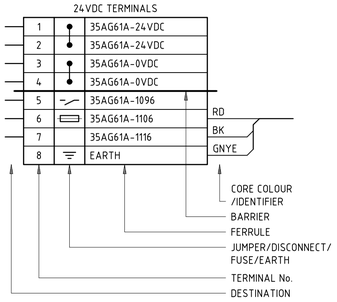

2000-F35-SCM-EL-10161_Rev2

Substation no. 35 MCC 20-SW-62 tank a agitator soft starter panel - 45kw schematic and termination diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\235171 KCGM GROWTH PROJECT\03 DELIVERABLES\ELV\F35 - CONCENTRATE HANDLING & FILTRATION\2000-F35-SCM-EL-10161.DWG 24AUG26 9:52PM GRENVILLE.DEASY