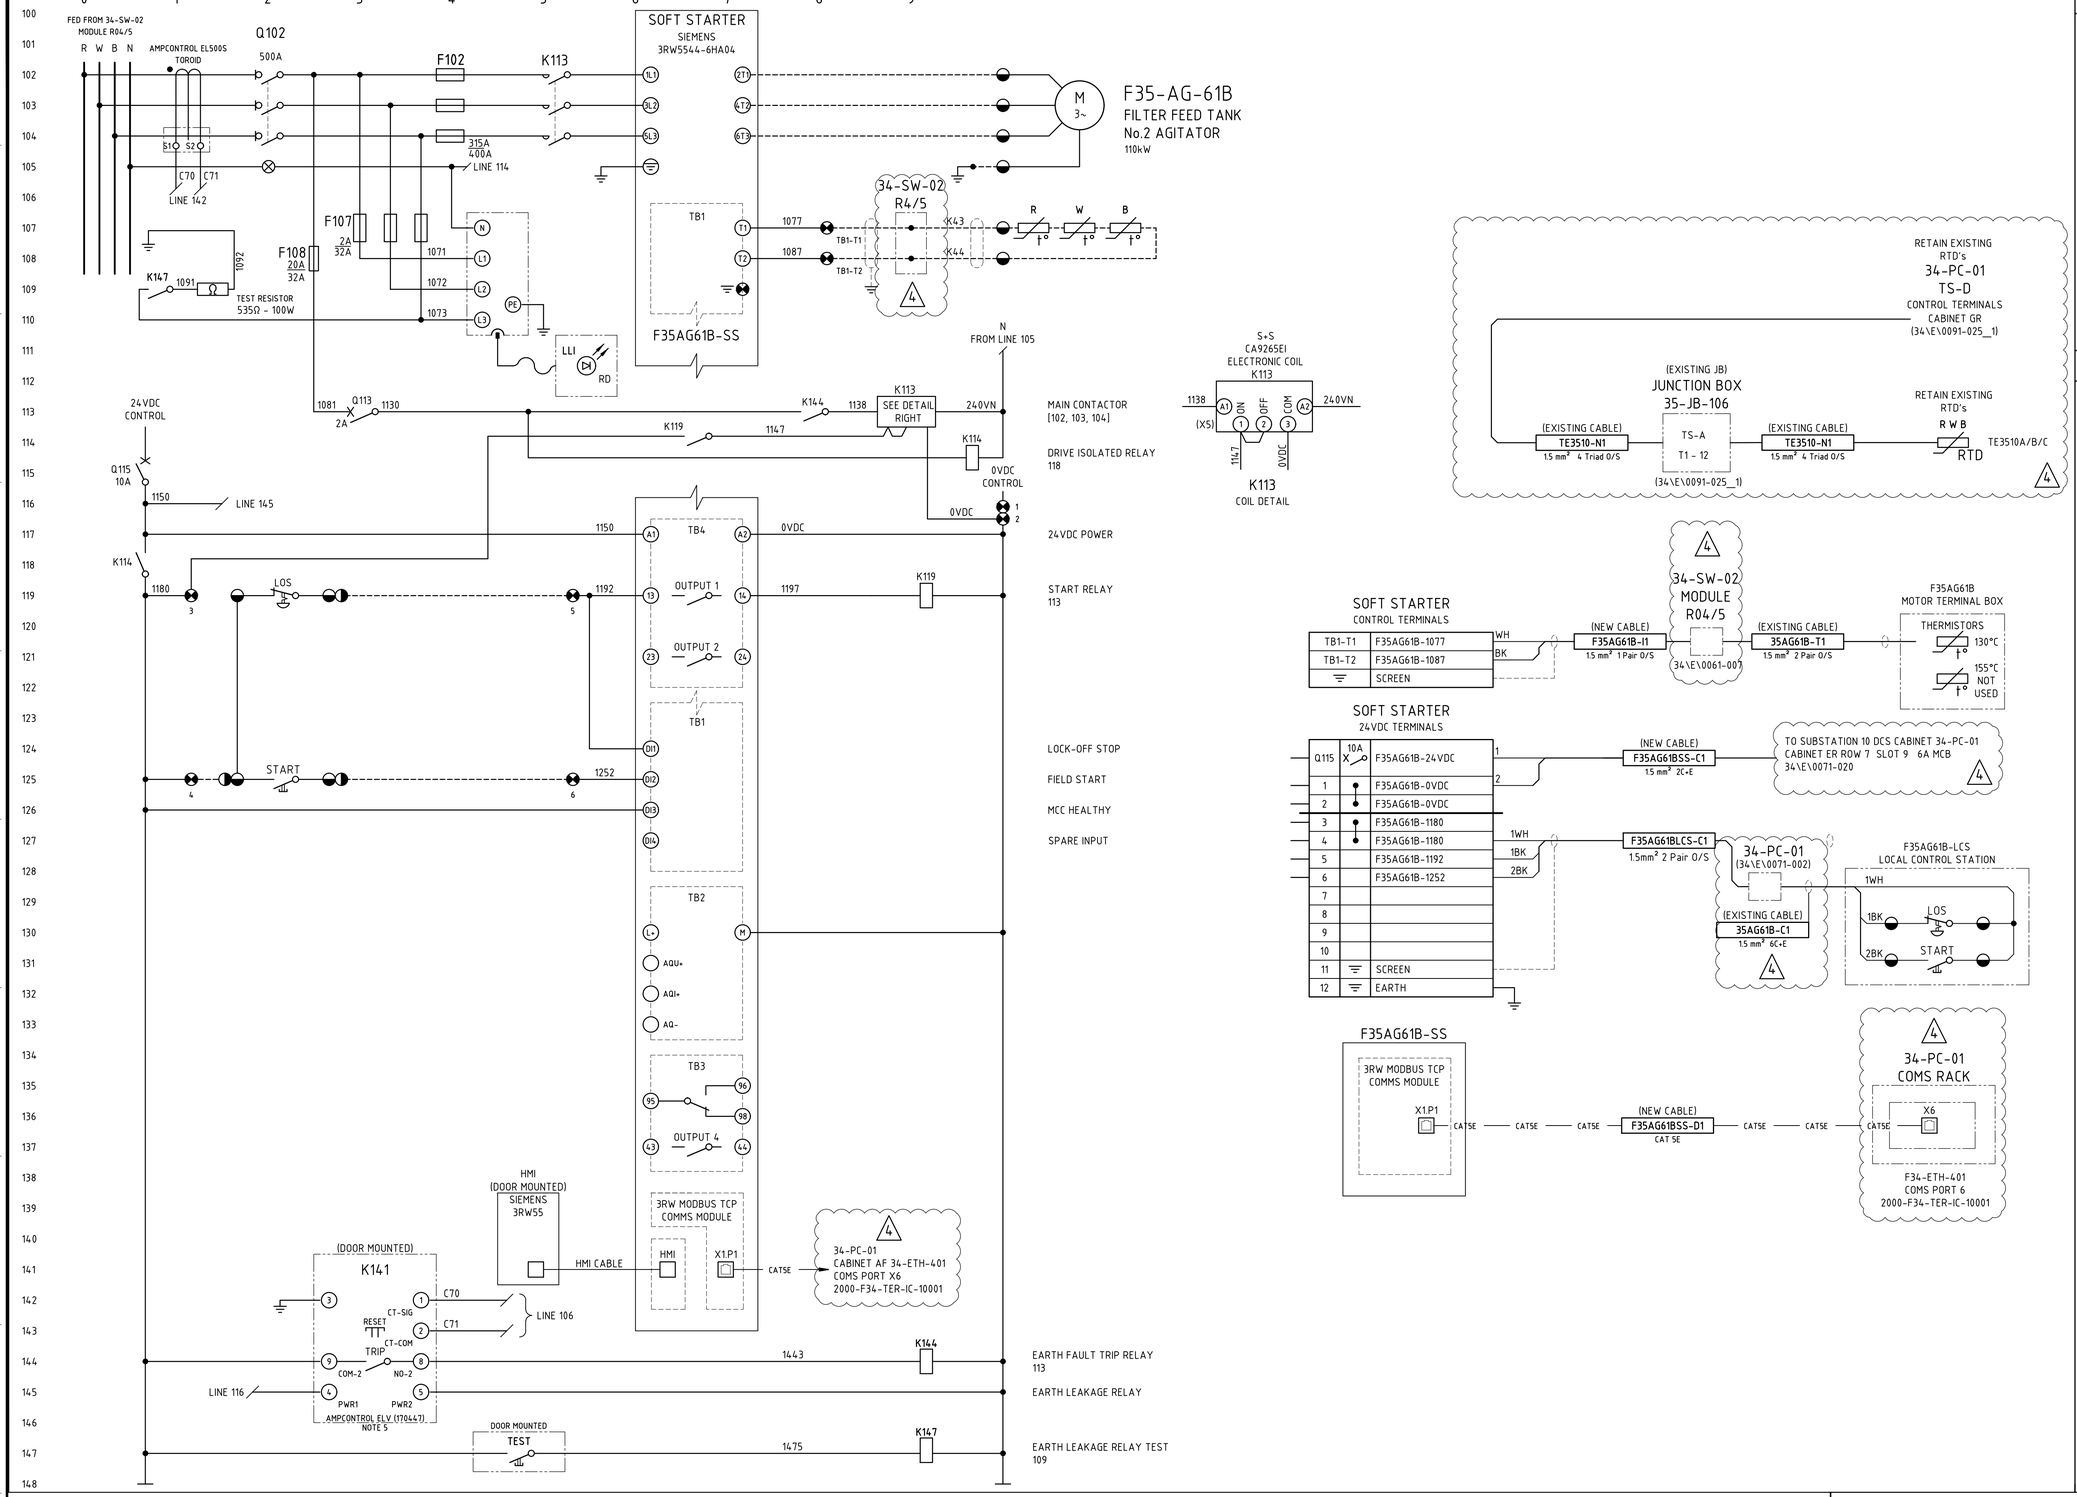



NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER i.e. F35AG61B-1200, UNLESS OTHERWISE NOTED.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. AMPCONTROL 101656
   100/1A TOROID.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR. RELAY ENERGISED (NORMALLY CLOSED CONTACT OPEN) IN NORMAL OPERATION.
6. SWITCHGEAR SELECTED SHALL PROVIDE TYPE-2 CO-ORDINATION SUITABLE FOR HIGH-EFFICIENCY MOTORS.

LEGEND

- MCC MODULE TERMINAL
- FIELD TERMINAL
- DEVICE TERMINAL
- SOFT STARTER TERMINAL
- DCS OR I/O TERMINAL

TERMINATION LEGEND

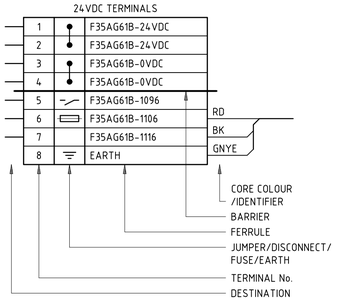

2000-F35-SCM-EL-10162_Rev4

Substation no. 10 MCC 34-SW-02 tank b agitator soft starter panel - 110kw schematic and termination diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\235117 KCGM GROWTH PROJECT\03 DELIVERABLES\EL\F35 - CONCENTRATE HANDLING & FILTRATION\2000-F35-SCM-EL-10162.DWG 14:SEP26 2:12PM GRENVILLE.DEASY