





F72-SW-172
REAGENTS EMERGENCY
415V MCC
630A


2000-F72-SCM-EL-10231

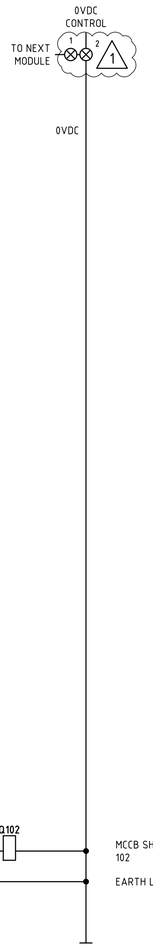



NOTE 2

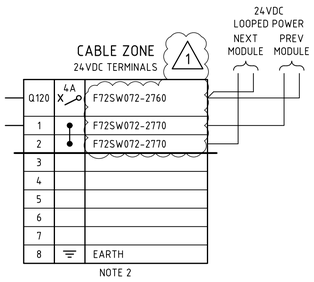


MCCB SHUNT TRIP COIL
102

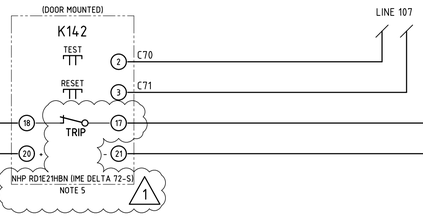EARTH LEAKAGE RELAY

## NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F72SW172-1200 UNLESS OTHERWISE NOTED.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGF2
   IN:400A IΔN MIN:0.3A TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR. RELAY ENERGISED (NORMALLY CLOSED CONTACT OPEN) IN NORMAL OPERATION.


1

## LEGEND

| | |
|---|---|
| 00/01/00 | DCS DIGITAL INPUT |
| 00/02/00 | DCS DIGITAL OUTPUT |
| ⊗ | MCC TERMINAL |
| ◓ | VSD TERMINAL |
| ◒ | FIELD TERMINAL |
| ◑ | DCS OR I/O TERMINAL |
| ◧ | MARSHALLING TERMINAL |
| ⊗ x | DEVICE TERMINAL |
| ⊗ cc | INDICATION LAMP cc = COLOUR |

1

## TERMINATION LEGEND

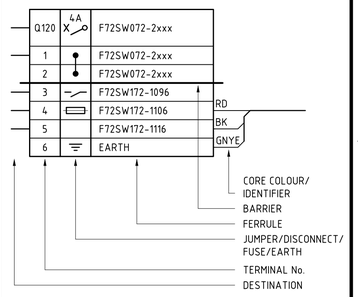


# 2000-F72-SCM-EL-10223_Rev1

F72-SW-072 F72-SW-172 emergency switchboard
feeder schematic and termination diagram

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\235117 KCGM GROWTH PROJECT\03 DELIVERABLES\ELF72 - REAGENTS MIXING & STORAGE\2000-F72-SCM-EL-10223.DWG 02DEC25 12:39PM HOTSEAT04