

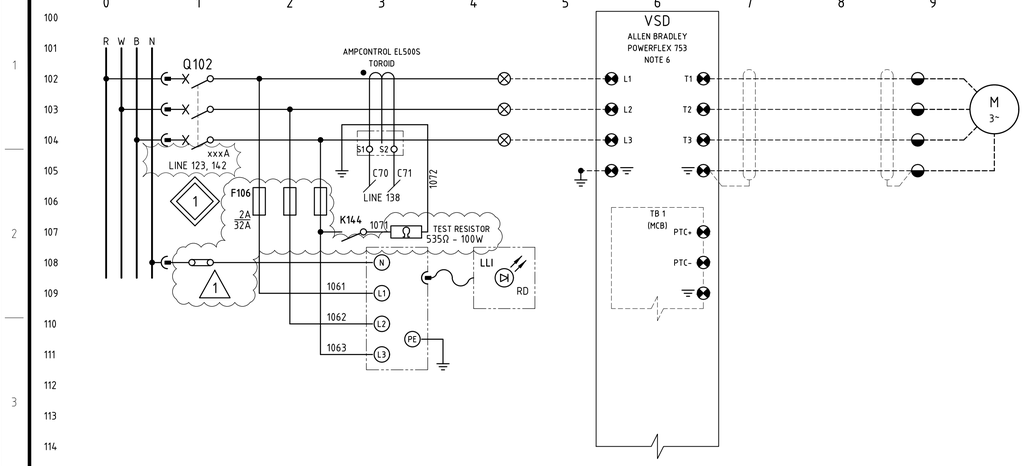


F72-PP-712
CONCENTRATE
BELT FILTER 1
FLOCCULANT DOSING PUMP (FUTURE)
2.2 kW

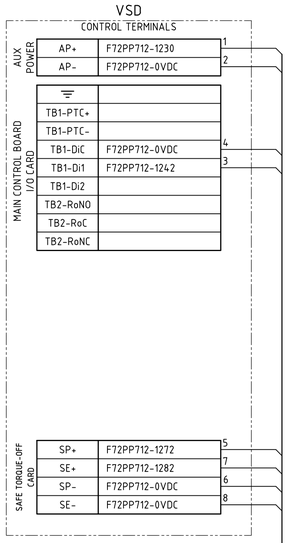

FUTURE
NON-EQUIPPED MODULE
1

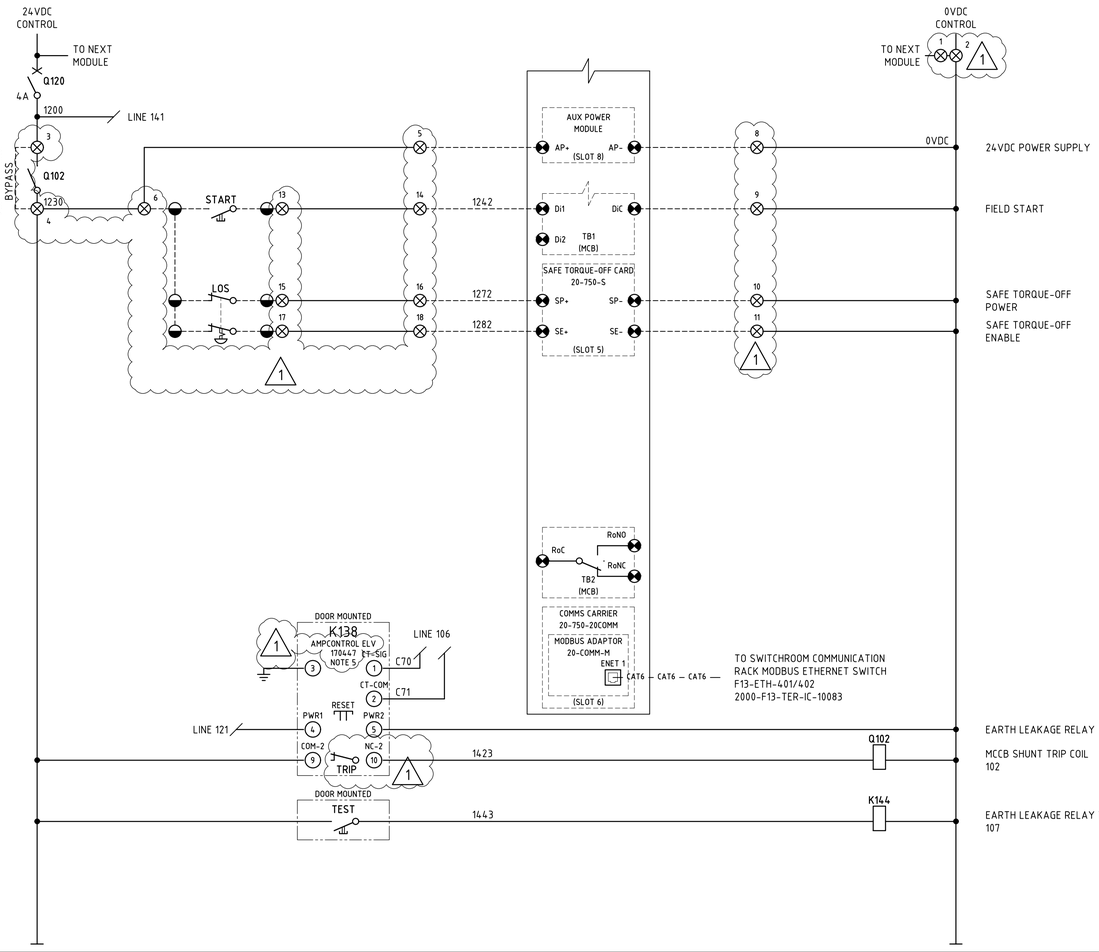

24VDC POWER SUPPLY
FIELD START
SAFE TORQUE-OFF POWER
SAFE TORQUE-OFF ENABLE
EARTH LEAKAGE RELAY
MCCB SHUNT TRIP COIL 102
EARTH LEAKAGE RELAY TEST 107

TO SWITCHROOM COMMUNICATION RACK MODBUS ETHERNET SWITCH
F13-ETH-401/402
2000-F13-TER-IC-10083

CABLE ZONE
24VDC TERMINALS

Q120	4A	F13SW020-2xxx
1		F13SW020-2xxx
2		F13SW020-2xxx
3		F72PP712-1200
4		F72PP712-1230
5		F72PP712-1230
6		F72PP712-1230
7		F72PP712-1230
8		F72PP712-0VDC
9		F72PP712-0VDC
10		F72PP712-0VDC
11		F72PP712-0VDC
12		F72PP712-0VDC
13		F72PP712-1242
14		F72PP712-1242
15		F72PP712-1272
16		F72PP712-1272
17		F72PP712-1282
18		F72PP712-1282
19		SPARE
20		SPARE
21		
22		
23		
24		
25		
26		EARTH
27		EARTH

NOTE 2


24VDC LOOPED POWER
NEXT MODULE
PREV MODULE

COMMISSIONING BYPASS

F72PP712VS-C1
1.5 mm² 10C+E

F72PP712LCS-C1
1.5 mm² 4C+E

F72PP712-LCS
LOCAL CONTROL STATION



NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F72PP712-1200, UNLESS OTHERWISE NOTED. (1)
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. THE ELV RELAY REQUIRES A SEPARATELY PURCHASED EL500S TOROID FOR MEASUREMENT OF THE EARTH LEAKAGE CURRENT. EL500S TOROIDS ARE AVAILABLE IN THE FOLLOWING WINDOW SIZES: 25mm, 60mm & 112mm.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR. RELAY ENERGISED (NORMALLY CLOSED CONTACT OPEN) IN NORMAL OPERATION. (1)
6. VSD SHALL BE SIZE FRAME 2 AND ABOVE.

LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- MCC TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- DCS OR I/O TERMINAL
- MARSHALLING TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)

HOLDS

1. DETAILS TO TBC.

TERMINATION LEGEND

Q120	4A	F13SW020-2xxx
1		F13SW020-2xxx
2		F13SW020-2xxx
3		F72PP712-1096
4		F72PP712-1106
5		F72PP712-1116
6		EARTH

RD
BK
GNYE

CORE COLOUR/ IDENTIFIER
BARRIER
FERRULE
JUMPER/DISCONNECT/ FUSE/EARTH
TERMINAL No.
DESTINATION

2000-F72-SCM-EL-10714_Rev1

F13-SW-020 - F72-PP-712 conc belt filter 1 flocculant dosing pu - schematic and termination diagram

D:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\ELV\F72 - REAGENTS MIXING & STORAGE\2000-F72-SCM-EL-10714.DWG 30MAY25 10:57AM SANDRA CULL