

Docusign Envelope ID: 1C123F4F-48ED-425D-A3F4-754BD8FC0FD6

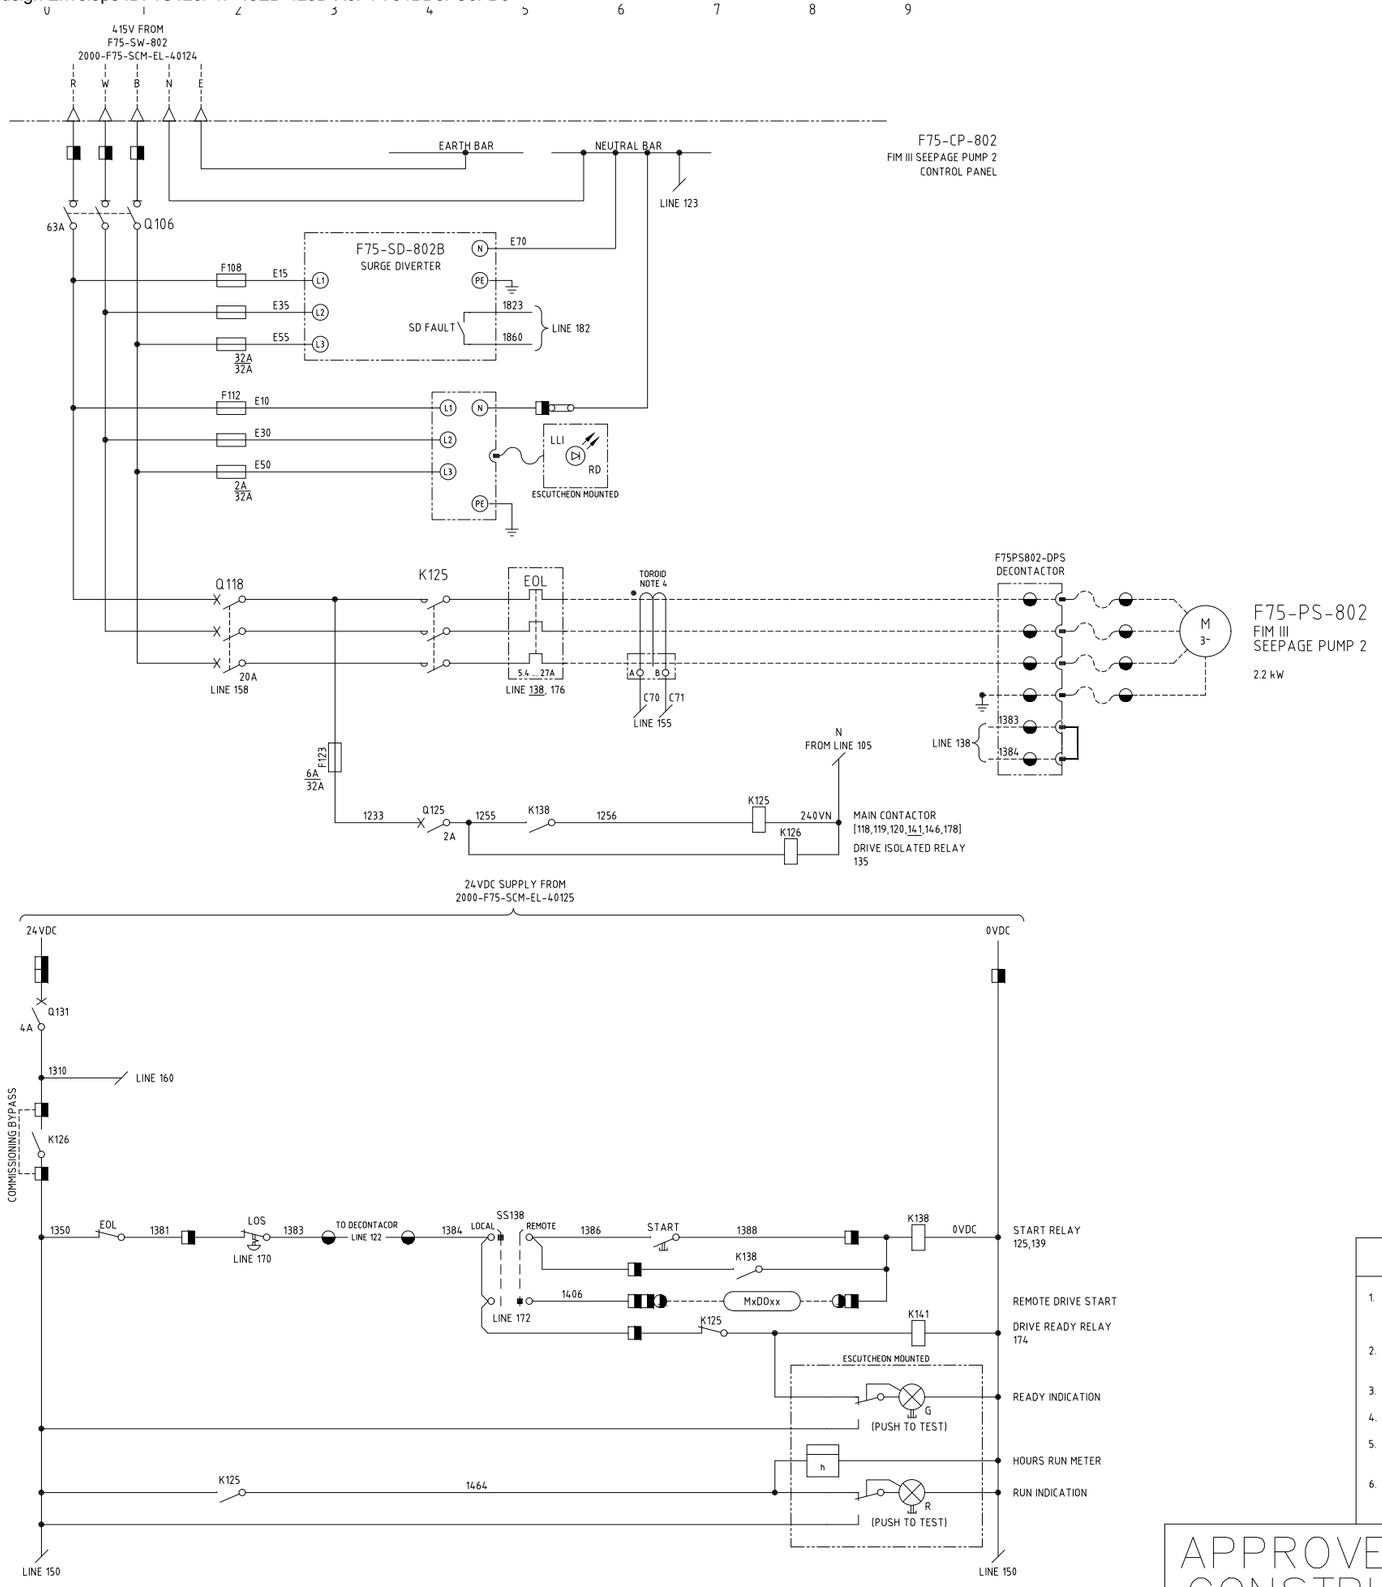

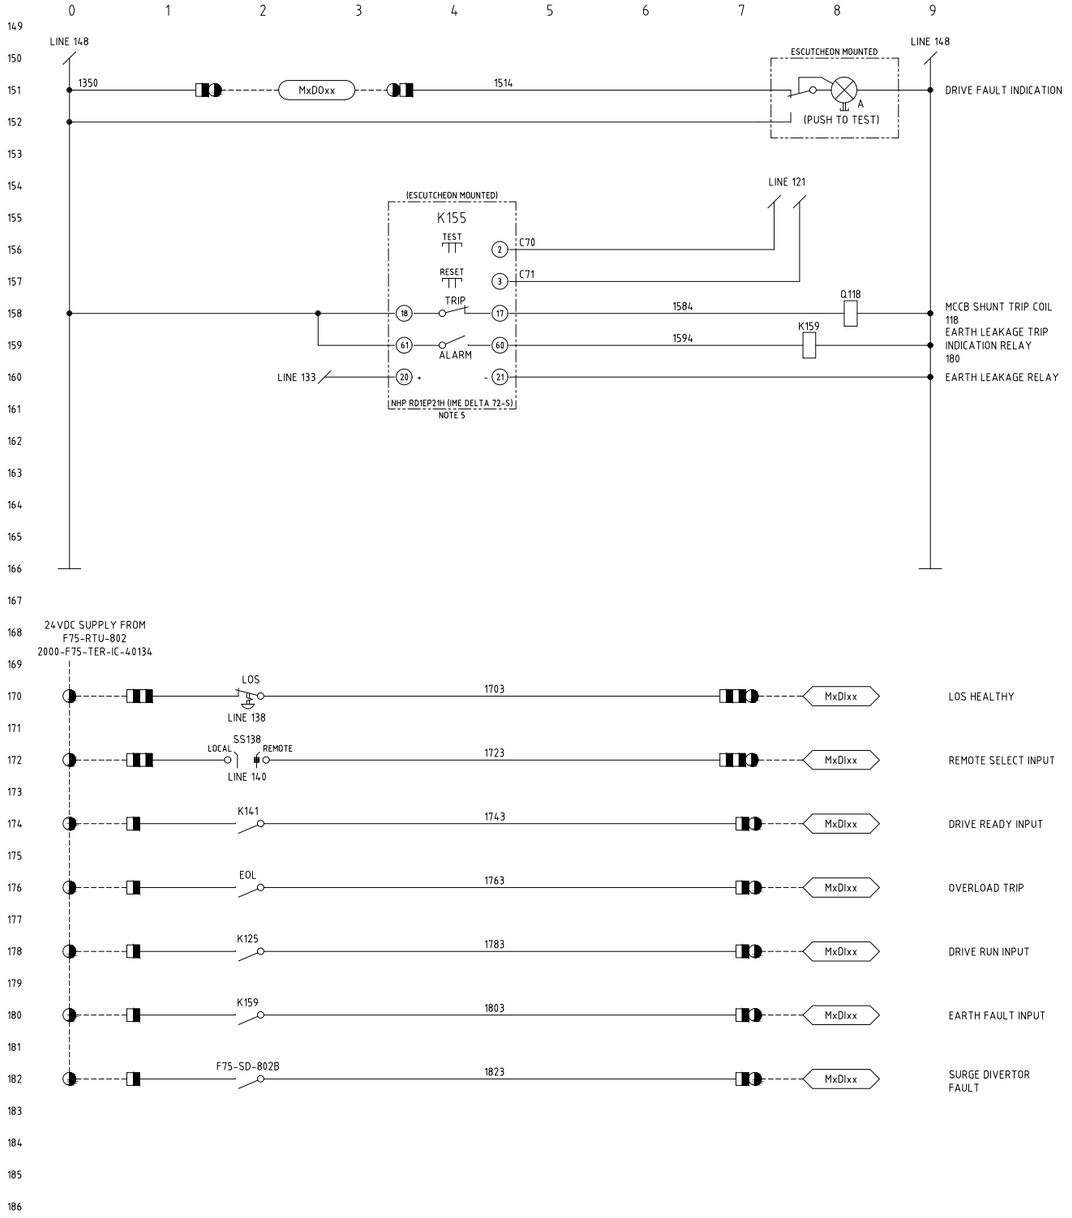


NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. FxxPSxxx-1200.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. NHP TDGx2 TOROID TO SUIT CABLE DIAMETER.
5. EARTH LEAKAGE RELAY USER INTERFACE TO BE MOUNTED ON CONTROL PANEL ESCUTCHEON.
6. REFER 2000-F75-LST-IC-40004 FOR RTU I/O ADDRESSES AND TERMINATION DETAILS.

LEGEND

- MxDIxx — RTU DIGITAL INPUT
- MxDOxx — RTU DIGITAL OUTPUT
- SWITCHBOARD TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- RTU TERMINAL
- CONTROL PANEL TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)

TERMINATION LEGEND

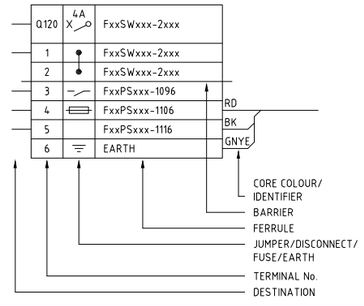

APPROVED FOR CONSTRUCTION

REFERENCES	DWG No	REV	DATE	REVISION
F75-RTU-802 FIM III TSF SWITCHBOARD 4 RTU TERMINATION DIAGRAM SHEET 1	2000-F75-TER-IC-40134			
F75-CP-802 FIM III SEEPAGE PUMP 2 CONTROL PANEL GENERAL ARRANGEMENT SHEET 1	2000-F75-DRG-EL-40131			
F75-CP-802 FIM III SEEPAGE PUMP 2 CONTROL PANEL TERMINATION DIAGRAM	2000-F75-TER-EL-40115			
F75-SW-802 FIM III TSF SWITCHBOARD 4 SCHEMATIC DIAGRAM SHEET 2	2000-F75-SCM-EL-40125			
F75-SW-802 FIM III TSF SWITCHBOARD 4 SCHEMATIC DIAGRAM SHEET 1	2000-F75-SCH-EL-40124			
GENERAL NOTES AND STANDARD DRAWINGS INDEX	2000-F00-STD-EL-10001	O	29.MAY.25	APPROVED FOR CONSTRUCTION

	Initial	Initial	Initial	DS
	TG	KVN	KVN	TH
	DRN	CHK	TECH APP	PROJ APP

NORTHERN STAR RESOURCES LIMITED

DRA PACIFIC (PTY) LIMITED

DRAWN	J TORRALBA	03.APR.25
CHECKED	K VAN NAMEN	03.APR.25
DESIGNED	J TORRALBA	03.APR.25
TECH APP	K VAN NAMEN	29.APR.25
PROJ APP	T HANDORF	29.MAY.25
CLIENT APP		

KCGM
FIM TSF PROJECT

TITLE: FIM III TAILINGS DAM
F75-CP-802 FIM III SEEPAGE PUMP 2 CP
SCHEMATIC DIAGRAM

SIZE	SCALE	DRG No.	REV
A1	NTS	2000-F75-SCM-EL-40115	O