
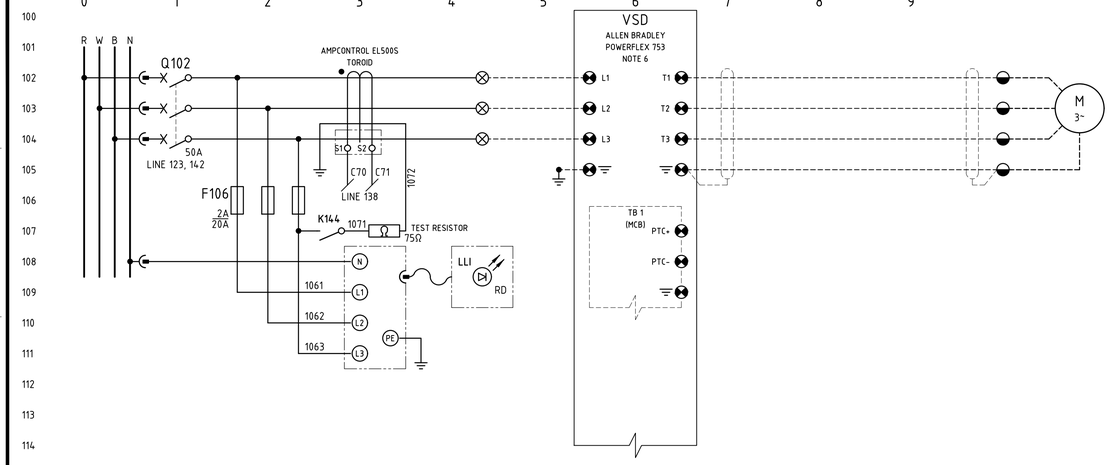


F35-PP-449
UFG CIRCUIT 3
FEED
PUMP
15 kW

VSD
CONTROL TERMINALS

AUX POWER	AP+	F35PP449-1230
	AP-	F35PP449-0VDC
MAIN CONTROL BOARD I/O CARD	TB1-PTC+	
	TB1-PTC-	
	TB1-DiC	F35PP449-0VDC
	TB1-Di1	F35PP449-1242
	TB1-Di2	
	TB2-RoNO	
	TB2-RoC	
	TB2-RoNC	
SAFE TORQUE-OFF CARD	SP+	F35PP449-1272
	SE+	F35PP449-1282
	SP-	F35PP449-0VDC
	SE-	F35PP449-0VDC

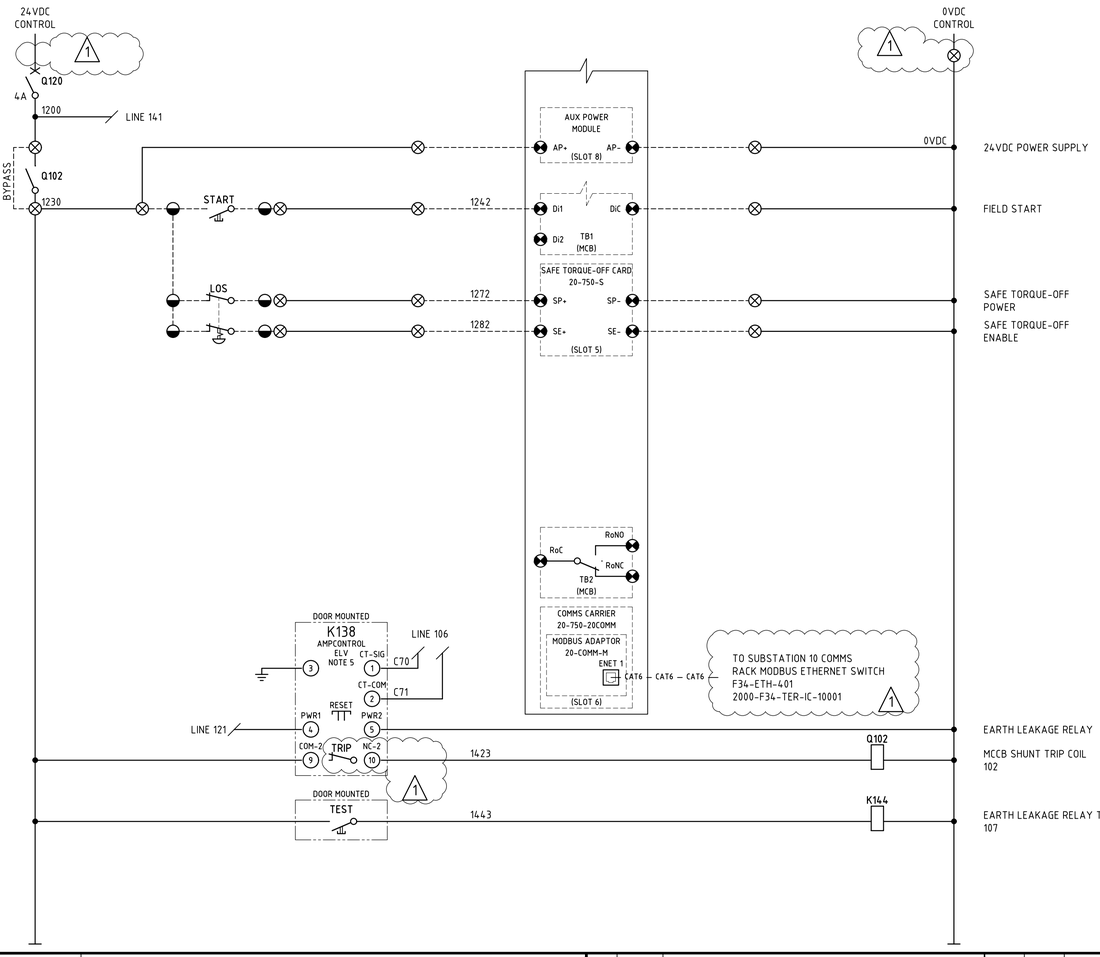

CABLE ZONE
24VDC TERMINALS


Q120	4A	1	F35PP449-24VDC	
1		2	F35PP449-0VDC	
2				
3		1	F35PP449-1200	COMMISSIONING BYPASS
4		1	F35PP449-1230	
5		1	F35PP449-1230	
6		1	F35PP449-1230	
7		2	F35PP449-1230	
8		4	F35PP449-0VDC	
9		6	F35PP449-0VDC	
10		8	F35PP449-0VDC	
11		2	F35PP449-0VDC	
12		3	F35PP449-0VDC	
13		3	F35PP449-1242	
14		5	F35PP449-1242	
15		4	F35PP449-1272	
16		7	F35PP449-1272	
17		9	F35PP449-1282	
18		10	F35PP449-1282	
19			SPARE	
20			SPARE	
21				
22				
23				
24		GNYE	EARTH	
25		GNYE	EARTH	

NOTE 2

F35PP449VS-C1
1.5 mm² 10C+E
F35PP449-C1
1.5 mm² 2C+E
TO SUBSTATION 10
DCS CABINET 34-PC-01ER
2000-F34-TER-IC-10004

F35PP449LCS-C1
1.5 mm² 4C+E

F35PP449-LCS
LOCAL CONTROL STATION




NOTES

1. TERMINALS ON TERMINAL STRIPS ABOVE 50VAC SHALL HAVE A SEPARATE PERSPEX SHROUD AND SHALL BE LABELLED "DANGER xxxVAC".
2. WIRE NUMBER FERRULES ON TERMINAL STRIP SHALL BE PREFIXED WITH EQUIPMENT NUMBER e.g. F35PP449-1200, UNLESS OTHERWISE NOTED.
3. EACH WIRE SHALL BE IDENTIFIED AT BOTH ENDS WITH FERRULES.
4. THE ELV RELAY REQUIRES A SEPARATELY PURCHASED EL500S TOROID FOR MEASUREMENT OF THE EARTH LEAKAGE CURRENT. EL500S TOROIDS ARE AVAILABLE IN THE FOLLOWING WINDOW SIZES: 25mm, 60mm & 112mm.
5. EARTH LEAKAGE RELAY (ELV) USER INTERFACE TO BE MOUNTED ON MCC MODULE DOOR.
   RELAY SETTINGS SET TO:
   TRIP LEVEL ="1A" (POSITION 0).
   TRIP DELAY = "100ms" (POSITION 1).
6. VSD SHALL BE SIZE FRAME 2 AND ABOVE.

LEGEND

- 00/01/00 — DCS DIGITAL INPUT
- 00/02/00 — DCS DIGITAL OUTPUT
- MCC TERMINAL
- VSD TERMINAL
- FIELD TERMINAL
- DCS OR I/O TERMINAL
- MARSHALLING TERMINAL
- DEVICE TERMINAL
- INDICATION LAMP (cc = COLOUR)

TERMINATION LEGEND

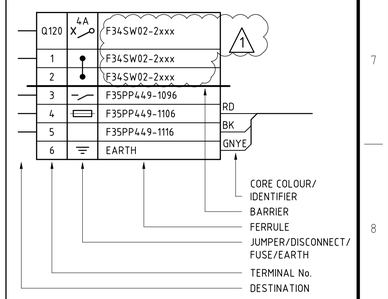

DRG No.	REFERENCES
2000-F34-SLD-EL-10102	SUBSTATION NO. 10 MCC 34-SW-02 SINGLE LINE DIAGRAM SHEET 2
2000-F34-DRG-EL-10001	SUBSTATION NO. 10 MCC 34-SW-02 GENERAL ARRANGEMENT
2000-F00-STD-EL-10001	GENERAL NOTES AND STANDARD DRAWING INDEX

REV	DATE	DESCRIPTION	DRAW	CHECK	DESIGN	TECH APP	PROJ APP
1	31MAR25	24VDC SUPPLY AND E/L RELAY CONTACT CHANGE	[redacted]				
0	04NOV24	APPROVED FOR CONSTRUCTION					

NORTHERN STAR RESOURCES LIMITED

PRIMERO
primero.com.au | DESIGN | CONSTRUCT | OPERATE
PRIMERO PROJECT NUMBER: 23517

INFORMATION AND REPRESENTATIONS ON THIS DRAWING ARE THE INTELLECTUAL PROPERTY OF PRIMERO UNLESS SPECIFICALLY IDENTIFIED OTHERWISE. ALL RIGHTS INCLUDING USE RESERVED

PROJECT: NORTHERN STAR RESOURCES LTD
KCGM GROWTH PROJECT

TITLE: FIMISTON PLANT - SUBSTATION NO. 10 MCC 34-SW-02
F35-PP-449 UFG CIRCUIT 3 FEED PUMP
SCHEMATIC AND TERMINATION DIAGRAM

SHEET	SCALE	DRG No.	REVISION
A1	NONE	2000-F34-SCM-EL-10004	1

O:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\EL\F34 - ULTRA FINE GRINDING\2000-F34-SCM-EL-10004.DWG 01APR25 9:35AM SAM.KEEL