


D:\CAD PROJECTS\235 NORTHERN STAR RESOURCES LTD\23517 KCGM GROWTH PROJECT\03 DELIVERABLES\PR\PID\ISSUED\12.09.25 - SIGNING\NATIVES\2000-F66-PID-PR-10001_1.DWG 09SEP25 8:31AM ANNE.HOYNE

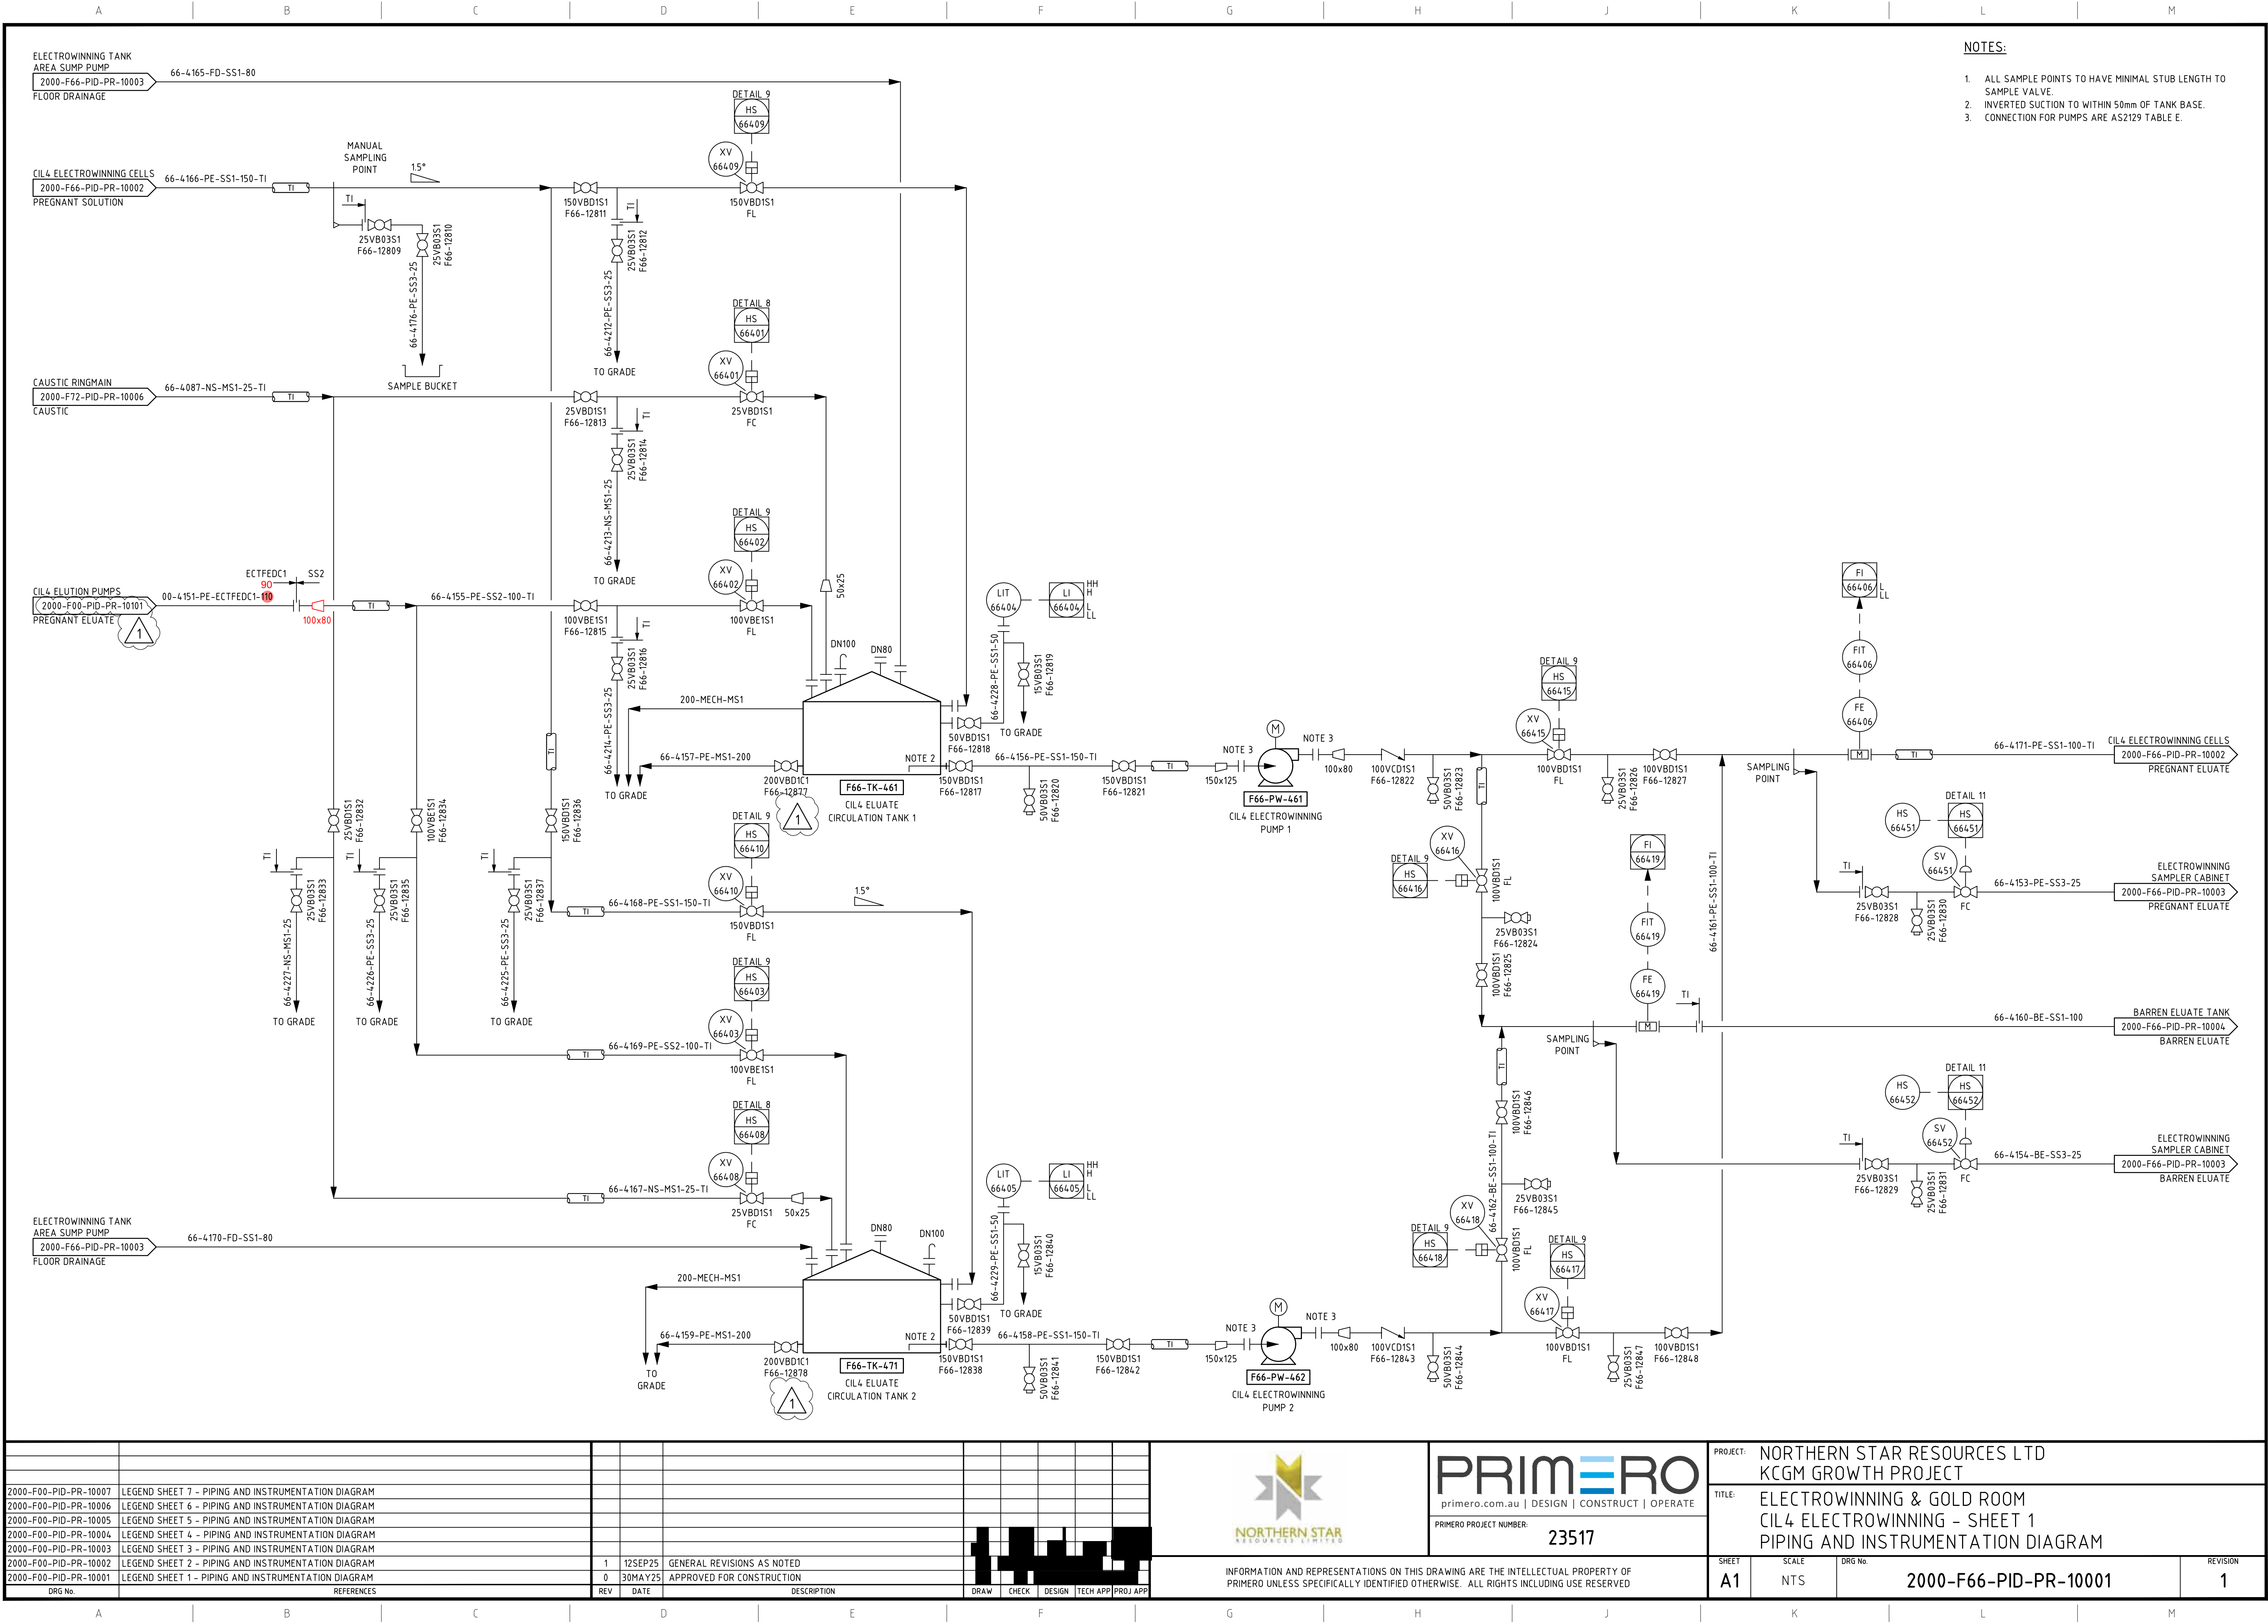

NOTES:

1. ALL SAMPLE POINTS TO HAVE MINIMAL STUB LENGTH TO SAMPLE VALVE.
2. INVERTED SUCTION TO WITHIN 50mm OF TANK BASE.
3. CONNECTION FOR PUMPS ARE AS2129 TABLE E.