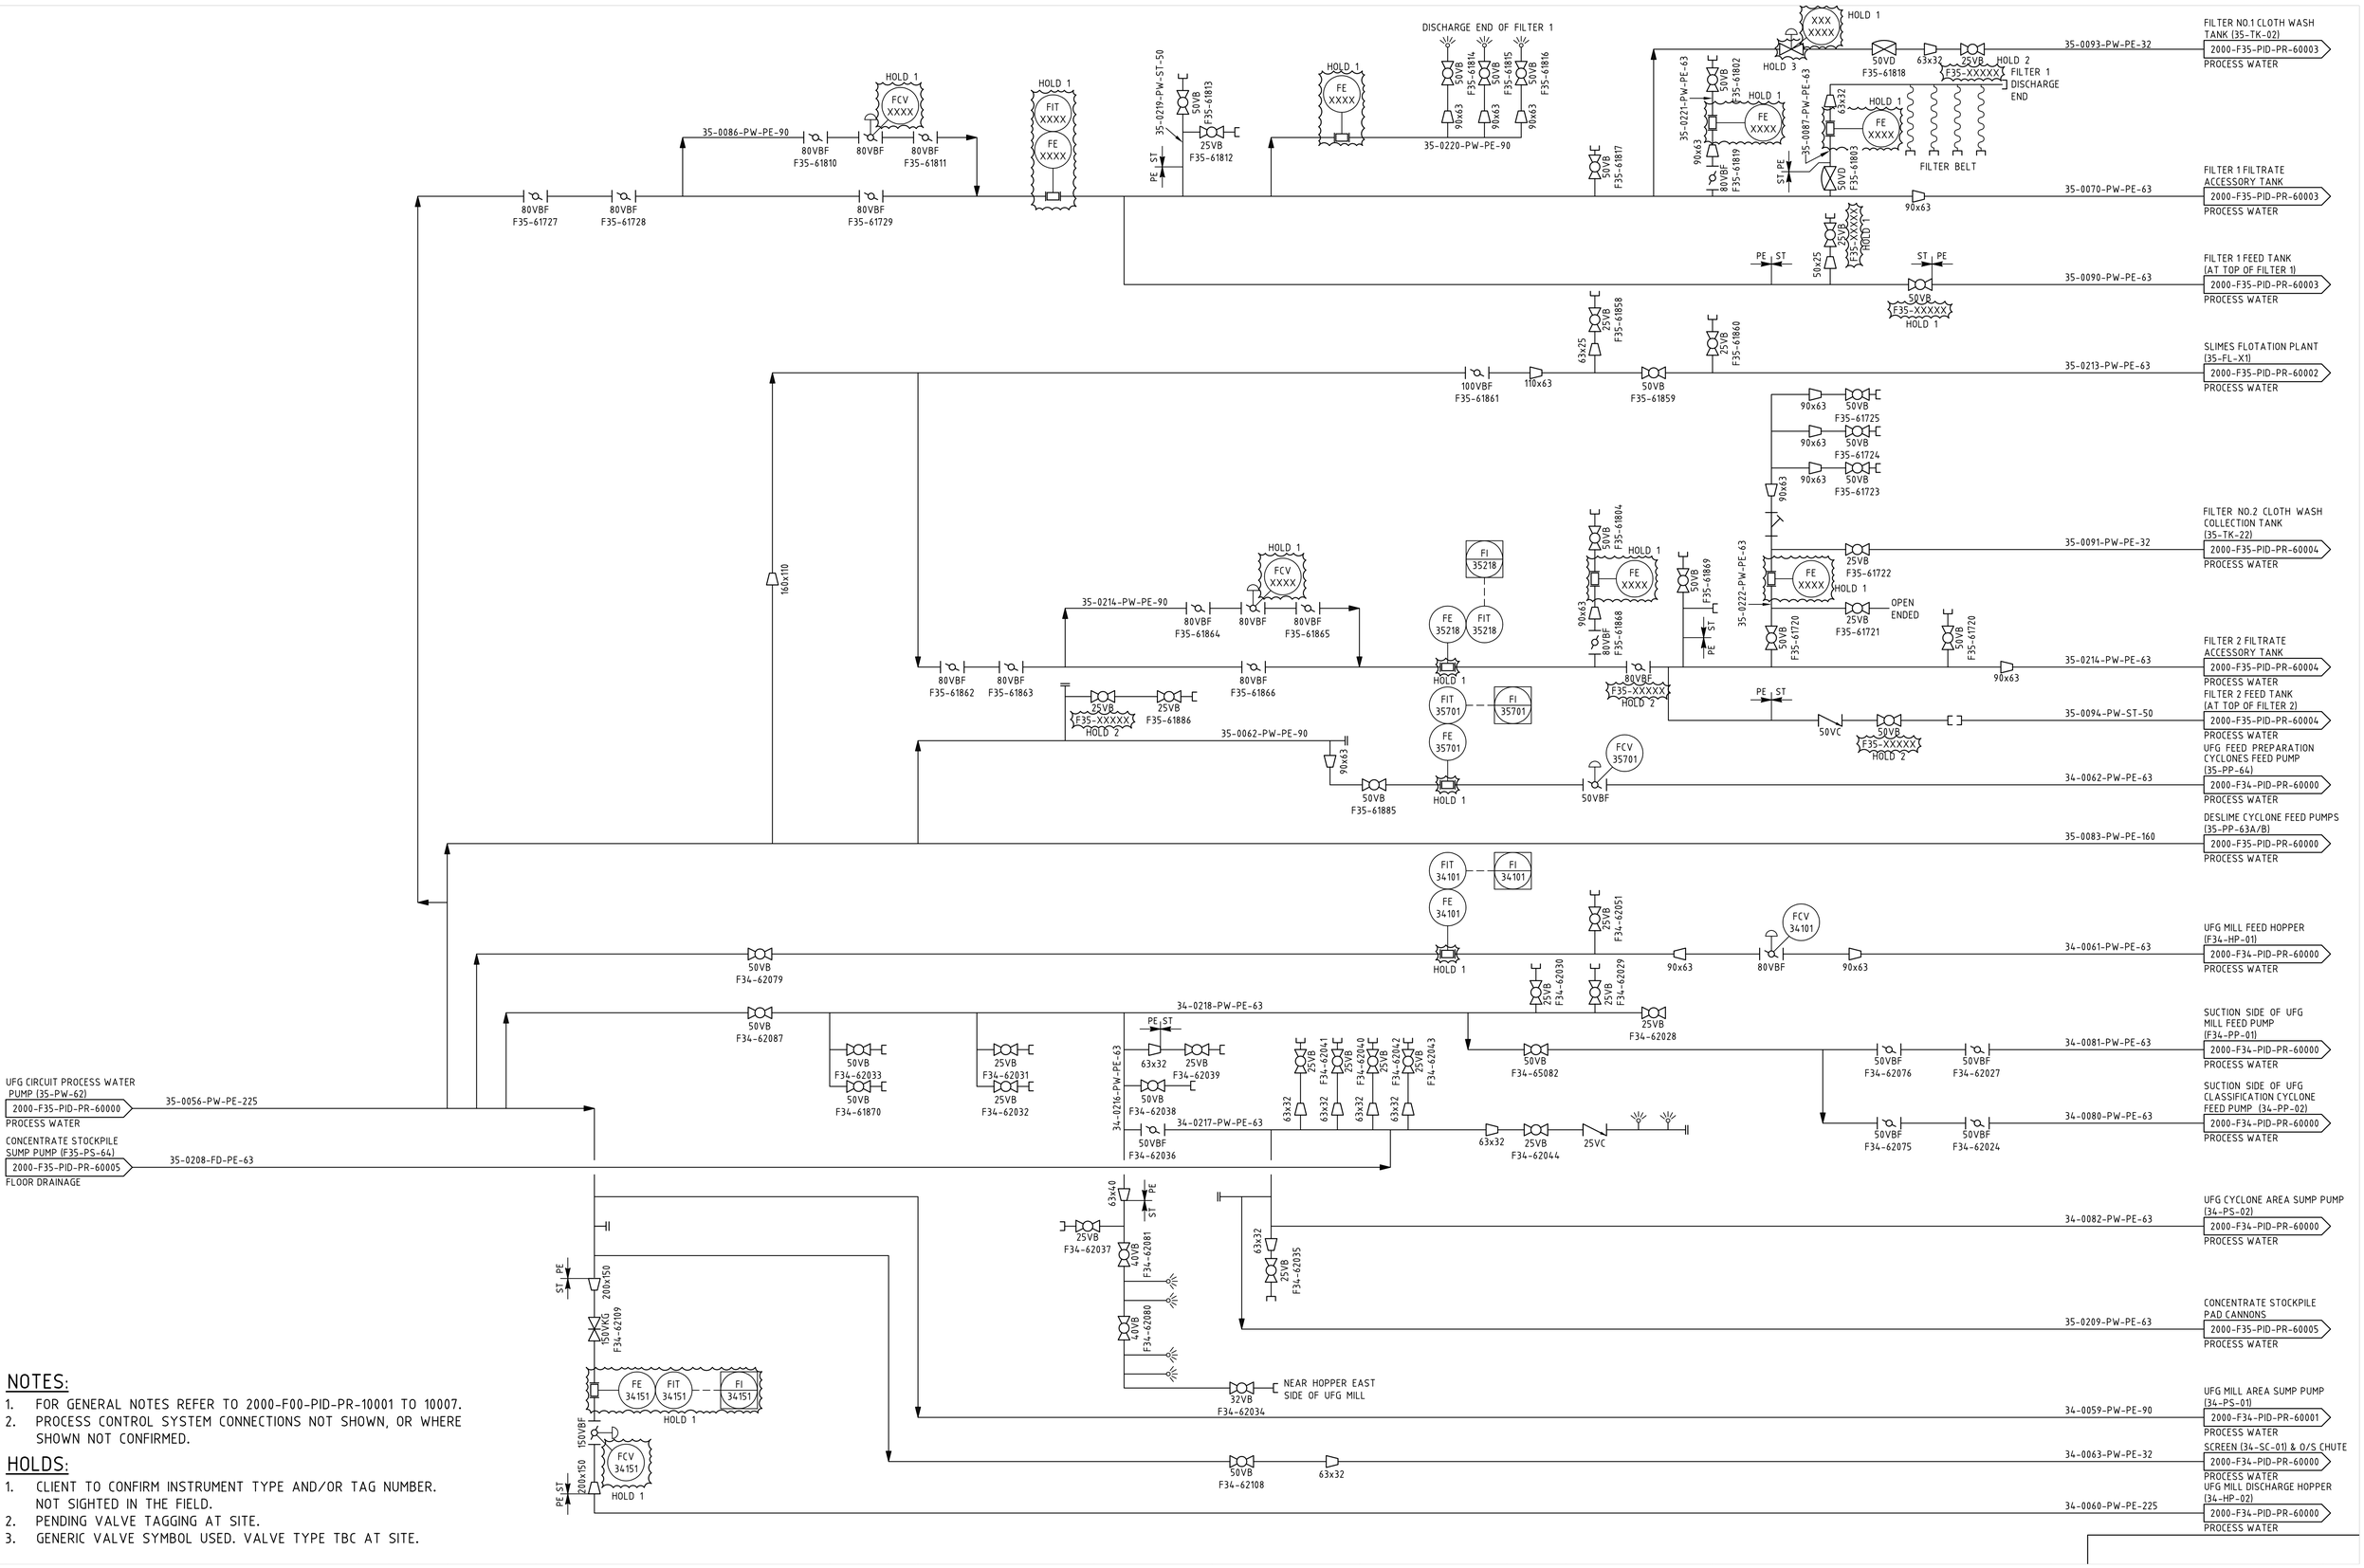


NOTES:

1. FOR GENERAL NOTES REFER TO 2000-F00-PID-PR-10001 TO 10007.
2. PROCESS CONTROL SYSTEM CONNECTIONS NOT SHOWN, OR WHERE SHOWN NOT CONFIRMED.

HOLDS:

1. CLIENT TO CONFIRM INSTRUMENT TYPE AND/OR TAG NUMBER. NOT SIGHTED IN THE FIELD.
2. PENDING VALVE TAGGING AT SITE.
3. GENERIC VALVE SYMBOL USED. VALVE TYPE TBC AT SITE.

2025.05.12 13:27:04+08'00'
2025.05.12 13:17:34+08'00'
2025.05.12 13:42:11+08'00'