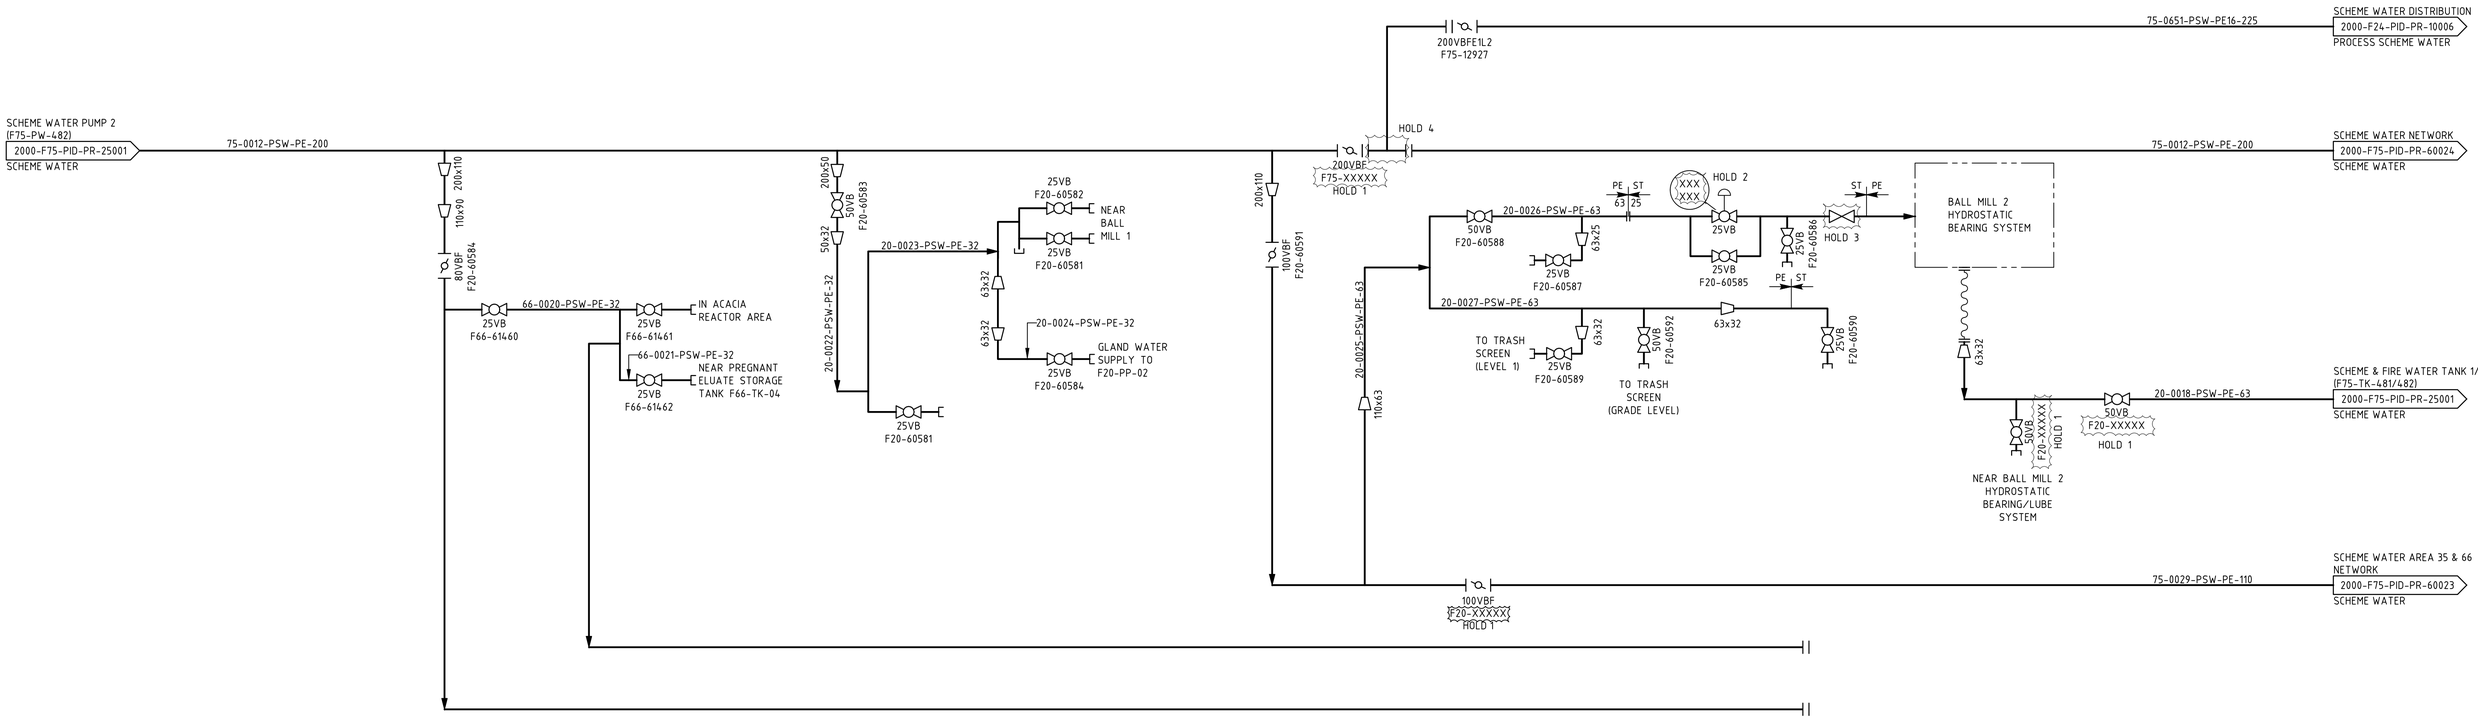


NOTES:

1. FOR GENERAL NOTES REFER TO 2000-F00-PID-PR-10001 TO 10007.
2. PROCESS CONTROL SYSTEM CONNECTIONS NOT SHOWN, OR WHERE SHOWN NOT CONFIRMED.
3. SCHEME WATER SUPPLIED FOR PUMP GLAND.

HOLDS:

1. PENDING VALVE TAGGING.
2. CLIENT TO CONFIRM INSTRUMENT TYPE AND/OR TAG NUMBER.
3. BURKERT VALVE. NO ACTUATOR SIGHTED. CLIENT TO CONFIRM TYPE OF VALVE.
4. TIE IN POINT (TIP-1054) LOCATION TO BE CONFIRMED.