
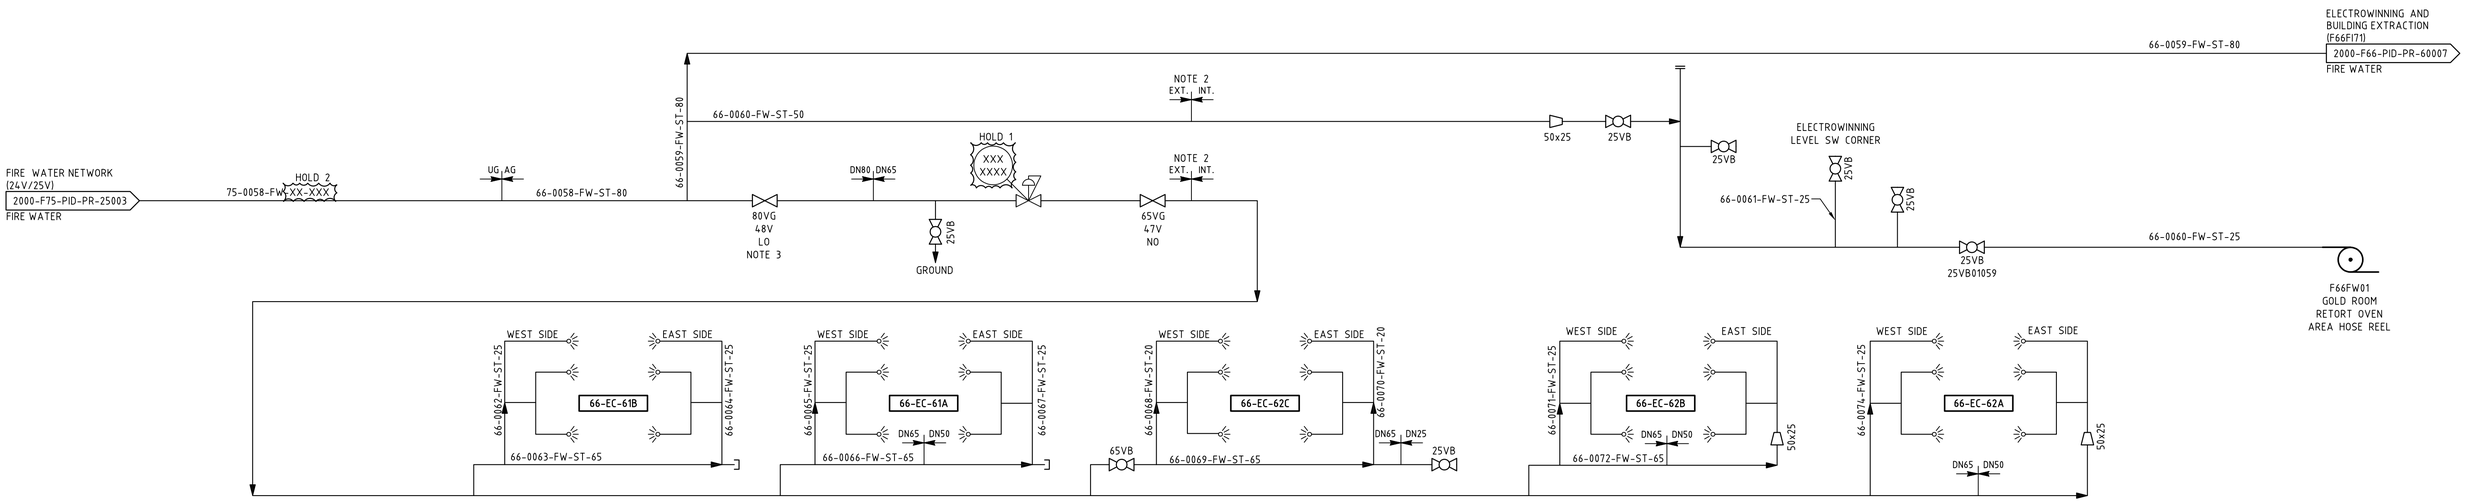


ELECTROWINNING CELLS SPRINKLER DELUGE SYSTEM

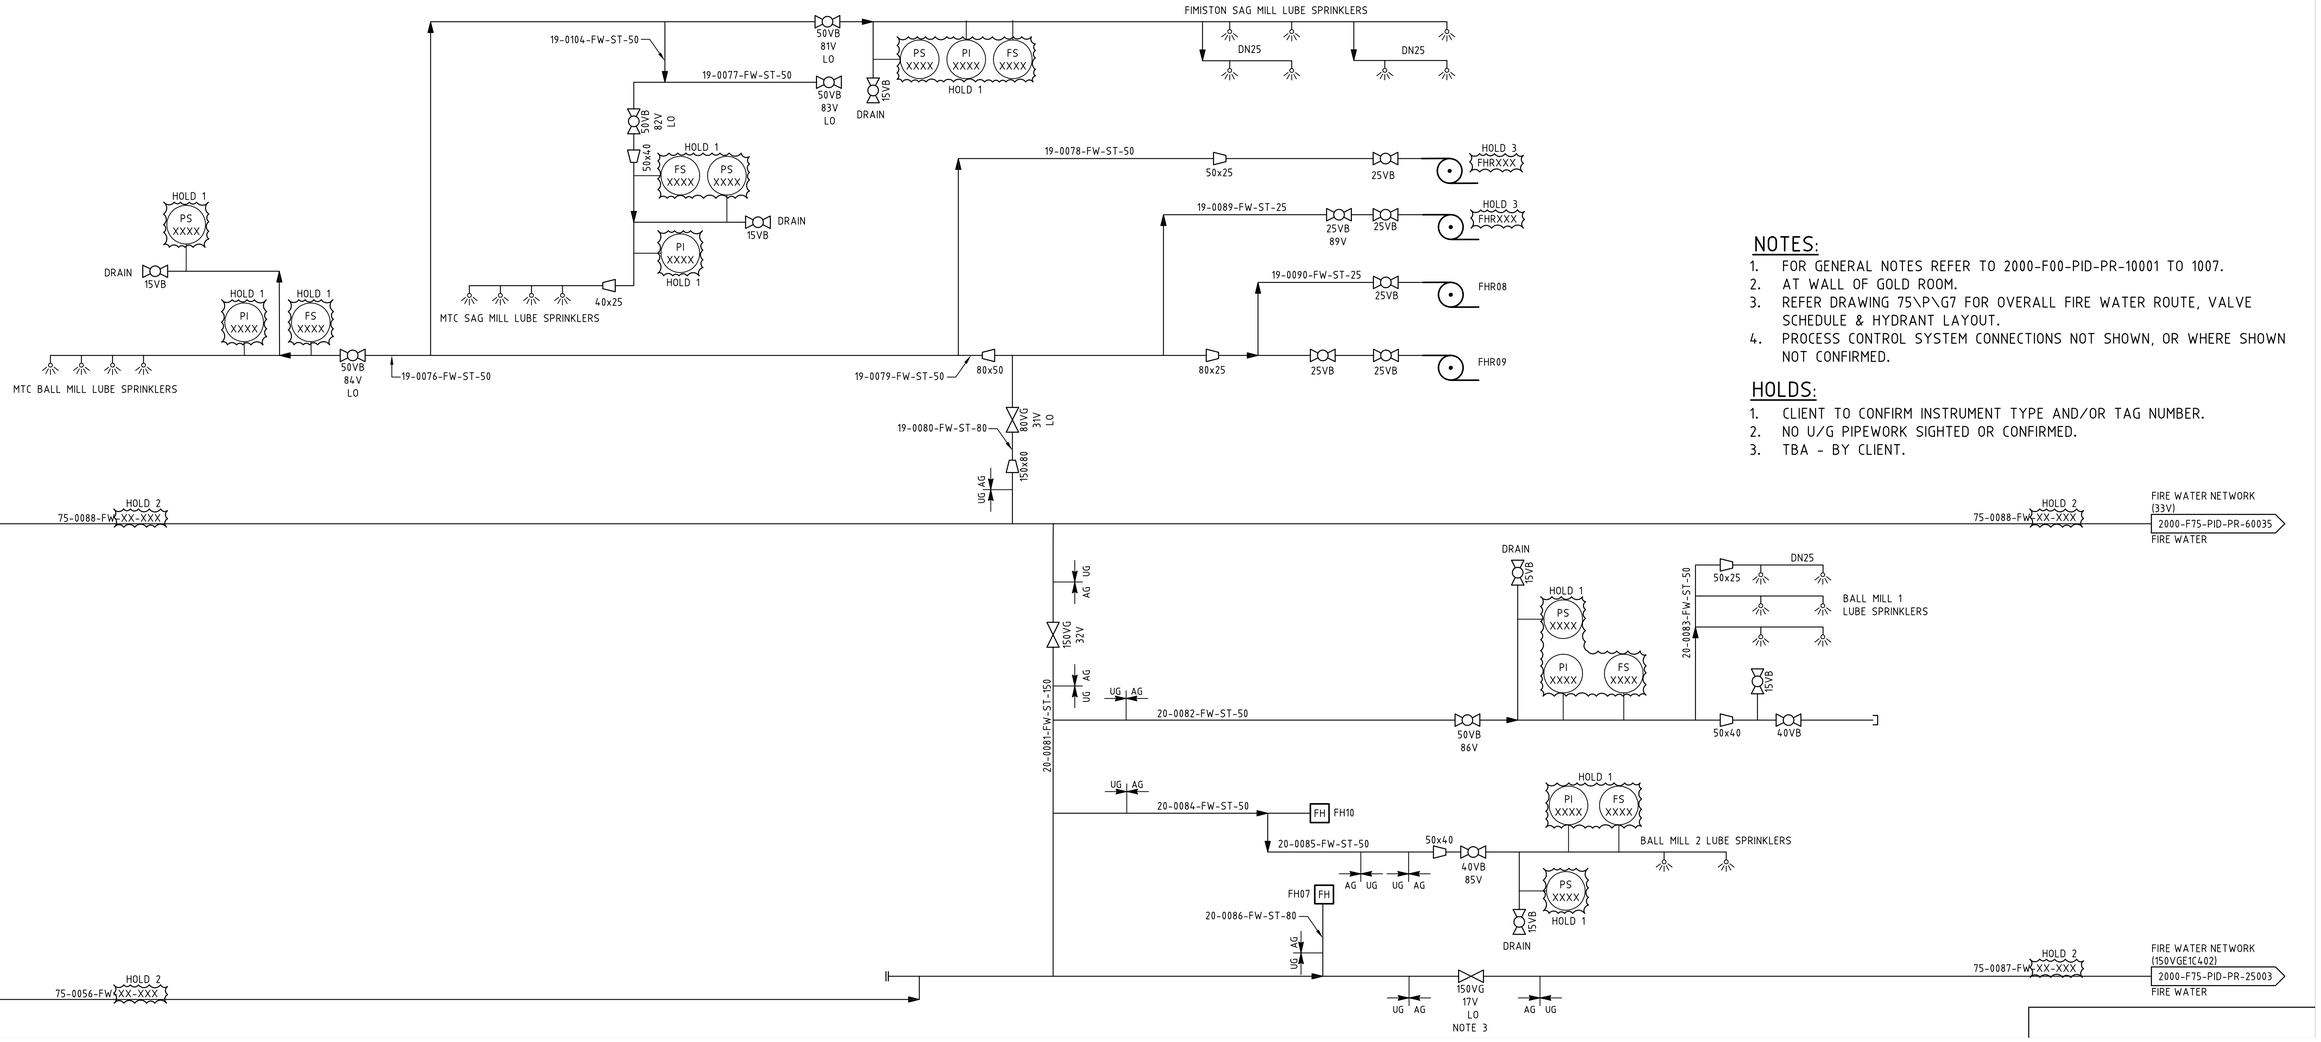

NOTES:

1. FOR GENERAL NOTES REFER TO 2000-F00-PID-PR-10001 TO 1007.
2. AT WALL OF GOLD ROOM.
3. REFER DRAWING 75\P\G7 FOR OVERALL FIRE WATER ROUTE, VALVE SCHEDULE & HYDRANT LAYOUT.
4. PROCESS CONTROL SYSTEM CONNECTIONS NOT SHOWN, OR WHERE SHOWN NOT CONFIRMED.

HOLDS:

1. CLIENT TO CONFIRM INSTRUMENT TYPE AND/OR TAG NUMBER.
2. NO U/G PIPEWORK SIGHTED OR CONFIRMED.
3. TBA - BY CLIENT.

SLB 2025.04.17 10:12:47+08'00'
2025.04.17 11:08:57+08'00'
2025.04.17 11:40:58+08'00'