A.

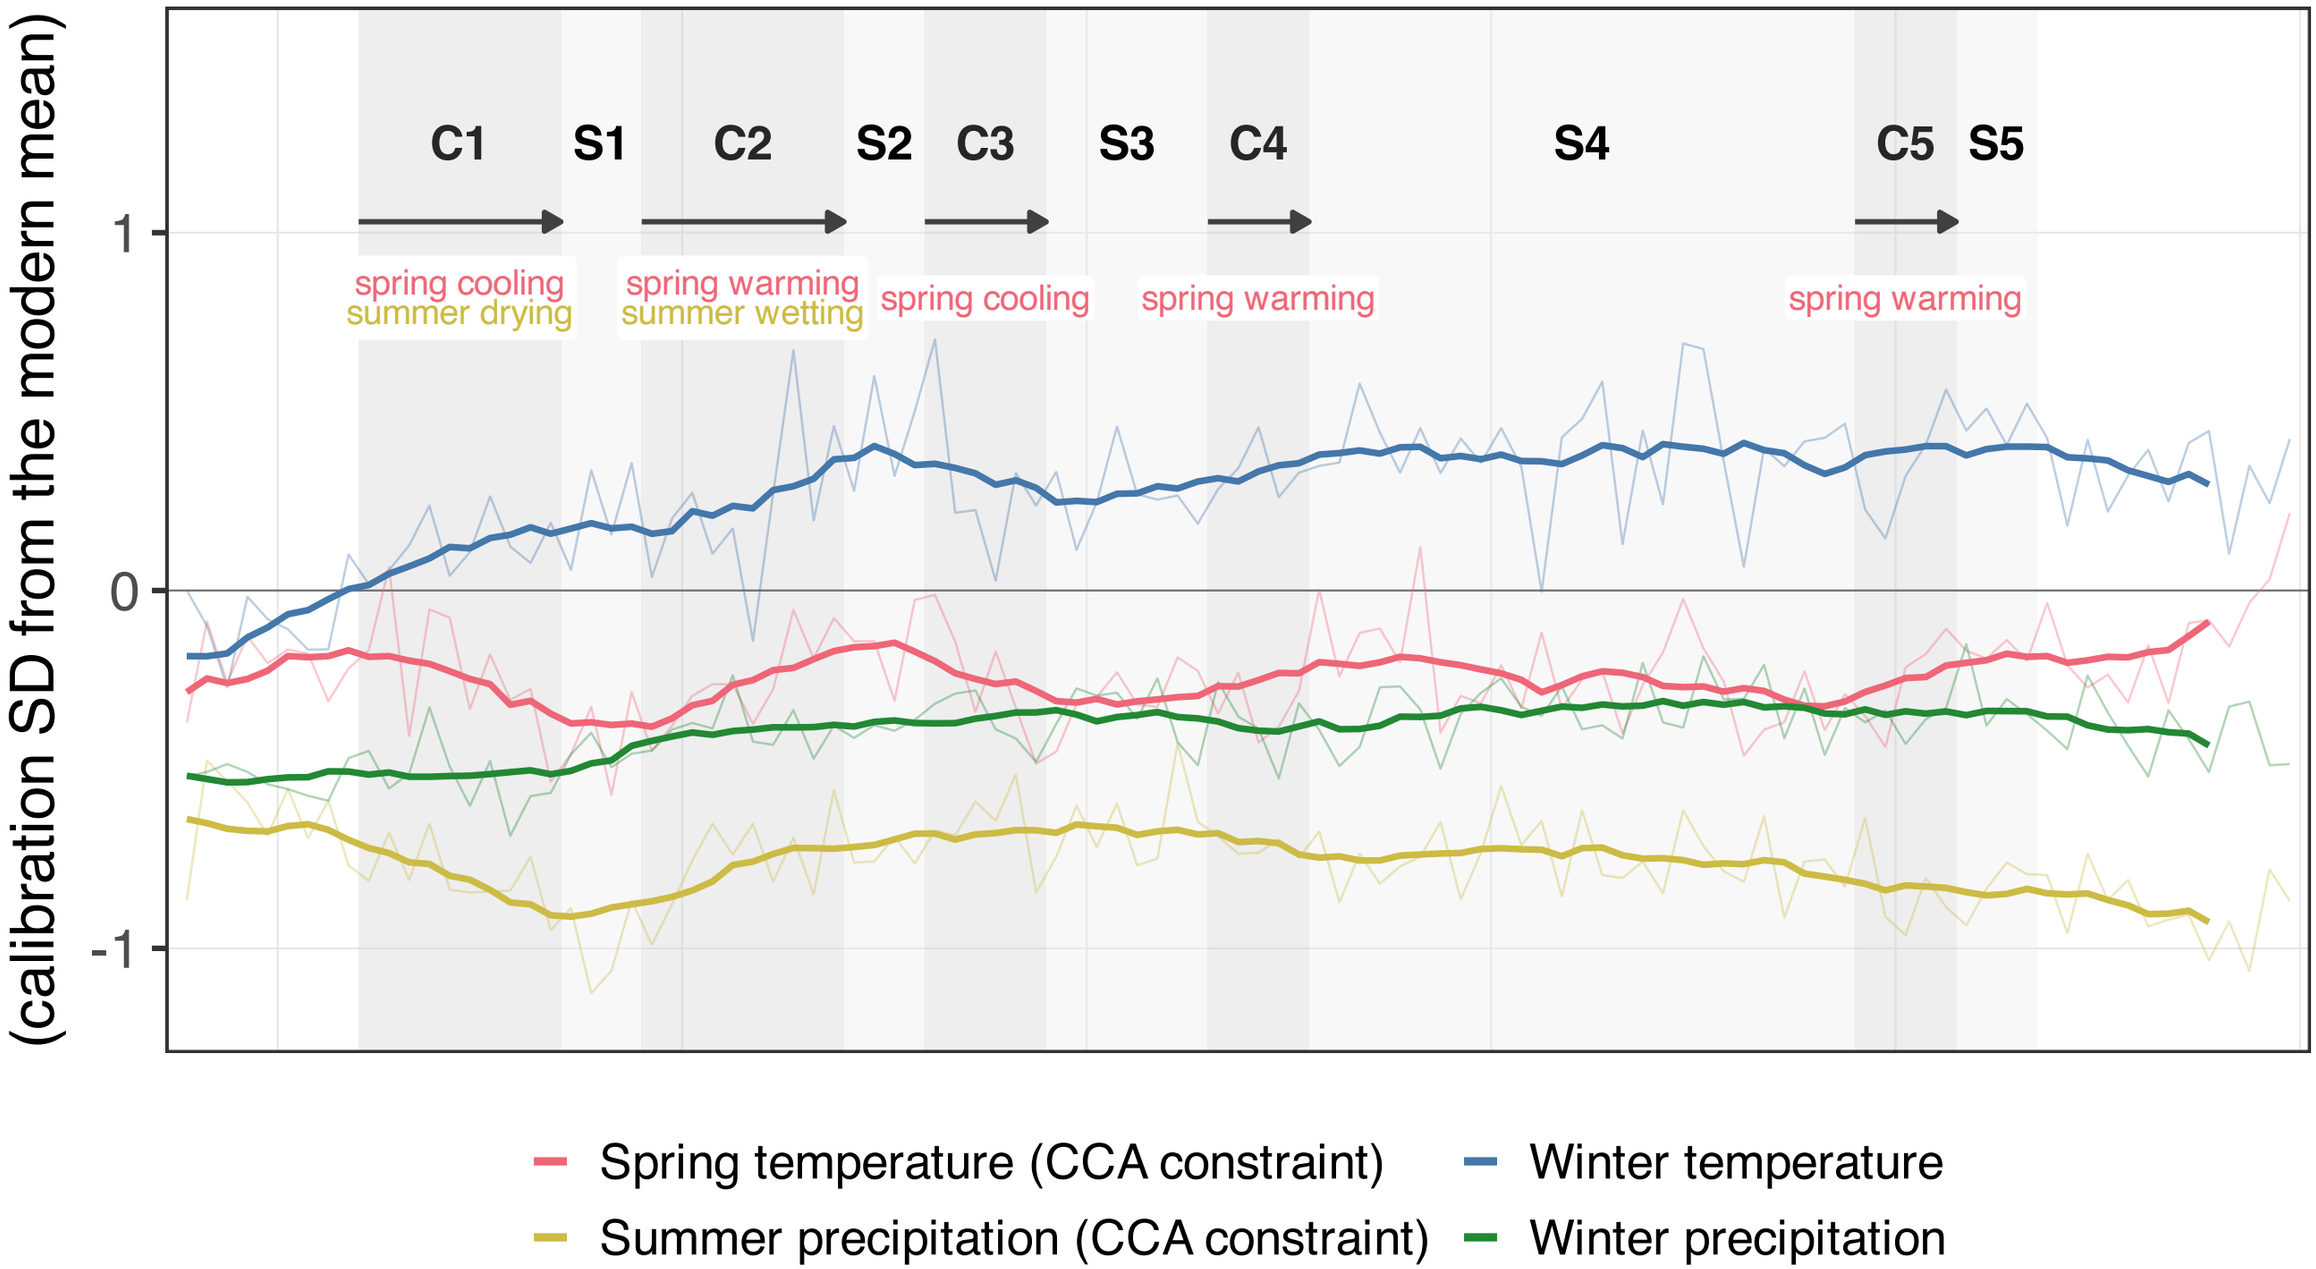
Standardized climate level
(calibration SD from the modern mean)
1
0
-1
C1
S1
C2
S2
C3
S3
C4
S4
C5
S5
spring cooling
summer drying
spring warming
summer wetting
spring cooling
spring warming
spring warming
Spring temperature (CCA constraint)
Winter temperature
Summer precipitation (CCA constraint)
Winter precipitation

B.

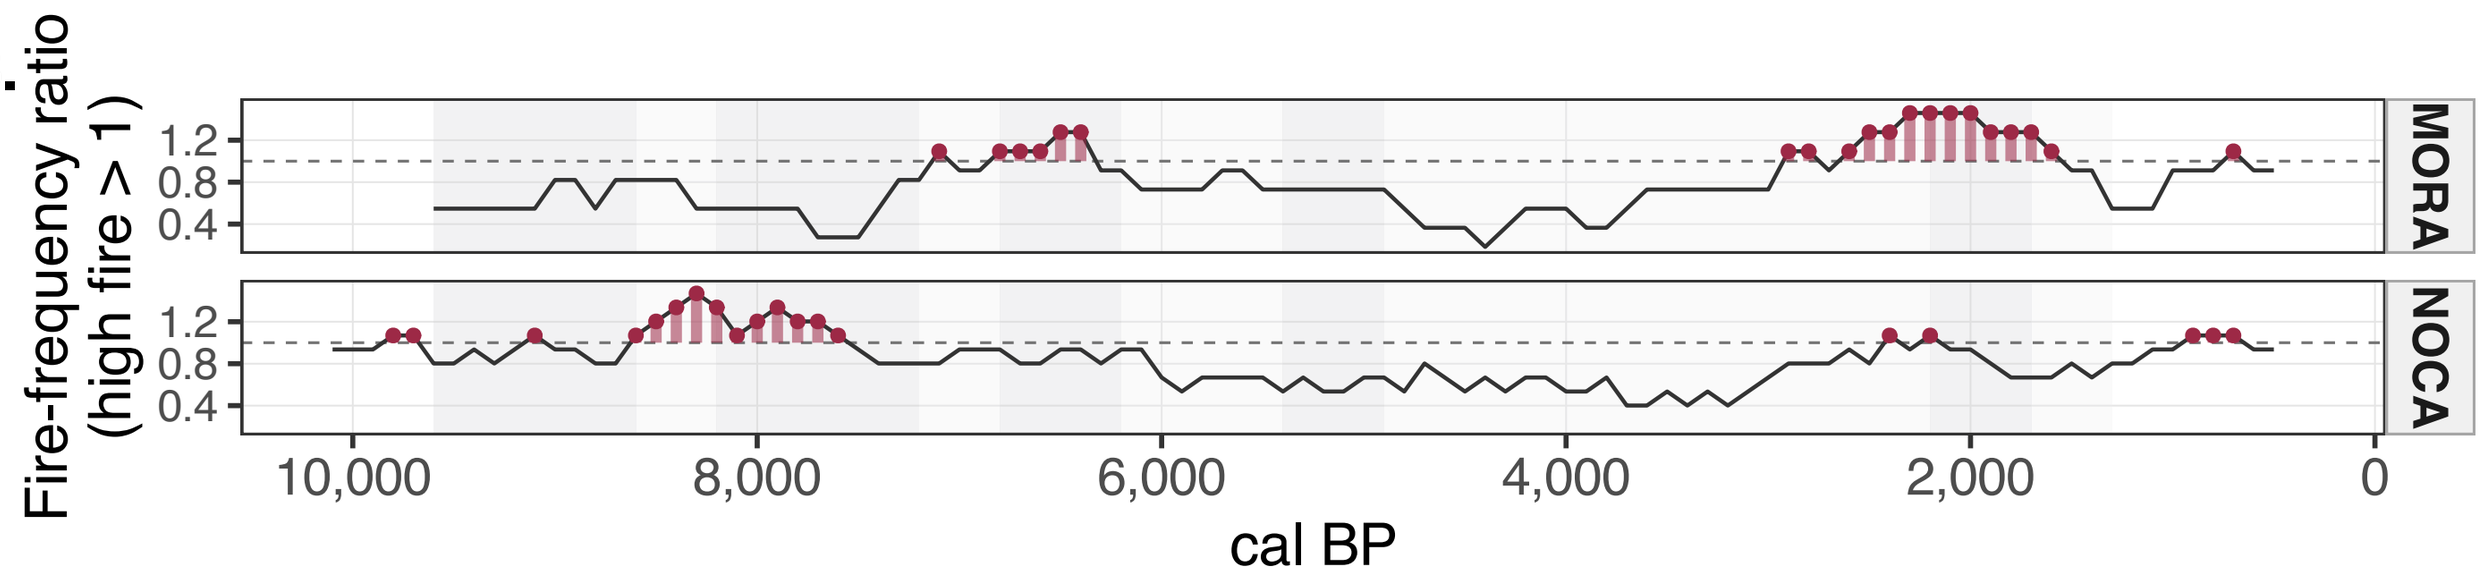
Fire-frequency ratio
(high fire > 1)
1.2
0.8
0.4
MORA
NOCA
10,000
8,000
6,000
4,000
2,000
0
cal BP