A.

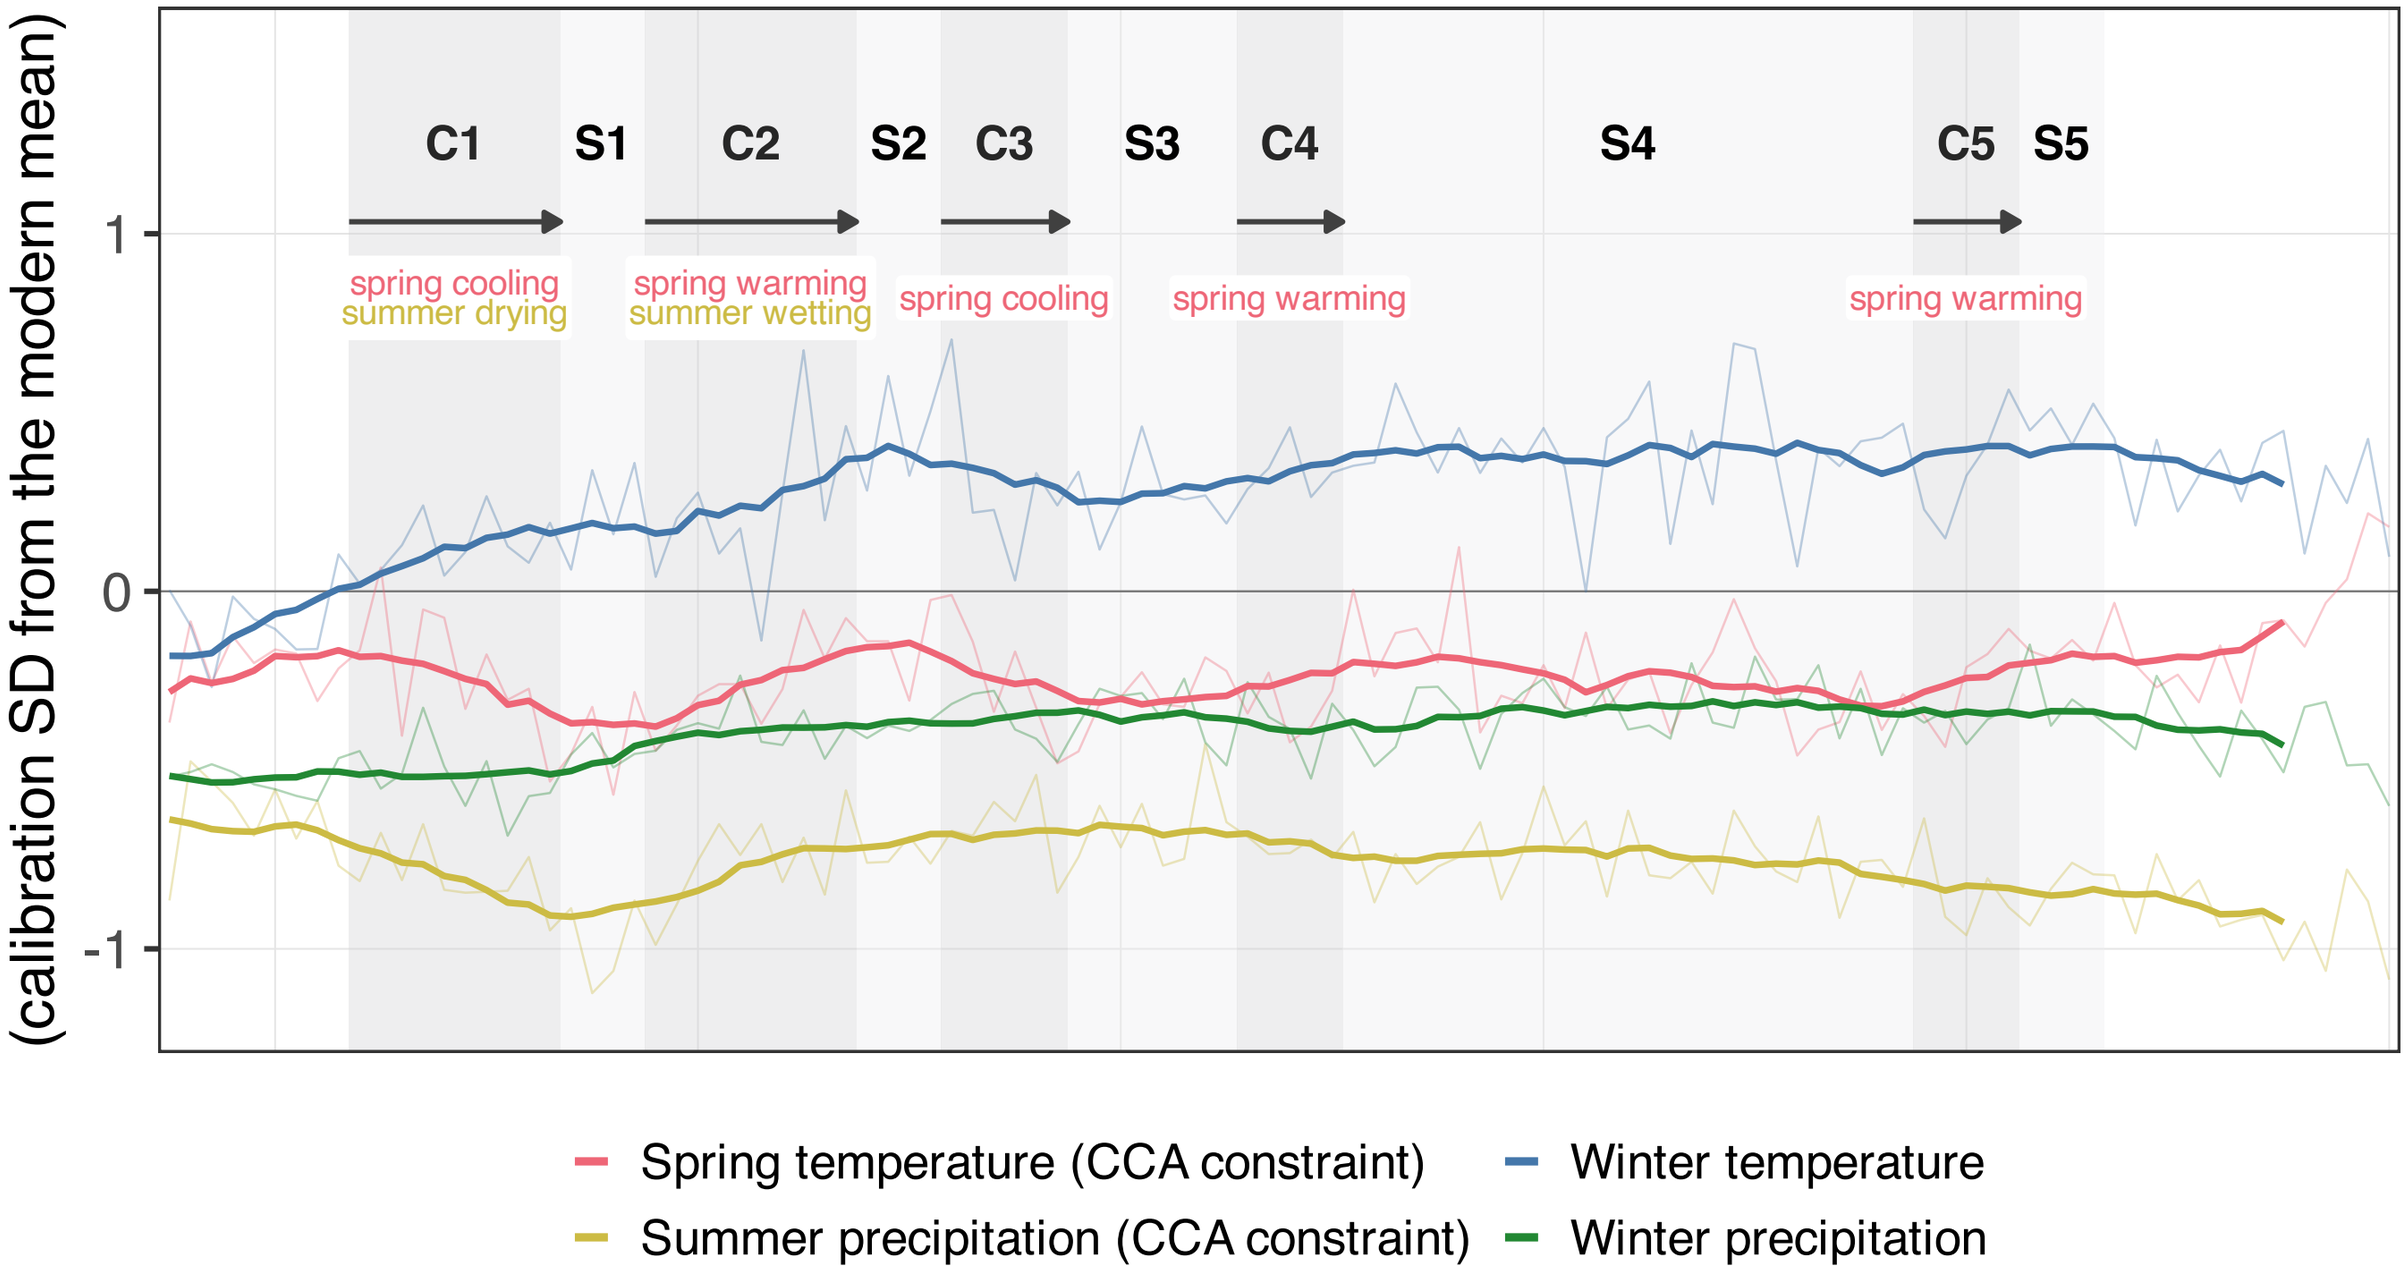
Standardized climate level
(calibration SD from the modern mean)
1
0
-1
C1
S1
C2
S2
C3
S3
C4
S4
C5
S5
spring cooling
summer drying
spring warming
summer wetting
spring cooling
spring warming
spring warming
Spring temperature (CCA constraint)
Summer precipitation (CCA constraint)
Winter temperature
Winter precipitation

B.

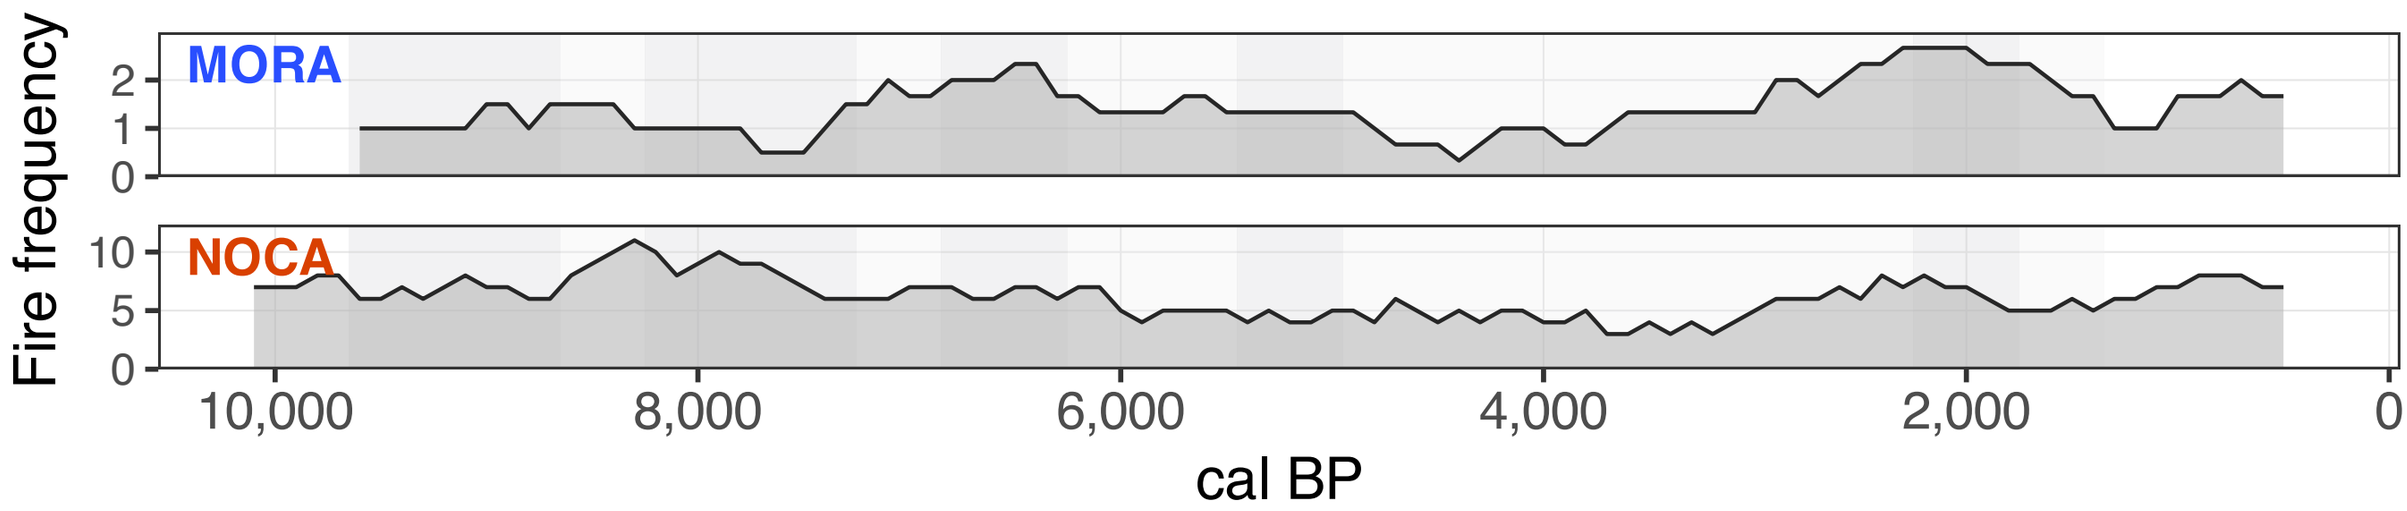
Fire frequency
MORA
2
1
0
NOCA
10
5
0
10,000
8,000
6,000
4,000
2,000
0
cal BP